


## Actual Supply & Power Position of Date: 07.01.2026

| Sl. No.                  | Actual Power Availability                 |                                        | Energy (MU) |
|--------------------------|-------------------------------------------|----------------------------------------|-------------|
| 1                        | State Generation                          |                                        | 8.88        |
| 2                        | Central Share to Uttarakhand & V.P. Share |                                        | 13.75       |
| Total from firm sources  |                                           |                                        | 22.63       |
| 3                        | Power from other sources                  | a) Power Purchase/Return Banking       | 15.00       |
|                          |                                           | b) Net IEX/PXIL Drawl                  | 11.25       |
|                          |                                           | c) Grid Overdrawl (+) / Underdrawl (-) | - 0.51      |
| Total from other sources |                                           |                                        | 25.74       |
| 4                        | Total Availability                        |                                        | 48.37       |
| 5                        | Rostering                                 |                                        | 0.13        |
| 6                        | Actual Demand                             |                                        | 48.50       |

| Actual Rostering on dated: 07-01-2026 |                        |
|---------------------------------------|------------------------|
| AREA                                  | HRS.                   |
| Rural of Haridwar & U.S. Nagar Distt. | 1:00 (Haridwar Distt.) |
| Small Towns                           | Nil                    |
| Other Towns                           | Nil                    |
| Hills                                 | Nil                    |
| Steel Furnaces                        | Nil                    |
| Non Continuous Industries             | Nil                    |

AVAILABILITY FROM CSGS VS ACTUAL DRAWL

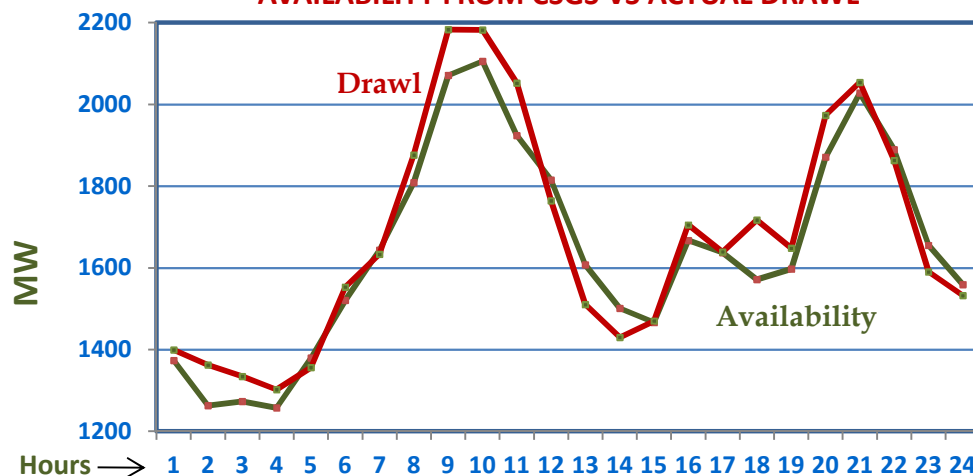

| TRANSMISSION CONSTRAINTS / CONTINGENCY |      |                                                        |
|----------------------------------------|------|--------------------------------------------------------|
| Substation                             | Hrs. | Reason                                                 |
| 132 KV S/s Jasodarpur                  | 2:06 | Due to Overloading of 315 MVA T/F at 400 KV Rishikesh. |
| 132 KV Laltappar                       | 1:37 |                                                        |
| 132 KV Bhupatwala                      | 2:06 |                                                        |
| 132 KV Rishikesh                       | 2:33 |                                                        |

|                      |                                                                                                                                                                                                                      |
|----------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Small Towns :</b> | Landhora Town, Manglore Town, Laksar Town, Bahadrabad Town, Dhakrani, Selaqui, Sahaspur, Vikasnagar, Doiwala, Kotdwar, Jwalapur, Jaspur Town, Kichha Town, Khatima Town, Ramnagar Town, Gadarpur Town & Bazpur Town. |
| <b>Other Towns :</b> | Rudrapur, Kashipur, Haldwani, Sitarganj & Roorkee Town.                                                                                                                                                              |