


Actual Supply & Power Position of Date: 13.07.2026

Sl. No.	Actual Power Availability		Energy (MU)	Actual Rostering on dated: 13-07-2026	
1	State Generation		23.81	AREA	HRS.
2	Central Share to Uttarakhand & V.P. Share		20.92	Rural of Haridwar & U.S. Nagar Distt.	0:30 (U.S. Nagar Distt.)
Total from firm sources			44.73		
3	Power from other sources	a) Power Purchase/Return Banking	8.44	Small Towns	Nil
		b) Net IEX/PXIL Drawl	0.12	Other Towns	Nil
		c) Grid Overdrawl (+) / Underdrawl (-)	0.31		
Total from other sources			8.87	Hills	Nil
4	Total Availability		53.60	Steel Furnaces	5:00
5	Rostering		0.84		
6	Actual Demand		54.44	Non Continuous Industries	Nil

AVAILABILITY FROM CSGS VS ACTUAL DRAWL

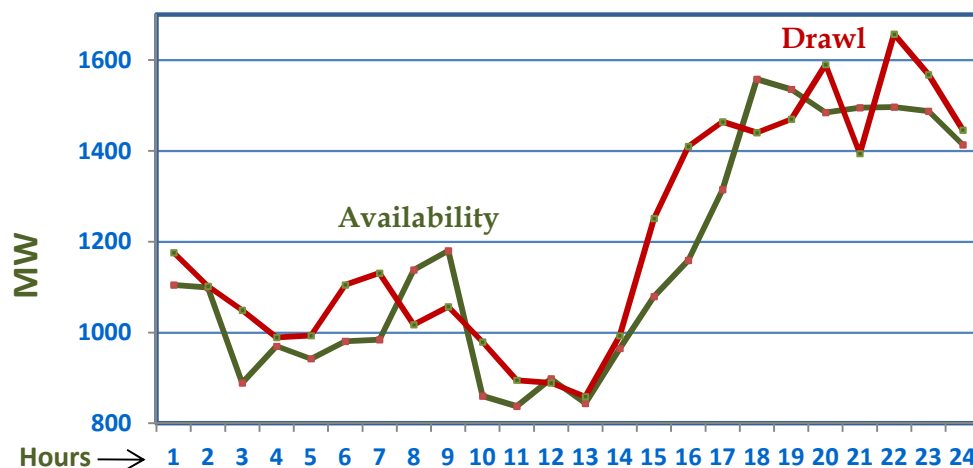

TRANSMISSION CONSTRAINTS / CONTINGENCY		
Substation / Area	Hrs.	Reason
132 KV Kashipur	0:07	Due to overload of 315 MVA T/F at Kashipur.
132 KV Jaspur	0:20	Due to shutdown of 220 KV line at Sharkot. As per request of SDO Sharkot.

Small Towns :	Landhora Town, Manglore Town, Laksar Town, Bahadrabad Town, Dhakrani, Selaqui, Sahaspur, Vikasnagar, Doiwala, Kotdwar, Jwalapur, Jaspur Town, Kichha Town, Khatima Town, Ramnagar Town, Gadarpur Town & Bazpur Town.
Other Towns :	Rudrapur, Kashipur, Haldwani, Sitarganj & Roorkee Town.