


Actual Supply & Power Position of Date: 13.08.2026

Sl. No.		Actual Power Availability		Energy (MU)
1		State Generation		20.60
2		Central Share to Uttarakhand & V.P. Share		22.79
Total from firm sources				43.39
3	Power from other sources	a) Power Purchase/Return Banking		12.66
		b) Net IEX/PXIL Drawl		- 1.63
		c) Grid Overdrawl (+) / Underdrawl (-)		0.32
Total from other sources				11.35
4		Total Availability		54.74
5		Rostering		1.82
6		Actual Demand		56.56

Actual Rostering on dated: 13-08-2026	
AREA	HRS.
Rural of Haridwar & U.S. Nagar Distt.	2:40 (Haridwar Distt.), 2:00 (U.S. Nagar Distt.)
Small Towns	2:15 (Garhwal), 0:50 (Kumaon)
Other Towns	Nil
Hills	Nil
Steel Furnaces	6:35 (Kumaon), 6:50 (Garhwal)
Non Continuous Industries	Nil

AVAILABILITY FROM CSGS VS ACTUAL DRAWL

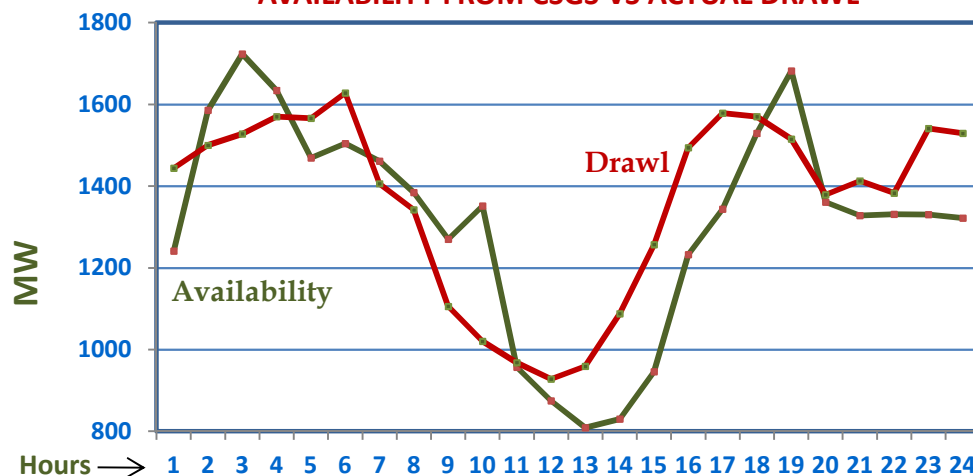

TRANSMISSION CONSTRAINTS / CONTINGENCY		
Substation / Area	Hrs.	Reason
220 KV Pantnagar	1:10	Due to tripping of 220 KV Pantnagar-Bareilly line.
132 KV Rudrapur	1:10	
132 KV Kashipur	2:05	Due to overloading of 315 MVA T/F at Kashipur.
132 KV Bazpur	2:45	
132 KV Jaspur	2:27	
132 KV Jaffarpur	1:15	
132 KV Mahuakhera	1:20	

Small Towns :	Landhora Town, Manglore Town, Laksar Town, Bahadrabad Town, Dhakrani, Selaqui, Sahaspur, Vikasnagar, Doiwala, Kotdwar, Jwalapur, Jaspur Town, Kichha Town, Khatima Town, Ramnagar Town, Gadarpur Town & Bazpur Town.
Other Towns :	Rudrapur, Kashipur, Haldwani, Sitarganj & Roorkee Town.