



सत्यमेव जयते

Ministry of Rural Development
Government of India

Quality Assurance Handbook for Rural Roads



Volume - II

**EQUIPMENT AND TEST
PROCEDURES**

May 2007



National Rural Roads Development Agency



**Ministry of Rural Development
Government of India**

Quality Assurance Handbook for Rural Roads

Volume-II

**EQUIPMENT AND TEST
PROCEDURES**

May 2007



National Rural Roads Development Agency

—◆—

Quality Assurance
Handbook for Rural Roads
has been developed by:
Indian Roads Congress
Kamakoti Marg,
Sector-6, R.K. Puram,
New Delhi-110022

—◆—

QUALITY ASSURANCE HANDBOOK FOR RURAL ROADS

VOLUME II

CONTENTS

		PAGE NO.
FORWARD		
PREFACE		
ABBREVIATIONS		
INTRODUCTION		1 TO 4
Section 100	GENERAL	100-1 to 100-11
	Preamble	
119	Equipment for Field Laboratory	
120	Equipment for Laboratory at District Level	
121	Equipment for Central Laboratory	
Section 300	EARTHWORKS	300-1 to 300-48
301	Embankment Construction	
A	Materials	
301.1	Grain Size Analysis	
301.2	Liquid Limit, Plastic Limits and Plasticity Index	
301.3	Proctor Density and Relationship between Dry Density and Moisture Content	
301.4	Free Swell Index Test	
301.5	Deleterious Content (Organic Matter)	
301.6	Deleterious Content (Soluble Sulphate)	
B	Construction & Workmanship	
301.7 (a)	Water Content of Soil – Oven Drying Method (Standard Method)	
301.7 (b)	Sand Bath Method (Subsidiary Method)	
301.7 (c)	Alcohol Method (Subsidiary Method)	

- 301.7 (d) Rapid Determination of Water Content with Infra-red Lamp Torsion Balance Moisture Meter
- 301.7 (e) Rapid Determination of Water Content from Gas Pressure developed by the Reaction of Calcium Carbide with the Free Water of the Soil
- 301.8 Measurement of In-situ Density / Degree of Compaction
 - 301.8(a) (a) Sand Replacement Method
 - 301.8(b) (b) Core Cutter Method
 - 301.8(c) (c) Nuclear Density Gauge
- 301.9 Horizontal Alignment
- 301.10 Surface Levels
- 301.11 Surface Regularity
- 302 Earthwork in Cutting**
- A Materials**
- 302.1 Grain Size Analysis
- 302.2 Liquid Limit, Plastic Limit and Plasticity Index
- 302.3 Proctor Density
- 302.4 Free Swell Index
- 302.5 Deleterious Content (Organic Matter)
- 302.6 Deleterious Content (Soluble Sulphate)
- 302.7 CBR of Remoulded and Soaked Samples
- B Construction & Workmanship**
- 302.8 Determination of Moisture Content
 - (a) Oven Drying Method
 - (b) Sand Bath Method
 - (c) Rapid Determination of Moisture Content using Calcium Carbide
- 302.9 Density of Compacted Material / Degree of Compaction
 - (a) Sand Replacement Method
 - (b) Core Cutter Method
 - (c) Nuclear Density Gauge
- 302.10 Horizontal Alignment
- 302.11 Surface Levels

302.12	Surface Regularity
303	Subgrade Construction
A	Materials
303.1	Grain Size Analysis
303.2	Liquid Limit, Plastic Limit and Plasticity Index
303.3	Proctor Density
303.4	Free Swell Index
303.5	Deleterious Content (Organic Matter)
303.6	Deleterious Content (Soluble Sulphate)
303.7	CBR of Remoulded and Soaked Samples
B	Construction & Workmanship
303.8	Moisture Content of In-situ Soil
	(a) Oven Drying Method
	(b) Sand Bath Method
	(c) Rapid Determination of Moisture Content using Calcium Carbide
303.9	In-situ Density / Degree of Compaction
	(a) Sand Replacement Method
	(b) Core cutter Method
	(c) Nuclear Density Gauge
303.10	Horizontal Alignment
303.11	Surface Levels
303.12	Surface Regularity
304	Rock Cutting
	Construction & Workmanship
304.1	Deviations of Pre-Split Face from Plane passing through adjacent holes.
304.2	Deviation from Drawings
306	Flyash Embankment Construction
A	Materials
306.1	Grain Size Analysis of Fly Ash (Pond Ash)
306.2	Grain Size Analysis of Soil for Cover

306.3	Liquid Limit and Plastic Limit of Soil for Cover
306.4	Proctor Density of Fly Ash (Pond Ash)
306.5	Proctor Density of Soil for Cover
306.6	Free Swell Index of Soil for Cover
306.7	Free Swell Index of Subgrade Material
306.8	Deleterious Content(Organic Matter) of Soil
306.9	Deleterious Content (Soluble Sulphate) of Soil
306.10	CBR on Remoulded Samples of Soil for Cover
B	Construction & Workmanship
306.11	Measurement of Field Density
306.12	Horizontal Alignment
306.13	Surface Levels
306.14	Surface Regularity
307	Surface Drains
	Cement for Brick Masonry Drains
	Bricks for Brick Masonry Drains
307.1	Colour and Size of Bricks
307.2	Water Absorption of Bricks
307.3	Efflorescence of Bricks
307.4	Compressive Strength of Bricks
	Cement for Brick Masonry Drains
307.5	Initial and Final Setting Time of Cement
	Lime in Lime – Cement Composite Mortar
307.6	Purity of Lime (Available CaO)
	Sand / Stone Dust / Marble Dust
307.7	Grain Size Analysis
307.8	Deleterious Material and Organic Impurities
	Water
307.9	Suitability of Water for Masonry Work

	Cement Sand Mortar	
307.11	Consistency of Mortar	
307.12	Water Retentivity of Mortar	
307.13	Compressive Strength of Mortar	
	Construction & Workmanship of Masonry Drains	
307.14	Dimensional Tolerances of Bricks	
307.15	Thickness of Joints for General Brick Work – Tolerance	
307.16	Thickness of Joints for Arches – Tolerance	
307.17	Plaster Finish – Tolerance	
	Stone Masonry for Drains	
307.18	Cement for Stone Masonry for Drains	
	Sand or Stone Dust or Marble Dust for Stone Masonry for Drains	
307.19	Grain Size Analysis	
	Cement Sand Mortar for Stone Masonry for Drains	
307.20	Compressive Strength of Mortar	
307.21	Water Retentivity of Mortar	
	Stones for Stone Masonry Drains	
307.22	Dimensional Tolerance of Stones	
307.23	Water Absorption of Stones	
307.24	Consumption of Mortar in Stone Masonry	
307.25	Water Cement Ratio of Mortar	
307.26	Compressive Strength of Stones	
Section 400	GRANULAR CONSTRUCTION	400-1 to 400-42
401	Granular Sub Base	
A	Materials	
401.1	Gradation Analysis of GSB Materials	
401.2	Liquid Limit and Plastic Limit of Material passing 425Micron size	
401.3	Grading and Plasticity Index Tests on Combined Materials from Different Sources	
401.4	Proctor Compaction Test	

- 401.5 Aggregate Impact Value (Wet) of Soft Aggregates
- 401.6 CBR on Representative Sample compacted at 100% Proctor Density

B Construction & Workmanship

- 401.7 Wet Sieve Analysis on Combined GSB Material
- 401.8 Liquid Limit and Plastic Limit
- 401.9 Placement Moisture Content
- 401.10 Compacted Thickness
- 401.11 In-situ Density / Degree of Compaction

401.12 Aggregate Impact Value

401.13 Horizontal Alignment

401.14 Surface Levels

401.15 Surface Regularity

402 Gravel / Soil Aggregate Base and Surface Course

A Materials

402.1 Gradation Analysis

402.2 Aggregate Impact Value (Wet)

402.3 Flakiness Index

402.4 Water Absorption of Aggregates

402.5 Soundness with Sodium Sulphate

402.6 Soundness with Magnesium Sulphate

B Construction & Workmanship

402.7 Wet Sieve Analysis on Combined GSB Material

402.8 Liquid Limit and Plastic Limit

402.9 Placement Moisture Content

402.10 Compacted Thickness

402.11 In-situ Density / Degree of Compaction

402.12 Aggregate Impact Value

401.13 Horizontal Alignment

401.14 Surface Levels

401.15	Surface Regularity
403	Lime Treated Soil for Improved Subgrade / Subbase
A	Materials
403.1	Purity of Lime
403.2	Determination of Optimum Quantity of lime
403.3	Plasticity Index of Lime Treated Soil
403.4	CBR of Lime Treated Soil
403.5	Unconfined Compressive Strength of Treated Soil
B	Construction & Workmanship
403.6	Pulverisation of Soil Clods
403.7	Placement Moisture Content
403.8	Maximum Dry Density and Degree of Compaction
403.9	Plasticity Index of Lime Treated Soil
403.10	Unconfined Compressive Strength of Sample extracted from Compacted Layer
403.11	Horizontal Alignment
403.12	Surface Levels
403.13	Surface Regularity
404	Cement Treated Soil Sub Base and Base
A	Materials
404.1	Quality of Cement
404.2	Purity of Lime
404.3	Unconfined Compressive Strength Test
B	Construction & Workmanship
404.4	Degree of Compaction
404.5	Unconfined Compressive Strength
404.6	Horizontal Alignment
404.7	Surface Levels
404.8	Surface Regularity

405	Water Bound Macadam Sub-base / Base/ Surfacing
A	Materials
405.1	Aggregate Impact Value (Dry and Wet)
405.2	Water Absorption of Aggregates
405.3	Soundness with Sodium Sulphate
405.4	Soundness with Magnesium Sulphate
405.6	Gradation Analysis of Aggregates and Screenings
405.7	Liquid Limit and Plastic Limit of Binder Material
B	Construction & Workmanship
405.8	Grading of Stone Aggregates and Screenings
405.9	Flakiness Index of Stone Aggregates
405.10	Plasticity Index of Crushable Screenings/Binding Material
405.11	Aggregate Impact Value
405.12	Layer Thickness
405.13	Volumetric Analysis
405.14	Horizontal Alignment
405.15	Surface Levels
405.16	Surface Regularity
406	Wet Mix Macadam Base
A	Materials
406.1	Aggregate Impact Value of Coarse Aggregates
406.2	Flakiness Index
406.3	Soundness with Sodium Sulphate
406.4	Soundness with Magnesium Sulphate
406.5	Gradation Analysis
406.6	Liquid Limit and Plastic Limit of Aggregate passing 425 Micron sieve
406.7	Proctor Compaction Test (After Replacing the Aggregate fraction retained on 22.4 mm sieve with material of 4.75 mm to 22.4 mm size)
B	Construction & Workmanship
406.8	Grading Analysis
406.9	Placement Moisture Content

406.10	Density of Compacted Layer
406.11	Horizontal Alignment
406.12	Surface Levels
406.13	Surface Regularity
407	Shoulder Construction
A	Materials
407.1	Free Swell Index for Earthen Shoulders
407.2	Dry Density for Earthen Shoulders
407.3	Grain Size Analysis for Earthen Shoulders
407.4	CBR of Remoulded and Soaked Material of Hard Shoulders
407.5	Aggregate Impact Value of Hard shoulders
407.6	Liquid Limit and Plastic Limit of Material passing 425 Micron Sieve
407.7	Compressive Strength of Bricks for Brick Edging
407.8	Efflorescence of Bricks for Brick Edging
407.9	Water Absorption of Bricks for Brick Edging
407.10	Compressive Strength of Stones for Stone Edging
407.11	Water Absorption of Stones for Stone Edging
407.12	Impact Value of Stones (Dry and Wet)
B	Construction & Workmanship
407.13	Horizontal Alignment
407.14	Surface Levels
407.15	Surface Regularity
408	Local Materials for Road Construction
A	Materials
408.1	Aggregate Impact Value (Dry and Wet) of Kankar, Laterite, Dhandla
408.2	Liquid Limit and Plastic Limit of Naturally Occurring Gravels
408.3	CBR on Soaked Material for Soil-Gravel Material
408.4	Gradation Analysis for Soil Gravel Mix
408.5	Determination of Total Calcium Oxide in Lime
408.6	Placement Moisture Content for Treated Stabilization

408.7	Unconfined Compressive Strength of Stabilized Soil Samples
408.8	Compressive Strength of Cement for Cement Treated Stabilization
408.9	Setting time of Cement
408.10	Tests on Water for Use in Cement Stabilisation
B	Construction & Workmanship
408.11	Placement Moisture Content
408.12	Degree of Compaction
408.13	Horizontal Alignment
408.14	Surface Levels
408.15	Surface Regularity
409	Lime- Flyash Stabilised Soil Sub-base
A	Materials
409.1	Fineness of Flyash by Blaine Apparatus
409.2	Particles Retained on 75 Micron IS Sieve
409.3	Lime Reactivity
409.4	Soundness by Autoclave Expansion
409.5	Soundness by Le Chatelier Method
409.6	Quality of Water
B	Construction & Workmanship
409.7	Unconfined Compressive Strength of Lime-Flyash Mix
409.8	Horizontal Alignment
409.9	Surface Levels
409.10	Surface Regularity
410	Industrial Wastes for Road Construction
A	Material
	Fly-Ash (Pond Ash) in Embankment Construction
410.1	Grain Size Analysis of Fly Ash (Pond Ash)
410.2	Grain Size Analysis of Soil for Cover
410.3	Liquid Limit and Plastic Limit of Soil for Cover

410.4	Proctor Density of Fly Ash (Pond Ash)
410.5	Proctor Density of Soil for Cover
410.6	Free Swell Index of Soil for Cover
410.7	Free Swell Index of Subgrade Material
410.8	Deleterious Content(Organic Matter) of Soil
410.9	Deleterious Content (Soluble Sulphate) of Soil
410.10	CBR on Remoulded Samples of Soil for Cover
	Fly Ash in Lime-Fly Ash Stabilised Soil Base
410.11	Fineness of Flyash by Blaine Apparatus
410.12	Particles Retained on 75 Micron IS Sieve
410.13	Lime Reactivity
410.14	Soundness by Autoclave Expansion
410.15	Soundness by Le Chatelier Method
410.16	Quality of Water
	Fly Ash in Lime Fly Ash Bound Macadam
410.17	Aggregate Impact Value (Dry and Wet)
410.18	Water Absorption of Aggregates
410.19	Soundness with Sodium Sulphate
410.20	Soundness with Magnesium Sulphate
410.21	Gradation Analysis of Aggregates and Screenings
410.22	Liquid Limit and Plastic Limit of Binder Material
410.23	Horizontal Alignment
410.24	Surface Level
410.25	Surface Regularity
	Slag in Gravel/Soil-Aggregate Base/Surfacing
410.26	Gradation Analysis
410.27	Aggregate Impact Value (Wet)
410.28	Flakiness Index
410.29	Water Absorption of Aggregates
410.30	Soundness with Sodium Sulphate

410.31	Soundness with Magnesium Sulphate
	Slag in Water Bound Macadam
410.32	Aggregate Impact Value (Dry and Wet)
410.33	Water Absorption of Aggregates
410.34	Soundness with Sodium Sulphate
410.35	Soundness with Magnesium Sulphate
410.36	Gradation Analysis of Aggregates and Screenings
410.37	Liquid Limit and Plastic Limit of Binder Material
410.38	Aggregate Impact Value
410.39	Water Absorption
	Slag in Cement Treated Sub Base / Base
410.40	Quality of Cement
410.41	Purity of Lime
410.42	Unconfined Compressive Strength Test
B	Construction & Workmanship
410.43	Horizontal Alignment
410.44	Surface Levels
410.45	Surface Regularity
411	Crusher Run Macadam Base
A	Materials
411.1	Aggregate Impact Value
411.2	Flakiness Index
411.3	Water Absorption
411.4	Liquid Limit and Plastic Limit of Material passing 425 Micron
411.5	Soundness of rocks
411.6	Gradation Analysis
411.7	Density of Compacted Layer
B	Construction & Workmanship
411.8	Horizontal Alignment

411.9	Surface Level	
411.10	Surface Regularity	
412	Brick Soling	
A	Materials	
412.1	Size and Colour of Bricks	
412.2	Compressive Strength of Bricks	
412.3	Water Absorption	
412.4	Efflorescence of Bricks	
B	Construction & Workmanship	
412.5	Horizontal Alignment	
412.6	Surface Levels	
412.7	Surface Regularity	
413	Stone Set Pavement	
A	Materials	
413.1	Aggregate Impact Value	
413.2	Water Absorption	
B	Construction & Workmanship	
413.3	Horizontal Alignment	
413.4	Surface Level	
413.5	Surface Alignment	
Section 500	BITUMINOUS CONSTRUCTION	500-1- 500-38
501	Preparation of Surface	
A	Materials	
501.1	Grain Size Analysis of Crusher Dust	
501.2	Viscosity of Bitumen Emulsion (Saybolt Furol)	
501.3	Test on Bitumen Emulsion Residue on 600 Micron	
501.4	Storage Stability Tests on Emulsion	
501.5	Flash Point of Cutback Bitumen	
501.6	Binder for Tack Coat	

B	Construction & Workmanship
5017	Horizontal Alignment
501.8	Surface Levels
501.9	Surface Regularity
502	Prime Coat Over Granular Base
A	Materials
502.1	Grain Size Analysis of Crusher Dust
502.2	Viscosity of Bitumen Emulsion (Saybolt Furol)
502.3	Residue of Bitumen Emulsion on 600 Micron
502.4	Storage Stability Test
502.5	Flash Point Test for Bitumen Cutback
502.6	Viscosity of Bitumen Cutback
B	Construction & Workmanship
502.7	Temperature of Binder
502.8	Rate of Spread of Binder
503	Tack Coat
A	Materials
503.1	Grain Size Analysis of Crusher Dust
503.2	Viscosity of Bitumen Emulsion (Saybolt Furol)
503.3	Residue of Bitumen Emulsion on 600 Micron
503.4	Storage Stability Test
503.5	Flash Point Test for Bitumen Cutback
503.6	Viscosity of Bitumen Cutback
B	Construction & Workmanship
503.5	Temperature of Binder
503.6	Rate of Spread of Binder
504	Bituminous Macadam
A	Materials
504.1	Quality of Binder – Straight –run Bitumen
504.1(a)	Penetration Test

504.1 (b)	R&B Softening Point
504.1 (c)	Ductility of Bitumen
504.2	Quality of Binder – Modified Bitumen
504.2 (a)	Penetration Test
504.2 (b)	R&B Softening Point
504.2 (c)	Elastic Recovery Test
504.2 (d)	Separation Test
504.3	Aggregate Impact Value
504.4	Flakiness Index
504.5	Bituminous Stripping of Aggregate Test
504.6	Water Absorption of Aggregates
504.7	Soundness with Sodium Sulphate
504.8	Soundness with Magnesium Sulphate
B	Construction & Workmanship
504.9	Grading of Aggregates
504.10	Binder Content
504.11	Density of Compacted Layer
504.12	Temperature of Binder before Mixing
504.13	Temperature of Binder During Laying and Compaction
504.14	Thickness of Compacted Layer
504.15	Horizontal Alignment
504.16	Surface Level
504.17	Surface Regularity
505	Built up Spray Grout
A	Materials
505.1	Quality of Binder – Straight –run Bitumen
505.1(a)	Penetration Test
505.1 (b)	R&B Softening Point
505.1 (c)	Ductility of Bitumen

505.2	Quality of Binder – Modified Bitumen
505.2 (a)	Penetration Test
505.2 (b)	R&B Softening Point
505.2 (c)	Elastic Recovery Test
505.2 (d)	Separation Test
505.3	Aggregate Impact Value
505.4	Flakiness Index
505.5	Bituminous Stripping of Aggregate Test
505.6	Water Absorption of Aggregates
505.7	Soundness with Sodium Sulphate
505.8	Soundness with Magnesium Sulphate
A	Construction & Workmanship
505.9	Rate of Spread of Binder
505.10	Rate of Spread of Aggregates
505.11	Grading of Aggregates
505.12	Temperature of Binder during Spraying
505.13	Thickness of Compacted Layer
505.14	Horizontal Alignment
505.15	Surface Level
505.16	Surface Regularity
506	Modified Penetration Macadam
A	Materials
506.1	Quality of Binder – Straight –run Bitumen
506.1(a)	Penetration Test
506.1 (b)	R&B Softening Point
506.1 (c)	Ductility of Bitumen
506.2	Quality of Binder – Modified Bitumen
506.2 (a)	Penetration Test
506.2 (b)	R&B Softening Point

506.2 (c)	Elastic Recovery Test
506.2 (d)	Separation Test
506.3	Aggregate Impact Value
506.4	Flakiness Index
506.5	Bituminous Stripping of Aggregate Test
506.6	Water Absorption of Aggregates
506.7	Soundness with Sodium Sulphate
506.8	Soundness with Magnesium Sulphate
B	Construction & Workmanship
506.9	Rate of Spread of Binder
506.10	Rate of Spread of Aggregates
506.11	Grading of Aggregates
506.12	Temperature of Binder during Spraying
506.13	Thickness of Compacted Layer
506.14	Horizontal Alignment
506.15	Surface Level
506.16	Surface Regularity
507	Surface Dressing
A	Materials
507.1	Quality of Binder – Straight –run Bitumen
507.1(a)	Penetration Test
507.1 (b)	R&B Softening Point
507.1 (c)	Ductility of Bitumen
507.2	Quality of Binder – Bitumen Emulsion
507.2 (a)	Viscosity
507.2 (b)	Residue on 600 Micron IS Sieve
507.2 (c)	Storage Stability Test
507.3	Quality of Binder – Modified Bitumen
507.3 (a)	Penetration Test

507.3 (b)	R&B Softening Point
507.3 (c)	Elastic Recovery Test
507.3 (d)	Separation Test
507.4	Aggregate Impact Value
507.5	Flakiness Index
507.6	Bituminous Stripping of Aggregate Test
507.7	Water Absorption of Aggregates
507.8	Soundness with Sodium Sulphate
507.9	Soundness with Magnesium Sulphate
B	Construction & Workmanship
507.10	Rate of Spread of Binder
507.11	Rate of Spread of Aggregates
507.12	Grading of Aggregates
507.13	Temperature of Binder during Spraying
507.14	Horizontal Alignment
507.15	Surface Level
507.16	Surface Regularity
508.1	20 mm Thick Premix Carpet using Bitumen
A	Materials
508.1.1	Quality of Binder – Straight –run Bitumen
508.1.1(a)	Penetration Test
508.1.1 (b)	R&B Softening Point
508.1.1 (c)	Ductility of Bitumen
508.1.2	Quality of Binder – Bitumen Emulsion
508.1.2 (a)	Viscosity
508.1.2 (b)	Residue on 600 Micron IS Sieve
508.1.2 (c)	Storage Stability Test
508.1.3	Quality of Binder – Modified Bitumen
508.1.3 (a)	Penetration Test

508.1.3 (b)	R&B Softening Point
508.1.3 (c)	Elastic Recovery Test
508.1.3 (d)	Separation Test
508.1.4	Aggregate Impact Value
508.1.5	Flakiness Index
508.1.6	Bituminous Stripping of Aggregate Test
508.1.7	Water Absorption of Aggregates
508.1.8	Soundness with Sodium Sulphate
508.1.9	Soundness with Magnesium Sulphate
B	Construction & Workmanship
508.1.10	Grading of Aggregates
508.1.11	Binder Content Before Seal Coat
508.1.12	Temperature of Binder
508.1.13	Thickness Before and After Compaction
508.1.14	Horizontal Alignment
508.1.15	Surface Levels
508.1.16	Surface Regularity
508.2	20mm Thick Premix Carpet using Bitumen Emulsion
A	Materials
508.2.1	Quality of Binder (Bitumen Emulsion)
508.2.1 (a)	Penetration
508.2.1 (b)	Softening Point Test
508.2.1 (c)	Elastic Recovery
508.2.1 (d)	Separation Test
508.2.2	Aggregate Impact Value
508.2.3	Flakiness Index
508.2.4	Bitumen Stripping of Aggregates
308.2.5	Water Absorption
508.2.6	Soundness with Sodium Sulphate

508.2.7	Soundness with Magnesium Sulphate
B	Construction & Workmanship
508.2.8	Grading of Aggregates
508.2.9	Binder Content before Seal Coat
508.2.10	Temperature of Binder
508.2.11	Thickness before and after Compaction
508.2.12	Thickness of Layer with Seal Coat
508.2.13	Horizontal Alignment
508.2.14	Surface Level
508.2.15	Surface Regularity
509	Mix Seal Surfacing
A	Materials
509.1	Flakiness Index of Aggregate
509.2	Aggregate Impact Value
509.3	Soundness with Sodium Sulphate
509.4	Soundness with Magnesium Sulphate
509.5	Water Absorption
509.6	Coating and Stripping of Bitumen Aggregate Mixture
509.7	Gradation Analysis
509.8	Binder
B	Construction & Workmanship
509.9	Horizontal Alignment
509.10	Surface Level
509.11	Surface Regularity
510	Seal Coat
A	Materials
510.1	Gradation Analysis
510.2	Flakiness Index of Aggregate
510.3	Aggregate Impact Value

510.4	Soundness with Sodium Sulphate	
510.5	Soundness with Magnesium Sulphate	
510.6	Water Absorption	
510.7	Coating and Stripping of Bitumen Aggregate Mixture	
510.8	Temperature of Binder	
510.9	Penetration on Paving Bitumen/Modified Emulsion	
510.10	Softening Point on Paving Bitumen/Modified Emulsion	
510.11	Ductility on Paving Bitumen	
510.12	Elastic Recovery of Modified Bitumen	
510.13	Viscosity	
510.14	Residue on 600 Micron	
510.15	Storage Stability Test for Emulsion	
B	Construction & Workmanship	
510.16	Rate of Spread of Binder	
510.17	Rate of Spread of Aggregates	
512	Modified Bitumen	
A	Materials	
512.1	Penetration	
512.2	Softening Point	
512.3	Elastic Recovery	
512.4	Separation	
Section 600	BRICKWORK FOR STRUCTURES	600-1 to 600-22
A	Materials	
600.1	Colour and Dimensional Check of Bricks	
600.2	Water Absorption of Bricks	
600.3	Efflorescence of Bricks	
600.4	Compressive Strength of Bricks	
600.5	Setting Time of Cement	
600.6	Purity of Lime	

600.7	Grain Size Analysis of Sand / Stone / Marble dust	
600.8	Water for Construction	
B	Construction & Workmanship	
600.9	Height, Bond and Verticality by Plumb Bob	
600.10	Consistency of Cement Mortar	
600.11	Water Retentivity of Mortar	
600.12	Compressive Strength of Mortar	
600.13	Thickness of Joints in General Brick Work	
600.14	Thickness of Joints in Arches	
600.15	Plaster Finish	
Section 700	STONE MASONRY FOR STRUCTURES	700-1 to 700-6
A	Materials	
700.1	Shape and Dimensions of Stones	
700.2	Water Absorption of Stones	
700.3	Dressing of Stones	
700.4	Setting Times Cement	
700.5	Purity of Lime	
700.6	Gradation of Sand	
700.7	Deleterious Material and Organic Impurities	
700.8	Water for Construction	
700.9	Size of Precast Concrete Blocks	
700.10	Consistency of Cement Mortar	
700.11	Water Retentivity of Mortar	
700.12	Mix Proportions for Different Works	
700.13	Compressive Strength of Mortar	
B	Construction & Workmanship	
700.14	Horizontality and Verticality	
700.15	Height and Thickness	
700.16	Thickness of Joints of Masonry	
700.17	Thickness of Joints in Arches	

Section 800

CONCRETE FOR STRUCTURES

800-1 to 800-33

A

Materials

Cement

- 800.1 Setting Times of Cement
- 800.2 Soundness of Cement
- 800.3 Compressive Strength of Cement

Coarse Aggregates

- 800.4 Gradation Analysis
- 800.5 Flakiness Index of Coarse Aggregates
- 800.6 Deleterious Materials and Organic Impurities
- 800.7 Water Absorption / Water Content
- 800.9 Aggregate Impact Value
- 800.10 Soundness
- 800.11 Alkali Aggregate Reactivity

Fine Aggregates

- 800.12 Gradation of Fine Aggregates
- 800.13 Deleterious Constituents
- 800.14 Alkali Aggregate Reactivity
- 800.15 Water for Construction
- 800.16 Mix Design for Each Work

B

Construction & Workmanship

- 800.17 Moisture Content of Coarse and Fine Aggregates
- 800.18 Cement Consumption
- 800.19 Workability of Concrete by Slump Test
- 800.20 Workability of Concrete by Compaction Test
- 800.21 Formwork and Construction Joints
- 800.22 Curing of Concrete
- 800.23 Schmidt's Rebound Hammer
- 800.24 Ultrasonic Pulse Velocity
- 800.25 Accelerated Curing Test

800.26	Compressive Strength of Concrete Cubes (150 mm x150 mmx150 mm) at 28 days	
800.27	Flexural Strength of Concrete	
Section 900	FORMWORK AND SURFACE FINISH FOR STRUCTURES	900-1 to 900-3
901	Materials and Design	
902	Construction Operations	
903	Removal of Formwork	
Section 1000	STEEL REINFORCEMENT	1000-1 to 1000-6
A	Material	
1000.1	Grade, Percentage Elongation and Ultimate Tensile Strength of Steel	
1000.2	Pitch of the Ribs and Nominal Diameter	
1000.3	Bending and Placing of Reinforcement	
1000.4	Splicing, Welding and Tolerances	
B	Construction & Workmanship	
1000.5	Route Inspection and Testing	
Section 1100	PIPE CULVERTS	1100-1 to 1100-5
A	Materials	
1100.1	Colour and Dimensional Check of Bricks	
1100.2	Water Absorption of Bricks	
1100.3	Efflorescence of Bricks	
1100.4	Compressive Strength of Bricks	
1100.5	Shape and Dimensions of Stones	
1100.6	Water Absorption of Stones	
1100.7	Dressing of Stones	
1100.8	Dimensions of Concrete Pipes	
1100.9	Manufacturing Defects and Tolerances	
1100.10	Three Edge Bearing Test	
Section 1200	RCC SLAB CULVERTS AND MINOR BRIDGES	1200-1 to 1200-2
A	Materials	
1200.1	Tests on Bricks	

- 1200.2 Tests on Stone
- 1200.3 Tests on Concrete Ingredients
- 1200.4 Tests on Water
- 1200.5 Tests on Steel Reinforcement
- 1200.6 Certification of Composition of steel by the Manufacturer
- 1200.7 Certification of Mechanical Properties of steel by the Manufacturer

B Construction & Workmanship

- 1200.8 Tolerances in Various Dimensions and Levels
- 1200.9 Reinforcement Cage
- 1200.10 Workability of Concrete
- 1200.11 Compaction of Concrete
- 1200.12 Curing of Concrete
- 1200.13 Compressive Strength of Concrete
- 1200.14 Flexural Strength of Concrete
- 1200.15 Tests on Sealants (Poly Sulphate or Bituminous)
- 1200.16 Test Certificates from the Manufacturers for Elastomeric Bearings, Expansion Joints, Plasticisers

Section 1300 PROTECTION WORKS AND DRAINAGE 1300-1 to 1300-2

A Materials

- 1300.1 Brick Masonry
- 1300.2 Stone Masonry
- 1300.3 Concrete for Structures
- 1300.4 Wire Crates (Size and Mesh Size)

B Construction & Workmanship

- 1300.5 Brick Masonry
- 1300.6 Stone Masonry
- 1300.7 Tests on Mortar for Joint
- 1300.8 Cross Sections, Gradient, General Workmanship

Section 1400 CEMENT CONCRETE CAUSEWAY 1400-1 to 1400-2

A Materials

- 1400.1 Tests on Bricks

1400.2	Tests on Stones	
1400.3	Tests on Ingredients of Cement Concrete	
1400.4	Pavement Materials GSB,WBM,CC	
B	Construction & Workmanship	
1400.5	Workability of Concrete	
1400.6	Curing of Concrete	
1400.7	Strength of Concrete	
1400.8	Formwork	
1400.9	Cement Concrete Pavements	
1400.10	Pipes	
1400.11	Bearings and Expansion Joints	
1400.12	Measurement of Dimensions, Levels and Joint Thickness	
Section 1500	CEMENT CONCRETE PAVEMENTS	1500-1 to 1500-12
1501	Plain Cement Concrete Pavements	
A	Materials	
	Tests on Cement	
1501.1(a)	Consistency of Cement	
1501.1(b)	Compressive Strength of Cement	
1501.1(c)	Setting time of Cement	
1501.1(d)	Fineness of Cement	
1501.1(e)	Soundness of Cement	
	Fine Aggregates	
1501.2(a)	Gradation of Fine Aggregates	
1501.2(b)	Deleterious Constituents	
1501.2(c)	Alkali Aggregate Reactivity	
	Coarse Aggregates	
1501.3(a)	Gradation Analysis	
1501.3(b)	Flakiness Index of Coarse Aggregates	
1501.3(c)	Deleterious Materials and Organic Impurities	

1501.3(d)	Water Absorption / Water Content
1501.3(e)	Aggregate Impact Value
1501.3(f)	Soundness
1501.3(g)	Alkali Aggregate Reactivity
	Water
1501.4	Suitability of Water for Construction
	Other Materials
1501.5	Admixtures
1501.6	Dowel Bars
1501.7	Premoulded Joint Filler
1501.8	Joint Sealing Compound
1501.9	Tools, Plants and Equipment
1501.10	Mix Design for Cement Mortar
1501.11	Granular Sub Base
1501.12	Trial Length
B	Construction & Workmanship
1501.13	Subgrade and Subbase
1501.14	Gradation and Moisture Content of Aggregates
1501.15	Concrete Workability
1501.16	Compressive Strength of Concrete
1501.17	Straightness of Side Forms
1501.18	Size, Spacing, Paralleling of Dowel Bars and Location of Different Joints
1501.19	Batching and Mixing of Materials
1501.20	Hot/Cold Weather Concreting and Compaction
1501.21	Compaction Equipment (Needle, Screed and Plate Vibrators)
1501.22	Separation Membrane
1501.23	Surface Levels
1501.24	Surface Regularity
1501.25	Width of Pavement
1501.26	Pavement Thickness

1501.27	Alignment of Joints
1501.28	Depth of Dowel Bars
1501.29	Texturing and Edging
1502	Roller Compacted Concrete Pavements
A	Materials
1502.1(a)	Consistency of Cement
1502.1(b)	Compressive Strength of Cement
1502.1(c)	Setting time of Cement
1502.1(d)	Fineness of Cement
1502.1(e)	Soundness of Cement
	Tests on Fine Aggregates
	Fine Aggregates
1502.2(a)	Gradation of Fine Aggregates
1502.2(b)	Deleterious Constituents
1502.2(c)	Alkali Aggregate Reactivity
	Coarse Aggregates
1502.3(a)	Gradation Analysis
1502.3(b)	Flakiness Index of Coarse Aggregates
1502.3(c)	Deleterious Materials and Organic Impurities
1502.3(d)	Water Absorption / Water Content
1502.3(e)	Aggregate Impact Value
1502.3(f)	Soundness
1502.3(g)	Alkali Aggregate Reactivity
	Fly Ash
1502.4(a)	Fineness of Flyash by Blaine Apparatus
1502.4(b)	Particles Retained on 75 Micron IS Sieve
1502.4 (c)	Lime Reactivity
1502.4(d)	Soundness by Autoclave Expansion
1502.4(e)	Soundness by Le Chatelier Method

Water

1502.5 Suitability of Water for Construction

Other Materials

1502.6 Admixtures

1502.7 Dowel Bars

1502.8 Premoulded Joint Filler

1502.9 Joint Sealing Compound

1502.10 Tools, Plants and Equipment

1502.11 Mix Design for Cement Mortar

1502.12 Granular Sub Base

1502.13 Trial Length

Construction & Workmanship

1502.14 Subgrade and Subbase

1502.15 Gradation and Moisture Content of Aggregates

1502.16 Batching and Mixing

1502.17 Concrete Workability

1502.18 Compressive Strength of Concrete

1502.19 Straightness of Side Forms

1502.20 Transverse Contraction Joints (Width and Depth)

1502.21 In-situ Density of Trial Length by Sand Replacement Method

1502.22 Compaction and Surface Correction

1502.23 Surface Levels

1502.24 Surface Regularity

1502.25 Width of Pavement

1502.26 Pavement Thickness

1502.27 Cumulative Length of Cracks

1502.28 Core Density

1502.29 Performance of 30 m Trial Length

1502.30 Texturing and Edging

1503	Rectangular Concrete Block Pavements
A	Materials
	Tests on Cement
1503.1(a)	Consistency of Cement
1503.1(b)	Compressive Strength of Cement
1503.1(c)	Setting time of Cement
1503.1(d)	Fineness of Cement
1503.1(e)	Soundness of Cement
	Tests on Fine Aggregates
1503.2(a)	Gradation of Fine Aggregates
1503.2(b)	Deleterious Constituents
1503.2(c)	Alkali Aggregate Reactivity
	Coarse Aggregates
1503.3(a)	Gradation Analysis
1503.3(b)	Flakiness Index of Coarse Aggregates
1503.3(c)	Deleterious Materials and Organic Impurities
1503.3(d)	Water Absorption / Water Content
1503.3(e)	Aggregate Impact Value
1503.3(f)	Soundness
1503.3(g)	Alkali Aggregate Reactivity
	Fly Ash
1513.4(a)	Fineness of Flyash by Blaine Apparatus
1503.4(b)	Particles Retained on 75 Micron IS Sieve
1503.4 (c)	Lime Reactivity
1503.4(d)	Soundness by Autoclave Expansion
1503.4(e)	Soundness by Le Chatelier Method
	Water
1503.5	Suitability of Water for Construction
	Other Materials
1503.6	Admixtures

- 1503.7 Joint Details, Pattern of Laying and End Restraints
- 1503.8 Tools, Plants and Equipment
- 1503.9 Mix Design for Concrete
- 1503.10 Subgrade and Sub Base
- 1503.11 Method of Manufacturing and Compacting Blocks
- 1503.12 Trial Length
- 1503.13 Grading for Bedding and Joint Filling Sand

B Construction & Workmanship

- 1503.14 Subgrade and Subbase
- 1503.15 Compressive Strength of Concrete
- 1503.16 Pattern of Laying Blocks and End Restraints
- 1503.17 Earthen Shoulders (Width and Camber)
- 1503.18 Width of Joints between Blocks
- 1503.19 Horizontal Alignment
- 1503.20 Surface Levels
- 1503.21 Surface Regularity
- 1503.22 Dimensions of Blocks (Size and Thickness)
- 1503.23 Performance of Trial Length
- 1503.24 General Workmanship

1504 Interlocking Concrete Block Pavements

A Materials

Tests on Cement

- 1504.1(a) Consistency of Cement
- 1504.1(b) Compressive Strength of Cement
- 1504.1(c) Setting time of Cement
- 1504.1(d) Fineness of Cement
- 1504.1(e) Soundness of Cement

Tests on Fine Aggregates

- 1504.2(a) Gradation of Fine Aggregates
- 1504.2(b) Deleterious Constituents

1504.2(c)	Alkali Aggregate Reactivity
	Coarse Aggregates
1504.3(a)	Gradation Analysis
1504.3(b)	Flakiness Index of Coarse Aggregates
1504.3(c)	Deleterious Materials and Organic Impurities
1504.3(d)	Water Absorption / Water Content
1504.3(e)	Aggregate Impact Value
1504.3(f)	Soundness
1504.3(g)	Alkali Aggregate Reactivity
	Fly Ash
1504.4(a)	Fineness of Flyash by Blaine Apparatus
1504.4(b)	Particles Retained on 75 Micron IS Sieve
1504.4 (c)	Lime Reactivity
1504.4(d)	Soundness by Autoclave Expansion
1504.4(e)	Soundness by Le Chatelier Method
	Water
1504.5	Suitability of Water for Construction
	Other Materials
1504.6	Admixtures
1504.7	Joint Details, Patter of Laying and End Restraints
1504.8	Tools, Plants and Equipment
1504.9	Mix Design for Concrete
1504.10	Base Course
1504.11	Method of Manufacturing and Compacting Blocks
1504.12	Trial Length of 30 m before Commencing Work
1504.13	Block Size and Thickness
1504.14	Water Absorption , Compressive Strength of Blocks
	B Construction & Workmanship
1503.15	Subgrade and Subbase
1504.16	Dimensions and Tolerances of Paving Blocks

1503.17	Compressive Strength of Concrete Blocks	
1503.18	Paving Pattern of Blocks and End Restraints	
1504.19	Horizontal Alignment	
1504.20	Surface Levels	
1504.21	Surface Regularity	
1504.22	Performance of 30 m Trial Length	
1504.23	General Workmanship	
Section 1600	Hill Road Construction	1600-1 to 1600-3
A	Materials	
	Tests on Stone	
1600.1	Compressive Strength of Stone	
1600.2	Water Absorption of Stones	
	Tests on Cement	
1600.3	Compressive Strength of Cement	
1600.4	Fineness of Cement	
1600.5	Setting time of Cement	
	Tests on Sand	
1600.6	Grain Size Analysis of Sand / Stone / Marble dust	
	Tests on Coarse Aggregate	
1600.7	Flakiness Index of Coarse Aggregates	
1600.8	Deleterious Content and Organic Material	
1600.9	Specific Gravity, Density, Voids and Absorption	
1600.10	Crushing Strength	
1600.11	Aggregate Impact Value	
1600.12	Soundness	
1600.13	Aggregate Alkali Reactivity	
	Tests on Water for Construction	
1600.14	Suitability of Water for Construction	
	Tests on Steel	
1600.15	Characteristic Strength of Steel	

- 1600.16 Modulus of Steel
- 1600.17 Ultimate Tensile Strength and Elongation

B Construction & Workmanship

- 1600.18 Degree of Compaction
- 1600.19 Workability of Concrete by Slump Test
- 1600.20 Compressive Strength of Concrete
- 1600.21 Flexural Strength of Concrete
- Surface Level**
- 1600.22 Horizontal Alignment
- 1600.23 Surface Levels
- 1600.24 Surface Regularity
- 1600.25 Earthworks
- 1600.26 Granular Sub base and Base and Bituminous Work
- 1600.27 Cement Concrete Pavements, Blocks etc.
- 1600.28 Cross Drainage Works

Section 1700 Traffic Signs and Markings 1700-1 to 1700-2

A Materials

- 1700.1 Colour, Configuration, Size, Location, Dimensions
- 1700.2 Concrete
- 1700.3 Reinforcing Steel
- 1700.4 Bolts,Nuts and Washers
- 1700.5 MS Sheets, Plates and Supports
- 1700.6 Reflectorised Paint
- 1700.7 Non Reflectorised Paint
- 1700.8 Paints for Road Markings

Section 1900 Maintenance 1900-1 to 1900-4

Maintenance of Earthworks and Drains

A Materials

- 1900.1 Soils
- 1900.2 Stones

1900.3	Bricks, Cement, Mortar
B	Construction & Workmanship
1900.4	Horizontal Alignment
1900.5	Surface Levels
1900.6	Surface Regularity
	Maintenance of Bituminous Roads
A	Materials
1904.1	Bituminous Materials
1904.2	Granular Materials / Aggregates
B	Construction & Workmanship
1904.3	Horizontal Alignment
1904.4	Surface Levels
1904.5	Surface Regularity
	Maintenance of Gravel Roads
A	Materials
1905.1	Gravels / Soil Aggregates
B	Construction & Workmanship
1905.2	Horizontal Alignment
1905.3	Surface Levels
1905.4	Surface Regularity
	Maintenance of WBM Roads
A	Materials
1906.1	WBM
B	Construction & Workmanship
1906.2	Horizontal Alignment
1906.3	Surface Levels
1906.4	Surface Regularity
	Maintenance of Culvers and Bridges
A	Materials
1908.1	Materials for Culverts and Bridges

B Construction & Workmanship

1908.2 Horizontal Alignment

1908.3 Surface Levels

1908.4 Surface Regularity

Maintenance of Causeway

A Materials

1909.1 Materials for Causeway

B Construction & Workmanship

1909.2 Horizontal Alignment

1909.3 Surface Levels

1909.4 Surface Regularity

Maintenance of Road Signs

A Materials

1910.1 Materials for Road Signs

Maintenance of Markings and Appurtenances

A Materials

1911.1 Materials for Markings and Appurtenances

APPENDICES

Appendix-1	List of Indian Standards	1 to 14
Appendix-2	List of Tests	1 to 5
Appendix- 3	List of Forms	1 to 2
Appendix -4	List of Photographs	3 to 4
Appendix - 5	List of Tables	5 to 6
Appendix – 6	List of Figures	7
Appendix -7	Measurement Conversion Factors	(i) to (ii)

ABBREVIATIONS

AE	:	Assistant Engineer
AIV	:	Aggregate Impact Value
BOQ	:	Bill of Quantities
CBR	:	California Bearing Ratio
CD	:	Cross-Drainage
CRMB	:	Crumb Rubber Modified Bitumen
cum	:	Cubic metre
EE	:	Executive Engineer
g	:	Gram
GBFS	:	Granulated Blast Furnace Slag
GSB	:	Granular Sub-Base
GTS	:	Grand Triangulation Survey
h	:	Hour
IS	:	Indian Standard
JE	:	Junior Engineer
kg	:	Kilogram
km	:	Kilometre
kN	:	Kilo Newton
λ	:	Litre
m	:	Metre
MB	:	Modified Binder
min	:	minutes
ml	:	Millilitre

mm : Millimetre
MORD : Ministry of Rural Development
MORTH : Ministry of Road Transport & Highways
MOSRTH : Ministry of Shipping, Road Transport & Highways
MPa : Mega Pascal
MPM : Modified Penetration Macadam
MS : Medium Setting
NRRDA : National Rural Roads Development Agency
NQM : National Quality Monitor
OMC : Optimum Moisture Content
PMB : Polymer Modified Bitumen
RMB : Rubber Modified Bitumen
RS : Rapid Setting
secc : seconds
SQC : State Quality Coordinator
SQM : State Quality Monitor
sqm : Square metre
SS : Slow Setting
UCS : Unconfined Compressive Strength
WBM : Water Bound Macadam
WMM : Wet Mix Macadam

FOREWORD

Focus on quality has been a singular feature of the Pradhan Mantri Gram Sadak Yojana (PMGSY) right from its inception. In fact, the report of the National Rural Roads Development Committee, which formed the conceptual basis of this programme, specifically highlighted the need for inbuilt quality assurance mechanisms, as a first step towards institutionalizing quality assurance system in the programme implementation, a quality control handbook for rural roads was brought out in 2002 by the National Rural Roads Development Agency (NRRDA) covering various tests to be conducted, frequency of these tests and details of the test procedures. However, at that time separate specifications were not available for the low volume rural roads. In 2004 the Ministry of Rural Development brought out Specifications For Rural Roads, which was published by the Indian Roads Congress (IRC). Following this technical experts as well as the programme managers felt that there was a consequential need to revise the Quality Control Handbook. Accordingly, the work of revising the handbook was entrusted to the IRC which constituted a group of experts headed by Shri S. C. Sharma, former Director General (Road Development) and Additional Secretary, Ministry of Road Transport and Highways. The other members of this expert group were Shri D. P. Gupta, Dr. V. M. Sharma, Dr N. B. Lal, Shri M. V. B. Rao, Shri G. S. Khinda and Shri S. P. Singh.

This revised version of the quality Assurance Handbook for rural roads does not restrict itself to quality control only. It has widened the scope by adopting the principles of quality assurance as laid down by the IRC. Volume-I of this handbook deals with the quality management system and quality control requirements and Volume-II covers the equipments and test procedures. Quality monitoring of the projects through independent, third party monitors at the State level as well as at the Central level has also been dealt with in Volume-I. Unlike the earlier practice of seeking quality control only during construction, this handbook recommends exercising quality control at three stages – at the stage prior to construction, during the construction phase and quality checks by the field engineers after completion of each stage of construction, which is termed as “stage passing”. A number of carefully thought out “Do’s and Don’ts” for each activity and item of work have also been prescribed for the guidance of users.

In its present form, this handbook incorporates valuable suggestions and recommendations which were received during a workshop which was specifically organized to review the draft on April 16-17, 2007 at Central Road Research Institute, New Delhi. I would like to express my sincere appreciation to the IRC, the members of the expert group for their painstaking efforts, to all the members of the peer review group for their meticulous and methodical scrutiny, and to all the participants of the national workshop which was held in April 2007 for their valuable contributions. I do believe that in the implementation of PMGSY in substantial measure.



(J. K. Mohapatra)

Joint Secretary (RC)

Ministry of Rural Development &

Director General

National Rural Roads Development Agency

PREFACE

A good road network has an important bearing on the economic growth of the country. Rural Connectivity is perceived as one of the major component in increasing the agricultural output and earning capacity of the rural population. There is a marked improvement in quality of life by way of better educational facilities, improved health services, improved attendance by the school teachers as well as students. Accessibility also provides improvement in governance and provision of other facilities like post offices, access to police in case of emergencies and other communication system like telephones. As a measure of poverty reduction, Government of India has launched Pradhan Mantri Gram Sadak Yojana (PMGSY) in December, 2000. The management systems developed for implementation of the programme are centered on quality and the guidelines clearly prescribe to provide good all-weather connectivity to target habitations.

Construction of quality roads requires concerted efforts on many fronts, therefore, a *three tier* quality mechanism has been operationalized under the programme. The *first tier* provides for in-house quality control, wherein, the Programme Implementation Unit (PIU) is required to control the quality of work through performing mandatory tests for the material and workmanship. The *second and third tier* of quality mechanism provides for monitoring of quality by the independent quality monitors at the State Level and at the National Level. The PMGSY Guidelines provides that the NRRDA will issue general guidelines on quality control and prescribe a Quality Control Hand Book to regulate the quality control process at works level. Accordingly, a Quality Control Hand Book was brought out in 2002.

Based on feedback received from States, executing agencies and other organizations, it was felt that handbook may also contain details about the tests involved in construction of cross drainage works, rigid and semi-rigid pavements and protection works etc. The Rural Roads Specifications provide for mandatory testing of material and workmanship and feedback of the field formations regarding the frequency of tests indicated that there is a scope to revisit these frequencies. Therefore, National Rural Roads Development Agency decided to review the Quality Control Hand Book and the work of review was entrusted to Indian Roads Congress (IRC).

The IRC was requested to review the content of Quality Control Hand Book with a view to include details about all the tests required for construction of roads and related cross drainage works etc. It was also requested that the IRC may review the prescription of frequency of tests and examine whether the concept of stage passing may be introduced to ensure clear accountability. The IRC constituted Expert Group headed by Shri S. C. Sharma, Former Director General, Ministry of Road Transport and Highways. The Expert Group prepared the contents of the Handbook and based on the level of work and its utility, the title of the handbook was decided as 'Quality Assurance Hand Book for Rural Roads'. The drafts of Quality Assurance Hand Book were reviewed in a series of meetings and deliberations by a Peer Review Committee, constituted by NRRDA as below:

Prof. C. E. G. Justo, Emeritus Fellow, Bangalore University – Chairman
Shri Prabha Kant Katare, Director (Projects-III), NRRDA – Convener

MEMBERS

Dr. Ashok Kumar, Rural Roads Specialist, World Bank
Dr. Praveen Kumar, Indian Institute of Technology, Roorkee

Shri H. L. Meena, Chief Engineer PWD, Rajasthan
Engineer-in-Chief, PWD (R&B), Nagaland
Shri V. V. Gulati, Former Chief Engineer P.W.D, Uttarakhand.
Shri Vidya Sagar Singh, Former Chief Engineer, U.P.P.W.D.
Shri H. K. Srivastava, Director (Projects-I), NRRDA
Dr. B. P. Chandrasekhar, Director (Technical), NRRDA
Shri S. Baliga, Director (Projects-II), NRRDA
State Quality Coordinator (PMGSY), MPRRDA, Madhya Pradesh
State Quality Coordinator (PMGSY), HPPWD, Himachal Pradesh

The suggestions of members of Peer Review Committee and officers of NRRDA on the draft Hand Book were incorporated and final draft document was prepared. A National Workshop on Quality Assurance Hand Book was organized on 16-17th April, 2007 at CRRI to review of the contents of Draft Handbook. Dr. Subas Pani, Secretary, Ministry of Rural Development inaugurated the Workshop and in addition to his valuable guidance about internalizing the quality consciousness, he mentioned that enormous efforts have been made in preparation of the Hand Book and it should be used extensively by the field officers engaged in implementation of PMGSY. It was suggested by him that the Quality Assurance Hand Book should be made available on the Programme Website, so that the officers, contractors and other construction agencies can have easy access to the provisions of quality assurance. The workshop was attended by representatives of almost all the States and experts. A number of valuable suggestions and comments made at the Workshop were suitably incorporated in the present form of Quality Assurance Hand Book.

Volume I of the Handbook covers quality management system and details about quality control requirements. The revised frequency of tests and requirements about stage passing in form of quality control checks have been elaborated in this Volume. Volume II gives detailed description about equipment and test procedures.

I would like to express my sincere gratitude to members of Expert Group, members of Peer Review Committee and Shri R. S. Sharma, Former Secretary, IRC whose pains taking efforts have brought out this wonderful document. I would also like to express my sincere appreciation to the efforts made by Shri V. K. Sinha, Secretary General IRC, officers and other staff of IRC in bringing out this handbook in the present form. I thankfully acknowledge the contribution made by the participants of the workshop organized at CRRI in April, 2007.

The document of this nature cannot remain static with continuous upgradation of technology. User of this handbook would be the best judge of the deficiencies, if any still left in the document. We would greatly value the feedback and suggestions in this regard to keep this document updated. I am confident that this document would serve its intended purpose.



(Prabha Kant Katare)

New Delhi
May, 2007

Director (Projects) & Chief Quality Coordinator
National Rural Roads Development Agency

INTRODUCTION

1. BACKGROUND

- 1.1 A major rural road programme known as Pradhan Mantri Gram Sadak Yojana (PMGSY) is being implemented since December 2000 by the Government of India through the Ministry of Rural Development (MORD). The National Rural Roads Development Agency (NRRDA), working under the aegis of the MORD, provides the overall administrative, technical and programme support to the states in the execution of works. The scheme envisages construction of good quality all-weather roads to provide connectivity to habitations with a population of 500 and above (250 and above in case of hills, deserts and tribal areas). Emphasis is being laid on planning, design, construction and maintenance of rural roads based on sound engineering principles, which conform to specifications, codes of practice and manuals of the Indian Roads Congress. A comprehensive document, IRC:SP:20 entitled Rural Roads Manual has been brought out in 2002 for adoption in case of all rural roads including works being carried out under the PMGSY programme. Subsequently, the NRRDA brought out its own Handbook on Quality Control for Rural Works and Operations Manual for PMGSY works. A detailed Book of Specifications for Rural Roads and Standard Data Book for Analysis of Rates have also been prepared and published through the Indian Roads Congress. A strong technical underpinning has been given so that roads taken up under this programme conform to the MORD Specifications.
- 1.2 The Government of India have recently reviewed the progress of the PMGSY and other schemes relating to rural development and have decided to undertake a bold initiative of building infrastructure in rural areas under an umbrella programme, known as 'Bharat Nirman'. The PMGSY is one of the six components of the Bharat Nirman and the following targets have been set:
 - (i) Provide all-weather connectivity to habitations of population above 1000 (500 in case of hills, deserts and tribal areas).
 - (ii) The task would involve connectivity to 66,802 habitations.
 - (iii) The work involves construction of over 140,000 km of new roads and upgradation of over 190,000 km of existing rural roads at an estimated cost of Rs 48,000 crore.

2. QUALITY ASSURANCE

- 2.1 A three-tier quality management mechanism has been operationalized under PMGSY for ensuring that the quality of assets created conform to the prescribed standards. The first tier of quality management mechanism is in-house quality control at the level of the executing agencies whereas the second tier provides for quality monitoring through independent State Quality Monitors (SQM). Monitoring by independent National Quality Monitors (NQM) constitutes the third tier of this arrangement. Under this arrangement, it is the responsibility of the State Government to

operationalize the first and the second tiers of the quality management structure.

It is proposed to widen the scope of quality control by including the principles of Quality Assurance laid down by the Indian Roads Congress in their guidelines on quality systems for roads (IRC:SP:57-2000) and for bridges (IRC:SP:47-1998). A Total Quality Management approach is envisaged. The concept of Total Quality Management (TQM) as defined by ISO reads as “TQM is a management approach of an Organisation, centered on Quality, based on participation of all its members and aiming at long-term success through customer satisfaction, and benefits to all the members of the Organisation and the Society”. In fact the TQM is a management strategy aimed at embedding awareness of Quality in all organisational processes. The TQM concept in the context of Rural Roads suggests that quality has to be seen as the basic policy starting from conception till the operation and management of Rural Road assets. The objective of the PMGSY is to provide “Good All Weather Roads” and the implementation strategies of the programme are therefore, centered on the word ‘Quality’.

2.2 Class of Quality Assurance (QA) for Rural Roads: Four classes of Quality Assurance are prescribed as under:

Quality Assurance	Class
1. Nominal QA	Q1
2. Normal QA	Q2
3. High QA	Q3
4. Extra High QA	Q4

For rural roads, Class Q 2 may be adopted. However, for a particular project or even for particular activities, decision regarding upgradation of QA class could be taken by the Project Implementation Unit keeping in view the level of quality and the level of control expected beyond Class Q 2. The quality assurance requirements in respect of materials and workmanship to be achieved during execution are described against each item of road and bridge work in relevant Sections.

2.3 For day-to-day reference of the Engineers in the field and the Contractors engaged in construction of rural roads, this Handbook on Quality Assurance has been prepared drawing heavily on the following sources:

- (i) Specifications for Rural Roads, MORD (2004).
- (ii) Rural Roads Manual IRC:SP:20-2002.
- (iii) Handbook on Quality Control: Road Works NRRDA (2002).
- (iv) Hill Road Manual: IRC:SP:48-1998.

The frequency of tests has been further rationalized and NRRDA will bring out the necessary modifications in MORD Specifications for Rural Roads. The quality control requirements prescribed in the Book will be mandatory for all PMGSY works. This book would also serve as a useful reference to the State Technical Agencies, State-level Quality Control Units, and National Quality Monitors.

3. COVERAGE OF THE HANDBOOK- VOLUME II

Quality Assurance Handbook for Rural Roads has been prepared in two volumes:

Volume I: Quality Management System and Quality Control Requirements

Volume II: Equipment and Test Procedures

The Volume I covers quality management systems and describes in detail procedure for quality control of works, quality requirements for materials and workmanship, and various tests to be performed and their frequencies.

The Volume II covers the test procedures to be followed for conducting various tests, laboratory set up and equipment required for field laboratory and the laboratories at the District and the Central level. It describes in detail all the tests specified in MORD Specifications for various materials and workmanship. In addition, some non-destructive tests for concrete and other materials have also been included. The test procedures are in accordance with the methods given in the relevant IS Standards. The purpose and significance of the test has also been given for each test. For ease of reference, the numbers given to various Sections and Sub sections in Volume-II are same as given in the Volume I, which in turn, corresponds to the Sections of the MORD Specifications for Rural Roads.

All the test procedures given in the Volume II have been divided into two major categories:

(A) Materials

(B) Construction and Workmanship

There are some tests which are required to be performed on a particular material/ workmanship which get repeated. For example, the tests on cement get repeated in the list of tests required for cement concrete. To avoid repetition, whenever a test procedure has been described once, it has only been referred to, at its relevant place in a tabular form. A complete list of tests required under a particular Section or Sub-section have been given at its appropriate place and also in the Contents.

A list of Indian Standards which are referred to in the Handbook is given in Appendix 1. In case of any doubt or confusion, the users may refer to the Indian Standards.

In order to facilitate the reference to particular tests, an alphabetical list of all the tests has been prepared and given under Index in Appendix 2.

Most of the test procedures have included a form in which the data is to be recorded. A consolidated list of all such forms is given in Appendix 3.

—◆—

SECTION 100

GENERAL

—◆—

Preamble

For ensuring the requisite quality of construction, the materials and workmanship shall be subjected to quality control tests. These tests have been specified in respective Sections in Vol.I of this Handbook.

The frequency of tests required to be performed on different materials and the finished products shall be as specified in respective Sections in Volume I. The testing frequencies set forth are the desirable ones and the Engineer shall have the full authority to carry out additional tests as frequently as he may deem necessary, to satisfy himself that the materials and the workmanship comply with the appropriate specifications.

Setting up and maintaining an adequately equipped Field Laboratory as required for quality control of materials and workmanship shall be the responsibility of the Contractor. The Field Laboratory should have the needed equipment, trained man-power and essential documentation regarding sampling and test procedures.

Routine tests for Quality Control which are required to be conducted on a day to day basis shall be conducted by the Field Laboratory Staff. The Field Laboratory should preferably be located adjacent to the office of the Site Engineer and provided with amenities like water supply, electric supply, and proper access. The requirements of water supply and electricity supply will depend on the availability of these facilities in the vicinity of the project site. The Field Laboratory will have only those test equipment which are relevant to the project specifications.

The tests which are required to be done during the project preparation stage such as those pertaining to the suitability of construction materials, selection of quarries etc. or the tests which are required only once in a while for quality control shall be conducted in the District Laboratory. The District Laboratory will cover the testing requirements on a district level.

Tests requiring high level of skills and sophisticated equipment as also for the other quality checks will be carried out at the Central Laboratory under the control of the Chief Engineer, State Rural Road Development Agency. The Central Laboratory will, thus, act as the Control Testing Laboratory at the State level.

Any special or sophisticated tests for which the necessary equipment and expertise are not available in the Central Laboratory shall be outsourced.

119 Equipment for Field Laboratory

The field laboratory should be equipped with essential equipment required for day to day tests for exercising quality control during construction. Further, only those test equipment which are relevant to the project specifications will be necessary. Where the Contractor is required to carry out the maintenance of road and structures, the field laboratory should have necessary equipment during maintenance period for exercising quality over maintenance activities.

119.1 List of Essential Equipment - For Earthwork, Granular Construction and other General Requirements

- | | | |
|-----|--|---------|
| (a) | Post Hole Auger with extensions | One set |
| (b) | Digging tools like pick axes, shovels etc. | One set |

(c)	IS Sieves with lid and pan (125 mm, 100 mm, 90 mm, 80 mm, 75 mm, 63 mm, 53 mm, 50 mm, 45 mm, 40 mm, 31.5 mm, 26.5 mm, 25 mm, 22.4 mm, 20 mm, 19 mm, 16 mm, 13.2 mm, 12.5 mm, 11.2 mm, 10 mm, 9.5 mm, 6.3 mm, 5.6 mm, 4.75 mm, 3.35 mm, 2.36 mm, 2 mm, 1.18 mm, 600 micron, 425 micron, 300 micron, 180 micron, 150 micron, 90 micron and 75 micron)	One set
(d)	Standard Proctor Density Test Apparatus with Rammer	One set
(e)	Sand Pouring Cylinder with tray complete for field density test	One set
(f)	Core Cutter (10 cm dia), 10 cm/15 cm height complete with dolly and hammer	One set
(g)	Speedy moisture meter complete with chemicals	One set
(h)	Straight Edges	Two nos.
(i)	Liquid Limit and Plastic Limit testing apparatus	One set
(j)	Gas Burner, sand bath	One set
(k)	Camber Board	Two nos.
(l)	Electronic/digital balance 1 kg with the least count of 0.01 g	One no.
(m)	Electronic /digital balance 5 kg	One no.
(n)	Pan balance with weight box, 5 kg	One no.
(o)	Oven (200°C), thermostatically controlled	One no.
(p)	Enamelled tray	Six nos.
(q)	Measuring tape, spatula, spirit levels, glassware, porcelain dish, pestle mortar	One set
(r)	Aggregate Impact Test Apparatus	One set
(s)	Flakiness Gauge	Six nos.
(t)	Essential survey equipment for checking surface levels	One set
(u)	Lab CBR equipment	One set
(v)	Uppal's Syringe for Plasticity Index	One set
(w)	Pocket Penetrometer	One set

For other tests like Soundness of Aggregate, Deleterious Material, Sulphate Content etc. facilities at the District Laboratory will be used.

119.2 Additional Equipment for Bituminous Construction

(a)	Digital Thermometers	Three nos.
(b)	Water bath (ambient to 100°C)	One no.

- | | | |
|-----|---|------------|
| (c) | Penetration apparatus (Bitumen) | One set |
| (d) | Trays for measurement of tack coat quantity | Three nos. |
| (e) | Bitumen extraction apparatus | One no. |

For other tests like R&B Softening Point, Viscosity, Storage Stability, Ductility, Elastic Recovery and Separation Difference, facilities at the District Laboratory will be used.

119.3 Additional Equipment for Cement Concrete Works and Structures

- | | | |
|-----|----------------------|-------------|
| (a) | Slump Cone | Two nos. |
| (b) | Cube Moulds | Twelve nos. |
| (c) | Core Cutting Machine | One no. |

For other tests like physical and chemical tests on Cement, Alkali Aggregate Reactivity Test, Chemical Tests for Water, Compressive and Flexural Strength of Concrete etc., facilities at the District /Central Laboratory will be used.

- | | | |
|--------------|----------------------|---------|
| 119.1 | First Aid Box | One set |
|--------------|----------------------|---------|

120 Equipment for District Laboratory

120.1 General Equipment

120.1.1 Equipment for Sampling

- | | | |
|-----|---|--|
| (a) | Digging tools pick axes, shovels, hammers, chisels etc. | Two sets |
| (b) | Post hole augers (blade type) with extension rods and accessories | Three set (75 mm, 100 mm & 150 mm dia) |
| (c) | Thin walled sampling tubes | Four sets (38 mm, 50 mm & 100 mm dia) |
| (d) | Sample extruder – hand operated 38 mm, 50 mm, 100 mm dia | One set each |

120.1.2 Sieves

Standard set of sieves, lid and pan 450 mm dia for coarse aggregates and 200 mm dia for soils and fine aggregates, sieve shaker.

Coarse Aggregates

125 mm, 106 mm, 100 mm, 90 mm, 80 mm, 75 mm, 63 mm, 53 mm, 50 mm, 45 mm, 40 mm, 37.5 mm, 31.5 mm, 26.5 mm, 25 mm, 22.4 mm, 20 mm, 19 mm, 16 mm, 13.2 mm, 12.5 mm, 11.2 mm, 10 mm, 9.5 mm, 6.3 mm, 5.6 mm, 4.75 mm, 2.80 mm, 2.36 size with lid and cover

Fine Aggregates and Soils

10 mm, 5.6 mm, 4.75 mm, 2.80 mm, 2.36 mm, 2.00 mm, 1.70 mm, 1.18 mm, 1 mm, 850 micron, 710, 600, 500, 425, 355, 300, 250, 212, 180, 150, 90 and 75 micron with pan and cover One set

120.1.3 Balances

- (a) Electronic/digital balance (1 kg) with the least count of .01 g One no.
(b) Electronic/digital balance (5 kg) One no.

120.1.4 Proving rings

10 kg, 50 kg, 100 kg capacity One each

120.1.5 Dial gauges

25 mm, 50 mm travel, (sensitivity 0.01 mm/division) Six nos.

120.1.6 Water bath

Electrically operated and thermostatically controlled Gas burner and sand bath One no.

120.1.7 Thermometers

Digital thermometers Three nos.

120.1.8 Glassware

Flasks, graduated cylinders, stirring apparatus, spatulas, wire gauges, scoops, steel scales, measuring tapes, casseroles, assorted sizes of enameled trays, porcelain dish, filter paper, desiccator, funnel, measuring tape, glass marking pencils, heat resistant hand gloves, spirit levels, vernier calipers, mortar with rubber-covered pestle etc. One set

120.1.9 Oven

Electricity operated and thermostatically controlled up to 200°C (sensitivity 1°C) with interior of non-corroding material One no.

120.1.10 Reagents

Hydrochloric acid, sodium hexametaphosphate, hydrogen peroxide, calcium carbide One no.

120.1.11 First Aid Box

One set

120.2 Equipment for Testing of Soils

- (a) Water still (capacity 4 litres per hour) One no.
(b) Rapid Moisture Meter complete with Chemicals One no.

(c)	Liquid Limit and Plastic Limit Testing Apparatus	One no.
(d)	Sampling Pipette 10ml	One no.
(e)	Standard Proctor Density Test Apparatus with Rammer (Light compaction)	One set
(f)	Standard Proctor Density Test Apparatus with Rammer(Heavy compaction)	One set
(g)	Sand Pouring Cylinder with Tray complete for field density test.	Four nos.
(h)	Sampling tins with lids 100 mm dia, 50 mm height	Twenty nos.
(i)	Lab CBR equipment (complete set) with 12 moulds	One set
(j)	Nuclear Density Gauge	Two sets
(k)	Pocket Penetrometers	Four nos.
(l)	Uppal's Syringe for Plasticity Index	Four nos.

120.3 Equipment for Testing of Aggregates

(a)	Flakiness Gauge	One no.
(b)	Standard equipment for Aggregate Crushing Value along with standard tamping rod	One set
(c)	Specific gravity determination test apparatus with pycnometre / specific gravity bottles, vacuum pump	One set
(d)	Aggregate soundness test apparatus	One set
(e)	Water absorption test apparatus	One set
(f)	Aggregate Impact Value test apparatus	One set
(g)	Stripping test apparatus	One set

120.4 Equipment for Testing of Concrete

(a)	Slump cone	Two Nos.
(b)	Cube moulds (150 mm x 150 mm x 150 mm)	Twelve Nos.
(c)	Compression Testing machine (200 Tonnes Capacity)	One No.

120.5 Equipment for Testing of Bitumen

(a)	Penetration test apparatus with standard needles	One set
(b)	R & B Softening Point Test Apparatus	One set
(c)	Ductility Test Apparatus	One set
(d)	Cleveland Open Cup Test	One set
(e)	Saybolt Furol Viscometrer Test Apparatus	One set

- (f) Residue on 600 Micron Sieve Test Apparatus One set
- (g) Storage Stability Test for Bituminous Emulsion One set
- (h) Elastic Recovery Test Apparatus One set
- (i) Separation Difference Test Apparatus One set

120.6 Equipment for Testing Bituminous Mixes

- (a) Mechanical mixer of 0.02 m³ capacity, electrically operated and fitted with heating jacket One no.
- (b) Electrically operated centrifuge type bitumen extractor and commercial benzene One no.

120.7 Equipment for Testing Workmanship

- (a) Camber Board / Template with 3m straight edge One No.
- (b) Thickness gauge One No.

121 Equipment for Central Laboratory

121.1 General Equipment

- 121.1.1** Equipment for Sampling items (i) to (iv) as in the equipment at District level, (v) Portable small size drilling machine (diesel operated) One No.

121.1.2 Sieves & Sieve Shaker

Standard set of sieves, lid and pan 450 mm dia for coarse aggregates and 200 mm dia for soils and fine aggregates, Sieve Shakers.

Coarse Aggregates

125 mm, 106 mm, 100 mm, 90 mm, 80 mm, 75 mm, 63 mm, 53 mm, 50 mm, 45 mm, 40 mm, 37.5 mm, 31.5 mm, 26.5 mm, 25 mm, 22.4 mm, 20 mm, 19 mm, 16 mm, 13.2 mm, 12.5 mm, 11.2 mm, 10 mm, 9.5 mm, 6.3 mm, 5.6 mm, 4.75 mm, 2.80 mm size & pan and cover One set

Fine Aggregates and Soils

5.6 mm, 4.75 mm, 2.36 mm, 2.00 mm, 1.70 mm, 1.18 mm, 1 mm, 850 micron, 710, 600, 500, 425, 355, 300, 180, 150, 90, 75 micron & pan and cover One set

121.1.3 Oven

Electricity operated and thermostatically controlled upto 200°C and 300°C (sensitivity 1°C) One set

121.1.4 Balances (with weights where necessary)

- (a) Platform type 300 kg capacity One no.
- (b) Beam type balance 20 kg capacity (1g accuracy) One no.

(c)	Chemical balance 100 g capacity (0.001 g accuracy)	One no.
(d)	Physical balance 250 g capacity (0.01 g accuracy)	Two nos.
(e)	Pan balance 5 kg capacity (1 g accuracy)	One no.
(f)	Self indicating type balance 7 kg capacity (1 g accuracy)	One no.
(g)	Electronic balance (digital) of 1 kg capacity (0.01 g accuracy)	One no.
(h)	Electronic/digital balance 5 kg capacity	One no.

121.1.5 Proving rings

(a)	100 kg, 200 kg, 500 kg capacity	Two each
(b)	1000 kg, 2000 kg, 5000 kg capacity	One each

121.1.6 Dial gauges

25 mm, 50 mm travel (sensitivity 0.01 mm/division)	Six nos.
--	----------

121.1.7 Hot Plate

Electrically operated and kerosene or gas stoves	One each
--	----------

121.1.8 Water bath

Electrically operated and thermostatically controlled	Two sets
---	----------

121.1.9 Thermometers

a) Metallic type (Mercury in steel) with 30 cm stem and 3 m stem for near and distant reading	Six nos.
b) Glass type (Mercury-in-glass) ranges of 110°C, 250°C, 400°C	Six nos.

121.1.10 Glassware

Beakers, pipettes, flasks, graduated cylinders, spatulas, funnel, glass rod, wire gauges, scoops, steel scales, measuring tapes, casseroles, assorted sizes of enameled trays, filter paper, glass marking pencils, spirit levels, heat resistant hand gloves, vernier calipers, stop watch, etc.	One set
---	---------

121.1.11 First Aid Box

One no.

121.2 Equipment for Testing of Soils

(a)	Water still (capacity 4 litres per hour)	One no.
(b)	Rapid Moisture Meters, complete with chemicals	One no.
(c)	Liquid Limit device with standard grooving tools	One set
(d)	Plastic Limit device with rod comparator and glass plate	One no.

(e)	Post hole auger (100 mm dia) with extensions for sampling	Four nos.
(f)	Sampling pipette 10 ml	One no.
(g)	Compaction test apparatus for heavy and light compaction	One set
(h)	Sand replacement equipment	Four nos.
(i)	Sampling tins with lids 100 mm dia, 50 mm height	Hundred nos.
(j)	Lab CBR equipment (complete set with 2 dozen CBR Moulds)	One set
(k)	Core cutter	Six nos.
(l)	Proctor Needle	Six nos.
(m)	Uppal's Syringe for Plasticity Index	Six nos.
(n)	Pocket Penetrometer	Six nos.
(o)	Nuclear Density Gauge	Six nos.

121.3 Equipment for Testing of Cement and Aggregates

(a)	Riffle Divider for sampling of coarse and fine aggregates	One no.
(b)	Flakiness Gauge	One no.
(c)	Standard moulds of 30, 15 and 3 litres capacity along with standard tamping rod	One set
(d)	Specific gravity determination test apparatus with pycnometer/ specific gravity bottles vacuum pump	One set
(e)	Aggregate soundness test apparatus	One set
(f)	Water absorption test apparatus	One set
(g)	Aggregate Impact Value test apparatus	One set
(h)	Stripping test apparatus	One no.
(i)	Equipment for testing Fineness, Setting time & Strength of cement	One set

121.4 Equipment for Testing of Concrete

(a)	Slump cone	Two nos.
(b)	Cube moulds	Twelve nos.
(c)	Compression Testing Equipment 2000 kN Capacity	One no.
(d)	Ultrasonic Pulse Velocity Measuring Device	One set
(e)	Rebound hammer	One set
(f)	Water Bath for Accelerated Curing test.	One set

(g) Flexural Strength Test with Compression Testing Machine One set

121.5 Equipment for Testing Straight Run and Liquid Bitumens

a) Penetration test apparatus with standard needles One set

b) Ring & Ball softening point test apparatus with ring, ball, thermometer etc. One set

c) Ductility test apparatus One set

d) Flash points: Cleveland open cup test apparatus One set

e) Saybolt Furol Viscometer One set

121.6 Equipment for Testing of Bituminous Mixes

121.6.1 Mechanical mixer of 0.02 m³capacity, electrically operated and fitted with heating jacket One no.

121.6.2 Electrically operated centrifuge type bitumen extractor and commercial benzene One no.

121.6.3 Pavement Core Cutting Machine One no.

—◆—

SECTION 300

EARTHWORK

—◆—

301 Embankment Construction

Sec No.	Title	Test Ref No.
A) Materials		
301.1	Grain Size Analysis	301.1
301.2	Liquid Limit, Plastic Limit and Plasticity Index	301.2
301.3	Proctor Density and Relationship between Dry Density and Moisture Content	301.3
301.4	Free Swell Index Test	301.4
301.5	Deleterious Content (Organic Matter)	301.5
301.6	Deleterious Content (Soluble Sulphate)	301.6
B) Construction & Workmanship		
301.7 (a)	Water Content of Soil – Oven Drying Method (Standard Method)	301.7 (a)
301.7 (b)	Sand Bath Method	301.7 (b)
301.7 (c)	Alcohol Method	301.7 (c)
301.7 (d)	Rapid Determination of Water Content with Infra-red Lamp Torsion Balance Moisture Meter	301.7 (d)
301.7 (e)	Rapid Determination of Water Content from Gas Pressure developed by the Reaction of Calcium Carbide with the Free Water of the Soil	301.7 (e)
301.8	Measurement of In-situ Density / Degree of Compaction	301.8
301.8(a)	(a) Sand Replacement Method	301.8(a)
301.8(b)	(b) Core Cutter Method	301.8(b)
301.8(c)	(c) Nuclear Density Gauge	301.8(c)
301.9	Horizontal Alignment	301.9
301.10	Surface Levels	301.10
301.11	Surface Regularity	301.11

A Materialte

301.1. Grain Size Analysis

Purpose

Grain size analysis is carried out to determine the relative percentages of different sizes of particles in the sample. These sizes control the mechanical behaviour of coarse grained soil. Dry method of sieving is used for coarser fractions (retained on 4.75 mm sieve) and wet method is used for finer fractions (retained on 75micron sieve) and pipette method is used for fractions passing 75 micron sieve.

Procedure**A. Dry Sieve Analysis**

(For soil fraction retained on 4.75 mm sieve)

1. Prepare the sample by drying it in air or oven and bring it to room temperature.
2. Clean all the sieves to be used (100 mm, 75 mm, 19 mm, and 4.75 mm). The sieves should conform to the requirements of IS 460 (Part I) – 1985.
3. Weigh the required quantity of material from the prepared sample in accordance with Note 1 given below:

Note 1: Depending on the maximum size of material present in substantial quantities in the soil, the mass of soil sample taken for analyses may be as follows:

Table 301.1.1 Mass of Various Sized Materials to be Taken for Sieve Analysis

Maximum Size of Material Present in Substantial Quantities (mm)	Mass to be taken for test (kg)
75	60
40	25
25	13
19	6.5
12.5	3.5
10	1.5
6.5	0.75
4.75	0.4

4. Place the sieves over a clean tray one over the other in the ascending order of size.
5. Shake the sieve with a varied motion, backwards and forwards, left to right, circular clockwise and anti clockwise, and with frequent jerking, so that the material is kept moving over the sieve surfaces.
6. Do not force the material through the sieve by hand, except for sizes coarser than 19 mm.
7. Break the lumps of fine particles, if any, with fingers against the side of the sieve.
8. Light brushing with a soft brush on the under side of sieves may be done to clear surface.



9. Find the individual weight of material retained on each sieve and record.
10. The quantity taken for sieving shall be such that the wt. of material retained on each sieve does not exceed the values given in Note 2.

Note 2: Maximum weight of material to be retained on each sieve at the completion of sieving shall be as follows:

Table 301.1.2: Maximum Weight of Material to be Retained on Each Sieve

IS Sieve Designation	450 mm Dia Sieves (kg)	300 mm Dia Sieves (kg)
80 mm	15	6
20 mm	4	2
4.75 mm	1.0	0.5

11. Calculate the percentage by weight of the total sample passing each sieve and report the results in Form EW-1.

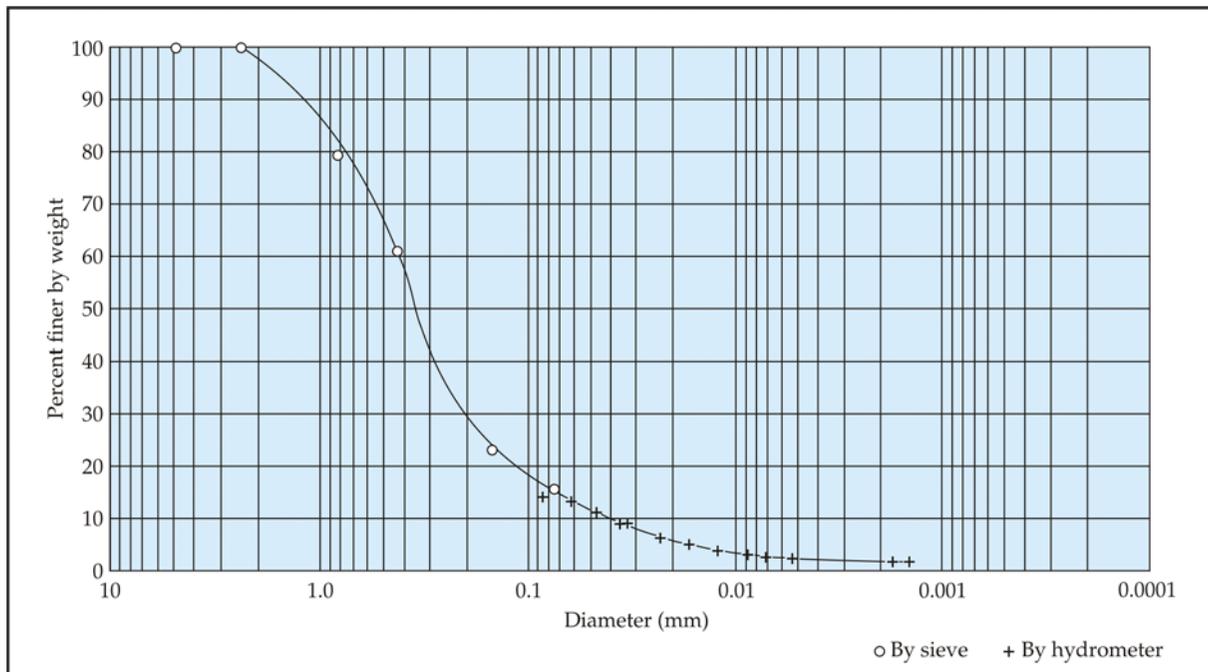


Figure 1 Typical Grain Size Distribution Diagram

B. Wet Sieve Analysis

(for soil fraction passing 4.75 mm sieve and retained on 75 micron sieve)

1. Take a portion of the sample prepared by drying in oven at 105°C to 110°C and brought to room temperature.
2. Soak the sample in water containing two grams of sodium hexametaphosphate or one gram of sodium hydroxide and one gram of sodium carbonate per litre of water and leave it for soaking overnight.
3. Wash out the finer fraction passing through 75 micron sieve. Washing should be continued until the water pressure through 75 micron sieve is substantially clean.
4. Then dry it in oven for 24 h and sieve the dry particles on 2 mm and 425 micron sized sieves and find the percentage of soil passing through each sieve and report the results in form EW-1

5. Care shall be taken to see that the sieves are not overloaded. See Note 3.

Note 3: The permissible maximum mass of sample on the 200 mm diameter sieves shall be as follows :

Table 301.1.3 Permissible Maximum Mass of Sample on 200 mm Diameter Sieves

IS Sieve Designation	Maximum Mass of Sample (g)
2 mm	200
425 micron	50
75 micron	25

Form EW-1

Sieve Analysis of Soil

Dry Sieving

Weight of Soil Sample Taken: (g)

I. S. Sieve * Designation	Weight of Sample Retained (g)	Percent of Wt. Retained	Cumulative Percent of Wt. Retained (%)	Percentage of Wt. Passin
100 mm				
75 mm				
19 mm				
4.75 mm				

Wet Sieving

Weight of Soil Sample Taken: (g)

I. S. Sieve * Designation	Weight of Sample Retained (g)	Percent of Wt. Retained	Cumulative Percent of Wt. Retained (%)	Percentage of Wt. Passin
2 mm				
425 μ				
75 μ				

Summary of Results

Clay / silt (-75 micron) percent	
Sand (-4.75 mm + 75 micron) percent	
Gravel (-100 mm + 4.75 mm) percent	

- Sieves of intermediate sizes may also be used, if desired.

Reference IS: 2720 (Part 4) – 1985 (Second Revision)

301.2. Liquid Limit, Plastic Limit and Plasticity Index


Purpose

The Liquid and Plastic Limits (Atterberg Limits) of soil indicate the water contents at which certain changes in the physical behaviour of soil can be observed. From Atterberg limits, it is possible to estimate the engineering properties of fine-grained soils. Plasticity is the property that enables a material to undergo deformation without noticeable elastic recovery and without cracking or crumbling. Plasticity is a major characteristic of soils containing an appreciable proportion of clay particles.

Procedure

A. Liquid Limit (LL)

1. Take 120 g of soil passing IS: 425 micron sieve.
2. Mix it with distilled water to form a uniform paste. The paste shall have a consistency that will require 30 to 35 drops of the cup to cause required closure of the standard groove. In case of clayey soils, paste may be left standing for 24 h to ensure uniform distribution of moisture throughout the soil mass.
3. Remix the soil thoroughly and place a portion of the paste in the cup of the apparatus.
4. Squeeze down and spread the sample with as few strokes of spatula as possible, at the same time trim it down to a depth of 1cm at the point of maximum thickness, Level the specimen to half the cup.
5. Cut the paste with the standard grooving tool along the centre line. In case where grooving tool type A does not give a clear groove as in sandy soil, use grooving tool type B or C.
6. Start rotating the handle at 2 revolutions per second.
7. Count the number of blows till two parts of the sample come into contact at the bottom of the groove along a distance of 12 mm. This length shall be measured with the end of the grooving tool or a ruler.
8. Record the number of blows and determine moisture content of the sample taken near the closed groove.

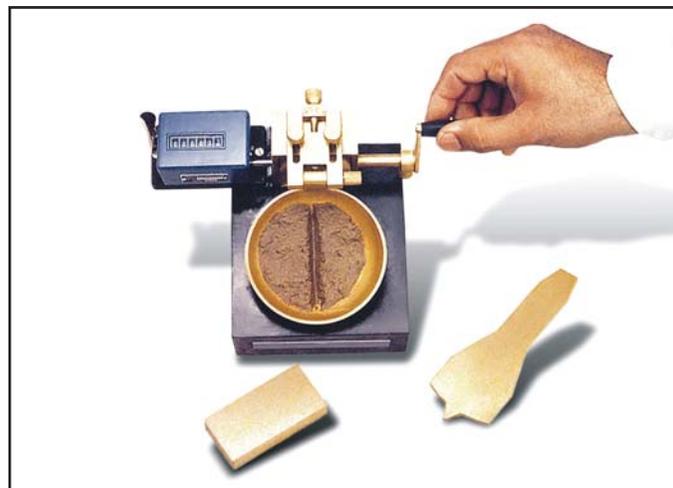

Liquid Limit Device

9. Repeat the test by changing the moisture content so that the number of blows to close the groove is not less than 15 or more than 35, such that the points on the flow curve are evenly distributed.
10. Plot a graph between log (number of blows) and moisture content and fit a straight line.
11. Read the moisture content corresponding to 25 number of blows from the graph. This gives the Liquid Limit of the soil.

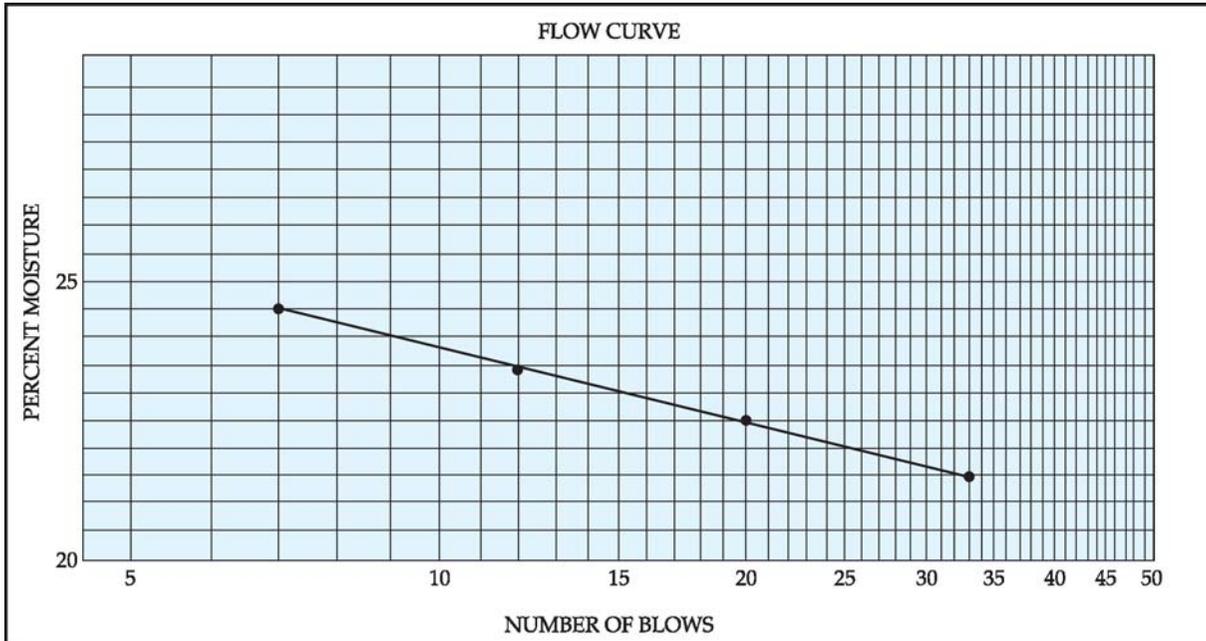


Figure 2 Determination of Liquid Limit

B. Plastic Limit (PL)

1. Take about 20 g of soil passing IS: 425 micron sieve.
2. Mix it with distilled water to form a paste which is plastic enough to be easily moulded with fingers. In the case of clayey soils, leave the soil mass standing for 24 h to obtain a uniform distribution of moisture.
3. Take about 8 g of soil from the paste and make a ball.
4. Roll the ball on a glass plate with hand to make a thread of uniform diameter throughout its length. The rate of rolling shall be between 80 and 90 strokes per minute counting a stroke as one complete motion of the hand forward and back to the starting position again.
5. When the diameter of thread reaches 3 mm, remould the soil again to a ball.
6. Repeat the process of rolling and remoulding until the thread of soil just starts crumbling at a diameter greater than 3 mm. This shall be considered a satisfactory end point, provided the soil has been rolled into a thread 3 mm in diameter immediately before. At no time, shall an attempt be made to produce failure at exactly 3 mm diameter by allowing the thread to reach 3 mm, then reducing the rate of rolling or pressure or both, and continuing the rolling without further deformation until the threads fall apart.
7. Determine the moisture content of the crumbled threads.

8. Repeat the test two more times with fresh portion of the soil mix.
9. The average of the moisture content of the soil in the three trials gives the Plastic Limit of the soil.

C. Plasticity Index (PI)

Plasticity Index is determined by subtracting the value of plastic limit from the value of the liquid limit.

$$PI = LL - PL$$

Report the results in Form EW-2.

Form EW-2

Atterberg Limits Test

Determination of Liquid Limit (LL)

	1	2	3	4	5	6	Remarks
Container Number							
Weight of container + wet soil							
Weight of container + dry soil							
Loss of Moisture							
Wt. of container							
Wt. of dry soil							
Moisture content %							
Number of blows							

Liquid Limit (LL) =per cent

Determination of Plastic Limit (PL)

	1	2	3	Remarks
Container Number				
Weight of container + wet soil				
Weight of container + dry soil				
Loss of Moisture				
Wt. of container				
Wt. of dry soil				
Moisture content %	(mc ₁)	(mc ₂)	(mc ₃)	

$$Plastic\ Limit\ (PL) = \frac{mc_1 + mc_2 + mc_3}{3} = \text{..... per cent}$$

$$Plasticity\ Index\ (PI) = LL - PL = \text{..... per cent}$$

Reference : IS 2720 (Part 5) - 1985

301.3 Proctor Density (Light Compaction)

Purpose

Compaction is measured in terms of dry density achieved. This is a function of water content, the compactive effort and the nature of soil. For the same compactive effort, this test determines the optimum moisture content and the maximum dry density of a given soil.



UNIVERSAL AUTOMATIC COMPACTOR

Procedure

1. Weigh the mould (W_1) to the nearest 1g with base plate attached.
2. Take about 6 kg of air dried soil passing 20 mm IS sieve for soils not susceptible to crushing during compaction, or about 15 kg of materials passing a 19 mm sieve for soils susceptible for crushing during compaction (see Note 1). Sieve this portion on a 19 mm sieve and reject the coarse fraction after recording its proportion of the total sample.

NOTE 1- The soil should be considered susceptible to crushing during compaction if the sample contains granular material of a soft nature, such as soft limestone, sandstone, etc. which is reduced in size by the action of the 2.6 kg rammer. The procedure given for soils susceptible to crushing during compaction can be applied to all soils, if it is convenient to do so.

Aggregations of particles shall be broken down so that, if the sample was sieved on a 4.75 mm IS sieve, only separated individual particles would be retained.

Two separate procedures for the test shall be used depending on whether the soil is susceptible to crushing during compaction or not.

Procedure for Soil not Susceptible to Crushing during Compaction: A 5 kg sample of air-dried soil passing the 19 mm IS test sieve shall be taken. The sample shall be mixed thoroughly with a suitable amount of water depending on the soil type (see Notes 2, 3 and 4).

The mould, with base plate attached, shall be weighed to the nearest 1g (m_1). The mould shall be placed on a solid base, such as a concrete floor or plinth and the moist soil shall be compacted into the mould, with the extension attached, in three layers of approximately equal mass, each layer being given 25 blows from the 2.6 kg rammer dropped from a height of 310 mm above the soil. The blows shall be distributed uniformly over the surface of each layer. The operator shall ensure that the tube of the rammer is kept clear of soil so that the rammer always falls freely. The amount of soil used shall be sufficient to fill the mould, leaving not more than about 6 mm to be struck off when the extension is removed (see Note 5). The extension shall be removed and the compacted soil shall be levelled off carefully to the top of the mould by means of the straight edge. The mould and soil shall then be weighed to the nearest 1g (m_2).

The compacted soil specimen shall be removed from the mould and placed on the mixing tray. The water content of representative sample of the specimen shall be determined as in IS: 2720 (Part 2)-1973.

The remainder of the soil specimen shall be broken up, rubbed through the 19 mm IS test sieve, and then mixed with the remainder of the original sample. Suitable increments of water (see Note 6) shall be added successively and mixed into the sample, and the above procedure from operations 5.1.2 to 5.1.4 shall be repeated for each increment of water added. The total number of determinations made shall be at least five, and the range of moisture contents should be such that the optimum moisture content, at which the maximum dry density occurs, is within that range.

Soil Susceptible to Crushing during Compaction (See Note 1)-

- a) Five or more 2.5 kg samples of air-dried soil passing the 19 mm IS test sieve, shall be taken (see Note 2). The samples shall each be mixed thoroughly with different amounts of water to give a suitable range of moisture contents (see Notes 3 and 4). The range of moisture contents, at which the maximum dry density occurs, is within that range (see Note 6).
- b) Each sample shall be treated as stated earlier.
- c) Each compacted specimen shall be treated as stated earlier.
- d) The remainder of each soil specimen shall be discarded.

Compaction in Large Size Mould- For compacting soil containing coarse material up to 37.5 mm size, the 2 250 ml mould should be used. A sample weighing about 6 kg and passing the 40 mm IS sieve is used for the test. Soil is compacted in three layers, each layer being given 55 blows of the 2.6 kg rammer. The rest of the procedure is same as stated earlier.

NOTE 2- The removal of small amounts of stone (up to 5 percent) retained on a 19 mm IS Sieve will affect the density obtainable only by amounts comparable with the experimental error involved in measuring the maximum dry density. The exclusion of a large proportion of stone coarser than 19 mm may have a major effect on the density obtained compared with that obtainable with the soil as a whole, and on the optimum moisture content. There is at present no generally accepted method of test or of calculation for dealing with this difficulty in comparing laboratory compaction test results with densities obtained in the field. For soils containing larger proportions of gravel, the use of a bigger mould (2 250 ml) will avoid major errors. If proportion of gravel is more than 10%, modified MDD should be invariably

found out or calculated so that FDD is correctly compared.

NOTE 3- The amount of water to be mixed with air-dried soil at the commencement of the test will vary with type of soil under test. In general, with sandy and gravelly soils, a moisture content of 4 to 6 percent would be suitable, while with cohesive soils moisture content about 8 to 10 percent below the plastic limit of the soil would (plastic limit minus 10 to plastic limit minus 8) usually be suitable.

NOTE 4- It is important that the water is mixed thoroughly and adequately with the soil, since inadequate mixing gives rise to variable test results. This is particularly important with cohesive soils when adding a substantial quantity of water to the air-dried soil. With clays of high plasticity or where hand mixing is employed, it may be difficult to distribute the water uniformly through the air-dried soil by mixing alone, and it may be necessary to store the mixed sample in a sealed container for a minimum period of about 16 h continuing with the test.

NOTE 5- It is necessary to control the total volume of soil compacted; since it has been found that if the amount of soil struck off after removing the extension is too great, the test results will be inaccurate.

NOTE 6- The water added for each stage of the test should be such that a range of moisture contents is obtained which include the optimum moisture. In general, increments of 1 to 2 percent are suitable for sandy and gravelly soils and of 2 to 4 percent for cohesive soils. To increase the accuracy of the test, it is often advisable to reduce the increments of water in the region of the optimum moisture content.

Calculations

Bulk Density $\tilde{\gamma}_m$ in g/ml of each compacted specimen shall be calculated from the equation:

$$\gamma_m = \frac{m_2 - m_1}{V_m}$$

where

m_1 = mass in g of mould and base;

m_2 = mass in g of mould, base and soil; and

V_m = volume in ml of mould.

The dry density, γ_d in g/ml, shall be calculated from the equation:

$$\gamma_d = \frac{100 * \gamma_m}{100 + w}$$

where

w = water content of soil in percent.

The dry density γ_d obtained in a series of determinations shall be plotted against the corresponding moisture contents w. A smooth curve shall be drawn through the resulting points and the position of the maximum on this curve shall be determined.

Reporting of results: The experimental points and the smooth curve drawn through them showing the

relationship between moisture content and dry density shall be reported.

The dry density in g/ml corresponding to the maximum point on the moisture content/dry density curve shall be reported as the maximum dry density to the nearest 0.01.

The percentage moisture content corresponding to the maximum dry density on the moisture content/dry density curve shall be reported as the optimum moisture content and quoted to the nearest 0.2 for values below 5 percent, to the nearest 0.5 for values below 5 to 10 percent; and to the nearest whole number for value exceeding 10 percent (see Note 7).

The amount of stone retained on the 19 mm IS Sieve shall be reported to the nearest 1 percent.

The method of obtaining the result shall be stated (2.6 kg rammer method). The procedure used shall also be stated, that is, single sample or separate sample and size of the mould used.

NOTE 7- For some highly permeable soils such as clean gravels, uniformly graded and coarse clean sands, the results of the laboratory compaction test (2.6 kg rammer method) may provide only a poor guide for specification on field compaction. The laboratory test often indicates higher values of optimum moisture content than would be desirable for field compaction and the maximum dry density is often much lower than the state of compaction that can readily be obtained in the field.

Form EW-3

Proctor Density

Description of Sample	
Type of Test	Standard Proctor
Weight of mould W_1 (g)	
Volume of mould V_m (cm ³)	
Percent retained on 20 mm IS Sieve	

S.No.	Weight of mould + compacted soil (g) W_2	Weight of wet soil (g) $W_2 - W_1$	Wet density (g/cc)	Container No.	Weight of container (g)	Weight + wet soil (g)	Weight of container + dry soil (g)	Weight of Water (Ww) (g)	Weight of dry soil (Ws) (g)	Moisture Content (%) (W)	Dry density (g/cc)
1											
2											
3											
4											
5											

Factors affecting Compaction

Compaction is measured in terms of the dry density achieved. This is found to be a function of

1. the water content
2. the compactive effort applied to the soil, and
3. the nature of the soil.

These effects are briefly discussed below

The effect of water content on compaction :

The shearing resistance to relative movement of the soil particles is large at low water contents. As the water content increases, it becomes relatively easier to disturb the soil structure, and the dry density achieved with a given compactive effort increases. However if the dry density is plotted against the water content for a given compactive effort, it will be seen that the dry density reaches a peak, after which any further increase in water content results in a lower dry density.

From the dry density / water content curve, we can determine two quantities;

- (a) the maximum dry density, and
- (b) the optimum water content at which this maximum dry density is achieved

The effect of variations in compactive effort:


Both the maximum dry density and the optimum water content are found to depend on the compactive effort used. Increasing the compactive effort increases the maximum dry density, but reduces the optimum water content. The air void ratio at the peak density remains very much the same.

It may be seen that, at high water contents, there is little to be gained by increasing the compactive effort beyond a certain point.

The effect of soil type on compaction:


The highest dry densities are produced in well-graded coarse-grained soils, with smooth rounded particles. Uniform sands give a much flatter curve, and a lower maximum dry density. Clayey soils have much higher optimum water contents, and consequently lower maximum dry densities. The effect of increasing the compactive effort is also much greater in the case of clayey soils.

Figures 3 and 4 show typical results of compaction tests for different soils and different moisture contents.

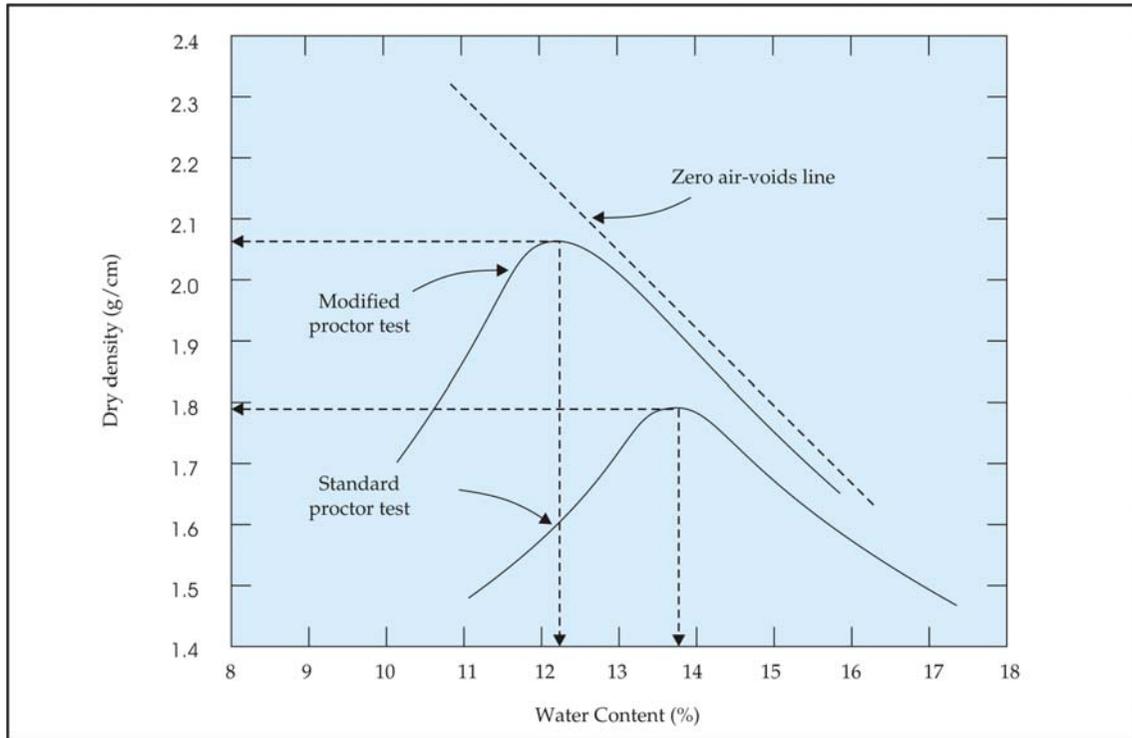

Note : $1 \text{ g/cm}^3 = 9.81 \text{ kN/m}^3$

Figure 3. Modified Proctor Test Curve (Dry Density vs Moisture Content)

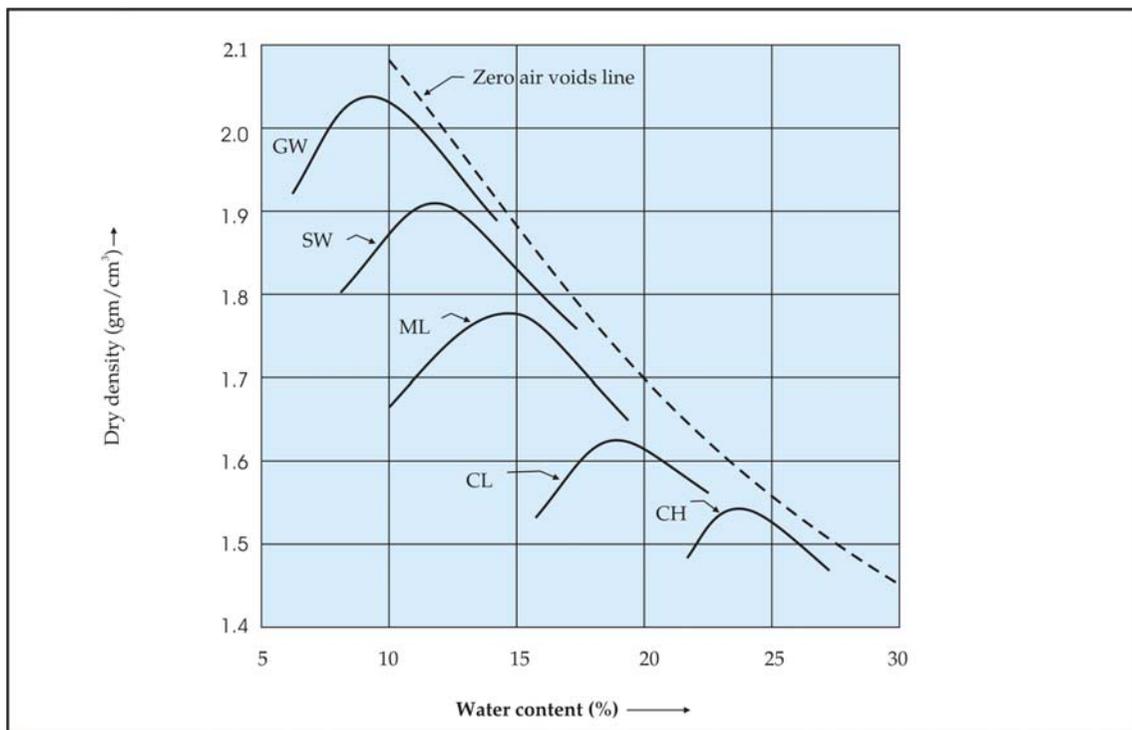

Note : $1 \text{ g/cm}^3 = 9.81 \text{ kN/m}^3$

Figure 4. Compaction Curve for a Range of Soil Types

Table 301.3.1 Typical Values of Maximum Dry Density and Optimum Water Content

Type of Soil	BS Light Hammer (Proctor) test		BS Heavy hammer (AASHO) test	
	Max.dry density (kN/m ³)	Optimum water content (%)	Max.dry density (kN/m ³)	Optimum water content (%)
Clay	15.2	28	18.2	18
Silty Clay	16.3	21	19.1	12
Sandy Clay	18.1	14	20.4	11
Sand	19.0	11	20.6	9
Gravel-sand-clay-mixture	20.0	9	22.0	8

Reference: IS : 2720 (Part 7) – 1980 reaffirmed 1987.

301.4 Free Swell Index Test

Purpose

On saturation, certain soils expand in volume due to the presence of particular minerals. Soil with free swell index more than 50% is considered inadequate for use as fill material.

Procedure

1. Take two samples of oven dry soil passing through 425 micron sieve- 10g each.
2. Take two 100 ml graduated glass cylinders.
3. Pour the soil sample in each cylinder.
4. Fill distilled water in one cylinder and kerosene in the other cylinder upto 100 ml marks.
5. Remove the entrapped air by gentle shaking or stirring with a glass rod.
6. Leave the samples to settle and allow sufficient time (24 h or more) for the soil samples to attain equilibrium state of volume.
7. Read the final volume of soil in each cylinder.
8. Determine the differential free swell index S_d using the formula

$$S_d = \frac{\text{Volume of soil in water} - \text{Volume of soil in kerosene}}{\text{Volume of soil in kerosene}} \times 100$$

9. If the value of S_d is 50 per cent or more, the soil is expansive and not suitable for use as embankment fill material.

Free Swell Index

Sample No.	Final volume of soil in water V_w	Final Volume of soil in kerosene V_k	Free Swell Index $S_d = \frac{V_w - V_k}{V_k} \times 100$

Note : Permissible Limit Max 50 per cent

Reference: IS: 2720 (Part 40) – 1977

301.5 Deleterious Content (Organic Matter)

Purpose

Deleterious contents of soil such as organic matter affect its characteristics and behaviour adversely and must therefore be within 2%.

Procedure

1. Take an air dried sample of soil and determine its moisture content. Using another sample, produce about 100 g of soil passing the 10 mm I.S. sieve. Pulverise this sample to pass through 425 micron I.S.sieve.
2. In case the soil contains a high percentage of sulphides or chlorides it may be neutralised with dilute sulphuric acid or washed with distilled water to remove the salts.
3. Take 5g of soil from thoroughly mixed soil passing 425 micron sieve and place it in a glass weighing bottle. The weight of the sample should be less (upto 0.2g) for soils with higher content of organic matter.
4. Add 10 millilitres of potassium dichromate solution into the conical flask with a burette and add 20 ml of concentrated sulphuric acid. Swirl the mixture for about one minute and keep it on a heat insulated surface for 30 min to allow oxidation.
5. Add 200 ml of distilled water along with 10 ml of orthophosphoric acid and 1 ml of sodium fluoride as the indicator. Shake the mixture vigorously. If the indicator gets absorbed, add another 1 ml of the indicator.
6. Add ferrous sulphate solution from a second burette until the colour of the solution changes from blue to green. Add a further 0.5 ml of potassium dichromate to change the colour from green to blue.
7. Add ferrous sulphate solution drop by drop with continuous swirling until the colour of the solution changes with a single drop. Note the total volume of ferrous sulphate solution used in the experiment.

Calculations

The total volume of potassium dichromate used to oxidise the organic matter in the soil is given by the following formula

$$V = 10.5 (1.0 - Y/X)$$

Where

Y = total volume of ferrous sulphate used in the test

X = total volume of ferrous sulphate used in the standardization test

The percentage of organic matter present in the oven-dried sample may be calculated from the following formula

The organic matter, percent by weight =
$$\frac{0.67 \cdot W_2 \cdot V}{W_1 \cdot W_3}$$

Where

W₂ = weight on oven-dry basis of the soil sample passing 10 mm sieve

V = total volume of potassium dichromate used to oxidise the organic matter

W₁ = weight on oven-dry basis of the total soil sample before sieving

W₃ = weight on oven-dry basis of the soil specimen used in the test

FORM EW - 5

Determination of Organic Matter Content

S.No.	Total volume of potassium dichromate used to oxidize the Organic Matter V	Wt. of soil sample (oven dried) before sieving W ₁ (g)	Wt. of soil sample (oven dried) passing 10 mm size W ₂ (g)	Wt. of soil sample (oven dried) used in the test W ₃ (g)	Organic matter percent by weight $\frac{0.67 \times W_2 \times V}{W_1 \times W_3}$

Reference I.S. 2720 (Part 22) - 1972

301.6 Deleterious Content (Soluble Sulphate)

Purpose

Sodium sulphate is present in some Indian soils. The salt is easily hydrated and dehydrated under the influence of climatic changes. There are enormous volume changes during this process of hydration and dehydration, which influence the engineering properties of soils.

Procedure

1. Take the soil sample in a state in which it can be crumbled. If necessary, dry it in oven at 105°C to 110°C. Break the lumps in a mortar with a rubber covered pebble. Mix the sample thoroughly and sub-divide it by quartering.
2. Take 10 g of soil from the sample in a 250 ml bottle with 100ml of distilled water. Shake it occasionally for about 2 h with a mechanical shaker. Allow the soil to stand overnight. In case the soil is dispersive, add 0.5 to 1.0 g of pure potassium nitrate to flocculate the particles.
3. Filter and take 25 ml of filtrate in a beaker. See if the solution is alkaline from phenolphthalein indicator. If so, add concentrated hydrochloric acid to just neutralize the solution. Add further 4 ml of hydrochloric acid to make the solution acidic.
4. Boil the solution. Remove the solution from heat and add hot barium chloride solution in a fine stream with constant stirring, till there is no precipitation with further addition.
5. Place the beaker on a steam bath for a minimum period of 4 h and allow precipitate to settle. Further the precipitate through ashless filter paper wash free from chloride ions, dry and ignite filtration can be done through a pre-weighed sintered glass crucible or a Gooch crucible. In case of filter paper after drying, ashing shall be done. On a low flame and the precipitate then ignited over a burner or in a muffle furnace at 600°C to 700°C for half an hour.
6. Cool in a dessicator, weigh and note the residue. This is the weight of the barium sulphate.
7. Calculate the corresponding weight of sodium sulphate and determine its percentage as follows:
 - a) Sulphate (SO_4) percent by mass = $41.15 W_1/W_2$
 - b) Sodium Sulphate ($\text{Na}_2 \text{SO}_4$) percent by mass = $60.85 W_1/W_2$

Where

W_1 = mass in g of the precipitate

W_2 = Mass of g of the soil contained in the solution taken for precipitation.

FORM EW-6

Determination of Soluble Sulphate Content

S.No.	Mass of the Precipitate W_1 (g)	Mass of the Soil contained in the solution W_2 (g)	Sulphate as SO_4	Sulphate as SO_3 = $\text{SO}_4 \times 80/96$

Reference: IS : 2720 (Part 27) -1977

B Construction & Workmanship

301.7 Water Content of Soil

Purpose

The properties of soil like shear strength and compaction characteristics are greatly influenced by its water content and the changes therein. Water content thus indicates the likely behavior of soil.



ELECTRIC OVEN



DIGITAL BALANCE

Procedure**a. Oven-Drying Method (Standard Method)**

1. Take any suitable non-corrodible air-tight container. Clean the container tin with lid, dry and weigh (W_1).
2. Take the required quantity of soil specimen in container, crumbled and placed loosely and weigh with lid (W_2).
3. Then keep it in an oven with the lid removed and maintain the temperature of the oven at $110^\circ\text{C} \pm 5^\circ\text{C}$.
4. If the soil contains gypsum or other minerals having loosely bound water of hydration or with significant amount of organic material, the drying may be carried out at $60\text{-}80^\circ\text{C}$.
5. Dry the specimen in the oven for 24 h.
6. Take out container from oven, place the lid back on the container and cool the container in a desiccator.
7. Record the final weight (W_3) of the container with lid and dried soil sample.
8. Calculate the percentage of moisture content using the formula:

$$\text{Moisture content} = \frac{W_2 - W_3}{W_3 - W_1} \times 100$$

9. Report the results in Form EW-7

Form EW-7

Moisture Content Test of Soil by Oven-drying Method

Sample No.	Tin No.	Wt. of Tin wet (g) (W_1)	Wt. of Tin+ soil (g) (W_2)	Wt. of Tin+ dry soil (g) (W_3)	Loss of water (g) ($W_2 - W_3$)	Wt. of dry soil (g) ($W_3 - W_1$)	Moisture Content (%) $\frac{W_2 - W_3}{W_3 - W_1} \times 100$

Note: Speedy Moisture Metres are also available in market. These are based on the principle that water will react with calcium carbide to form acetylene gas. Quantity of gas formed is directly proportional to the water present. The quantity of gas can be read from a pressure gauge which is calibrated in percentage of moisture on wet weight basis. This can then be converted to moisture content based on dry weight.

Reference I.S. 2720 (Part2) – 1973

b. Sand Bath Method

Purpose

The properties of soil like shear strength and compaction characteristics are greatly influenced by its water content and the changes therein.

Procedure

1. Take an open vessel of 150 mm diameter containing sand filled (called as sand bath) to a depth of 3 cm or more.
2. Take the required quantity of soil specimen in tray, crumbled and placed loosely and weigh (W_1).
3. Place few pieces of white paper on the sample.
4. Then keep the tray on the sand bath and heat it with stove. Drying takes place about 20 to 60 min, depending upon the type of soil. The white paper turns brown when overheating occurs.
5. Take tray out of the sand bath, once drying is over and cooled and weighed.
6. Record the weight of the dried soil sample (W_2).
7. Calculate the percentage of moisture content using the formula:
Moisture content: $[(W_1 - W_2) / W_2] * 100$
8. Report the results in Form EW-8.

Form EW-8

Moisture Content by Sand Bath Method

Sample No.	Wt. of wet soil (g) (W_1)	Wt. of dry soil (g) (W_2)	Loss of water (g) ($W_1 - W_2$)	Moisture Content (%) $\frac{W_1 - W_2}{W_2} \times 100$

c. Rapid Determination of Water Content with Alcohol Method

Purpose

It is a rapid method of determining the moisture content. Though less accurate, it is more suitable as a field test.

Procedure

1. Clean the evaporating dish, dry and weigh (W_1).
2. Take appropriate quantity of soil specimen in the evaporating dish and weigh (W_2).

3. Pour methylated spirit over the soil at the rate of about one millilitre for every gram of soil taken so that the soil is well covered.
4. Work the methylated spirit well into the soil with the palette knife and break up any large lumps of soil.
5. Place the evaporating dish on a surface which will not be affected by heat and ignite the methylated spirit. Stir the soil constantly with the spatula or knife taking care to see that none of the soil is lost.
6. After the methylated spirit has burnt away completely allow the dish to cool and weigh it with the contents (W_3).

Calculations

The percentage of water content shall be calculated as follows:

$$w = \frac{(W_2 - W_3)}{(W_1 - W_1)}$$

where

w = water content present

W_1 = mass of dish in g

W_2 = mass of dish with wet soil in g

W_3 = mass of dish with dry soil in g

d. Rapid Determination of Water Content with Infra – Red Lamp Torsion Moisture

Meter

Procedure

1. Set the 100 percent scale division of the calibrated drum to align with the index mark with the help of drive knob.
2. With the pan placed on the pivot check that the pointer is aligned with the index line and the 100 percent scale division. If not, set the pointer with the help of initial setting knob.
3. Rotate the drum drive knob anti-clockwise and bring the 0 percent scale division in line with the index mark, thus prestressing the wire through an amount equal to 100 percent scale division (this represents the amount of unbalance). The pointer will now be above the index mark.
4. Raise the lamp housing and carefully distribute the test material evenly on the sample pan until the pointer returns to the index mark (approximately 25 g of the material will be needed in one operation).
5. Lower the lamp housing and switch on the infra – red lamp with the help of the switch provided on the left hand side. Insert the thermometer in its socket and bracket. Adjust the control knob between 95 and 100 on the scale if it is desired that the temperature of drying is around 110°C. The sample will now begin to lose water and pointer will rise above the index.

e. **Rapid Determination of Moisture Content from Gas Pressure developed by the Reaction of Calcium Carbide with the Free Water of the Soil**

Purpose

The purpose of this test is to determine the moisture content of soil quickly, without having to wait for the moisture to evaporate.

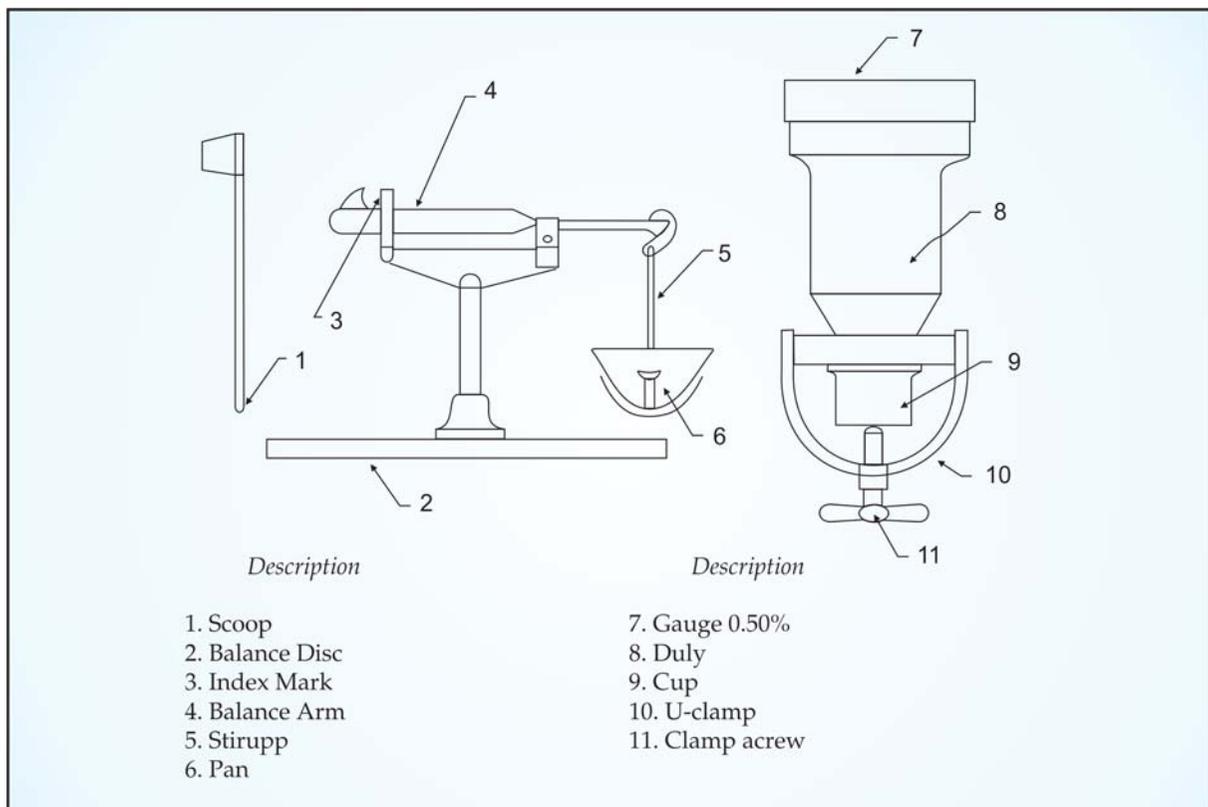


Figure 5 Set up for Rapid Determination of Moisture Content

Procedure

1. The apparatus required for the test includes one metallic pressure vessel with clamp for sealing cup and a gauge calibrated in percentage water. One counterpoint balance, a scoop for measuring calcium carbide and three steel balls of 12.5 mm diameter and one steel ball of 25 mm diameter.
2. Set up the balance and place the sample in the pan till the mark on the balance arm mass lines up with the index mark.
3. Unclamp the clamping screw to move the U-clamp off the cup. Lift off the cup. Clean the cup and the body.
4. Hold the body horizontally and gently deposit one level scoopful of calcium carbide halfway inside the chamber. Then lay the chamber down without disturbing the absorbent charge and transfer the soil weighed out as above from the pan to the cup.

5. Holding cup and chamber approximately horizontal bring them together, without disturbing sample or absorbent, bring the U clamp round and clamp the cup tightly into place.
6. With the gauge downwards, shake the moisture meter up and down vigorously for 5 seconds, then quickly turn it so that the gauge is upwards, give a tap to the body of the moisture meter to ensure that all the contents fall into the cup.
7. Hold the rapid moisture meter downwards, again shake for 5 seconds, then turn it with gauge upwards and tap. Hold for one minute. Repeat this for a third time. Once more invert the rapid moisture meter and shake up and down to cool the gas. Turn the rapid moisture meter with the gauge upwards, and dial horizontal held at chest height when the needle comes to rest, take the reading. The readings on the meter are the percentages of water on the wet mass basis.
8. Alternatively, the three smaller steel balls can be placed in the cup along with the soil and the larger one in the body along with the absorbent and seal up the unit as usual. Hold the rapid moisture meter vertical so that the material in the cup falls into the body. Now holding the unit horizontally, rotate it for 10 seconds so that the balls are rolled round the inside circumference of the body. Rest for 20 seconds. Repeat the rotation – rest cycle until the gauge reading is constant (usually this takes 4 to 8 min). Note the reading as usual.
9. Finally release the pressure slowly (away from the operator) by opening the clamp screw and taking the cup out, empty the contents and clean the instrument with a brush.
10. Calculate the water content (w) on the dry mass from the water content (m) obtained on the wet mass basis as the reading on the rapid moisture meter, as follows:

$$w = \frac{m}{(100-m)} \times 100 \text{ percent}$$

where,

w = percent water content of the dry mass

m = percent water content of the wet mass

Reference IS 2720 (Part II) - 1973

301.8 Measurement of In-situ Density / Degree of Compaction

a. Sand replacement method

Purpose

Field density of soil affects its permeability and compressibility. Also the compaction of soil is measured in terms of dry density achieved.

Procedure

1. The pouring cylinder shall be filled so that the level of the sand in the cylinder is within about 10 mm of the top. Its total initial weight (W_1) shall be found and shall be maintained constant throughout the tests for which the calibration is used. Volume of sand equivalent to that of the excavated hole in the soil (or equal to that of the calibration container) shall be allowed to run out

of the cylinder. The shutter on the pouring cylinder shall then be closed and the cylinder placed on a plane surface such as the glass plate. (Sand should be clean natural sand passing 1.0 mm IS sieve and retained on 600 micron).

2. The shutter on the pouring cylinder shall be opened and sand allowed to run out. When no further movement of sand takes place in the cylinder, the shutter shall be closed and the cylinder moved carefully.
3. The sand that has filled the cone of the pouring cylinder (that is the sand that is left on the plane surface) shall be collected and weighed to the nearest gram repeated at least three times and the mean weight (W_2) taken.
4. The internal volume (V) in cc of the calibrating container may be calculated from its internal dimensions.
5. The pouring cylinder shall be placed concentrically on the top of the calibrating container after being filled to the constant weight (W_1). The shutters on the pouring cylinder shall be closed during this operation. The shutters shall, be opened and sand allowed to run out. When no further movement of sand takes place, the shutter shall be closed. The pouring cylinder shall be removed and weighed to the nearest gram.
6. These measurements shall be repeated at least three times and the mean weight (W_3) taken.
7. A flat area, approximately 45 cm square, of the soil to be tested shall be exposed and trimmed down to a level surface, preferably with the aid of the scraper tool.
8. A round hole approximately 10 cm dia and the depth of the layer to be tested upto a maximum of 10 cm depth shall be excavated in the soil. No loose material shall be left in the hole. The metal tray with a central hole shall be laid on the prepared surface of the soil with the hole over the portion of the soil to be tested - the hole in the soil shall then be excavated using the hole in the tray as a patter. This tray shall be removed before the pouring cylinder is placed in a position over the excavated hole. The excavated soil shall be carefully collected and weighed to the nearest gram.
9. The moisture content (W) of the excavated soil shall be determined by taking representative sample of soil. Alternatively, the whole of the excavated soil may be dried and weighted (W_d).
10. The pouring cylinder filled to the constant weight (W_1) shall be placed so that the base of the cylinder covers the hole concentrically, the shutters on the pouring cylinder shall be closed during this operation. The shutter shall then be opened and sand allowed to run out into the hole.
11. The pouring cylinder and surrounding area shall not be vibrated during this period. When no further movement of sand takes place, the shutter shall be closed. The cylinder shall be removed and weighed to the nearest gram (W_4) (See Note).

Note: 0It is necessary to make a number of repeated determinations say 4 to 5 and to average the results, since the dry density of the soil varies appreciably from point to point.

12. The weight of sand (W_a) in g required to fill the calibrating container shall be calculated from the following formula.

$$W_a = W_1 - W_2 - W_3$$

Where

W_1 - Weight of pouring cylinder and sand before pouring into calibrating Cylinder in g.

W_2 - Mean weight of sand in cone in g.

W_3 - Mean weight of cylinder with residual sand after pouring into calibrating cylinder and cone in g

13. The bulk density of the sand Y_s in (g/cc) shall be calculated from the formula:

$$Y_s = W_a / V$$

Where

V = Volume of calibrating cylinder in cc

14. The weight of sand (W_b) in g required to fill the excavated hole shall be calculated from the following formula.

$$W_b = W_1 - W_4 - W_2$$

Where

W_1 - Weight of cylinder and sand before pouring into hole in g

W_2 - Mean weight of sand in cone, in g

W_4 - Weight of cylinder and sand after pouring into hole and cone in g

15. The bulk density of the soil Y_b shall be calculated from the following formula:

$$Y_b = \frac{W_w}{W_b} \times Y_s \text{ g/cc or}$$

Where

W_w - Weight of natural soil excavated in g

W_b - Weight of sand required to fill the hole in g

Y_s - Bulk density of sand

16. The density of the dry soil Y_d shall be calculated from the following formula.

$$Y_d = \frac{W_w}{W_b} \times Y_s \text{ g/cc or } \frac{100}{100 + W} \times Y_b \text{ g/cc}$$

Where

W - Moisture content of the soil in percent

W_w - Weight of dry soil from the hole in g and

W_b - Weight of sand required to fill the hole in g

The following values shall be reported. (Form EW-9 for recording results)

- (a) Dry density of soil in g/cc.
- (b) Moisture content of the soil in percent.



SAND POURING CYLINDER APPARATUS

Field Density of Soil
(Sand replacement method)

Road/Section Details:

Date of Testing:

Location of test point.:

Thickness of layer: mm

Observation Tables

a)	<p>Calibration</p> <p>(i) Mean weight of sand in cone (of pouring cylinder) (W_2) in g.</p> <p>(ii) Volume of calibrating cylinder (V) in cm^3,</p> <p>(iii) Weight of sand (+ cylinder) before pouring into calibrating container (W_1) in g.</p> <p>(iv) Mean weight of sand (+cylinder) after pouring into calibrating container. (W_3) in g.</p> <p>(v) Weight of sand to fill calibrating cylinder. ($W_a = W_1 - W_2 - W_3$) in g.</p> <p>(vi) Bulk density of sand $Y_s = (W_a/V)$ g/cm^3</p>		
b)	<p>Determination of soil density</p> <p>(i) Determination number</p> <p>(ii) Weight of wet soil from hole (W_w) in g,</p> <p>(iii) Weight of sand (+ cylinder) before pouring into hole (W_1) in g.</p> <p>(iv) Weight of sand (+ cylinder) after pouring into hole and cone (W_4) in g.</p> <p>(v) Mean weight of sand in cone (W_2) in g.</p> <p>(vi) Weight of sand in hole, in g. $W_b = (W_1 - W_4 - W_2)$</p> <p>(vii) Bulk density $Y_b = (W_w/W_b) \times Y_s$ g/cm^3</p> <p>(viii) Moisture content container number</p> <p>(ix) Moisture content (W) percent</p> <p>(x) Weight of dry soil from the hole in g. (W_d)</p> <p>(xi) Dry density $Y_d = (W_d / W_b) \times Y_s$ Qm/cm^3</p>		
	Layer	Value*	Permissible Limit
	Below Subgrade		Not less than 97 per cent
	Subgrade		Not less than 100 per cent

Reference IS : 2720 (Part 28) -1974

b. Core Cutter Method for Field Density

Field density can be determined by core cutter also. The method can be used successfully whenever soil conditions permit pushing of cutter for sampling and taking it out in the laboratory without much disturbance. This is briefly described as under:-

1. Measure the inside dimensions of the cutter and calculate its volume.
2. Weigh the cutter without dolly.
3. Remove loose soil from the site.
4. Place the dolly over the cutter and ram it gently into the soil till about one cm of the dolly protrudes above the surface.
5. Dig out the cutter containing the soil extruding from the ground.
6. Remove the dolly and trim off any soil extruding from the ends.
7. Weigh the cutter full of soil and keep a representative sample for water content determination.
8. Calculate the dry density of the soil by knowing its weight, volume and water content. Form EW-10 for recording results.

Reference : IS : 2720 (Part 28) – 1974

Determination of Field Density of Soil (Core Cutter Method)

Form EW-10

S.No.	Observation	1	2	3
1.	Volume of Core Cutter = V cm ³			
2.	Weight of empty Core Cutter = W g			
3.	Weight of Core Cutter + Wet Soil = W ₁ g			
4.	Weight of Wet Soil = W ₁ -W g			
5.	Bulk Density Y _b = $\frac{W_1 - W}{V}$ g/cm ³			
6.	Container No.			
7.	Weight of Container + Soil Sample = W ₂ g			
8.	Weight of Container after oven drying = W ₃ g			
9.	Moisture Content = W ₂ - W ₃ g			
10.	Weight of empty Container = W ₄ g			
11.	Weight of Dry Soil = W ₃ - W ₄ g			
12.	Percentage of Moisture Content $w = \frac{W_2 - W_3}{W_3 - W_4} \times 100 \%$			
13.	Dry Density Y _d = $\frac{100}{100 + m} \times Y_b$ g/cm ³			

Reference: IS : 2720 (Part 29) – 1966.

c. Measurement of Density of Soil in place by Nuclear Density Gauge

Purpose

This is a quick method of determining the in-situ density of soil which is based on the radiation.

Procedure

For this test a special equipment which measures in place density using gamma radiation is used. Gauge usually contains a small gamma source (about 10mCi) such as Cesium – 137 on the end of a retractable rod.

Gamma rays are emitted from the source which interact with electrons in the surrounding material. Density of material is then correlated to the number of gamma rays received by the detector. The following procedure is used for measuring the density of soil.

1. Make the surface even by using a guide plate or any other suitable equipment.
2. Make a hole by pounding a steel rod with a similar diameter to that of gauges retractable rod. The hole should be at least 50mm deeper than the intended depth of measurement.
3. Nuclear Density Gauges normally operate in two modes.
 - i) Direct Transmission
 - ii) Back Scatter

For measuring the density of soil, set the equipment to 'Direct Transmission Mode'.

4. Lower the source rod into the hole. Set the handle to the depth position required.
5. Read the detector count on the panel. Use the calibration chart provided by the manufacturer to obtain density of material.
6. It may be noted that the detector count is inversely proportional to the density of the surrounding material.
7. The Nuclear Density Gauges are calibrated at the factory. Since the source material undergoes decay, it needs to be calibrated from time to time in accordance with the procedure given by the manufacturer.



Nuclear Density Gauge

301.9 Horizontal Alignment

Purpose

It is necessary to check the horizontal alignment to ensure that the work is set out in accordance with the approved drawings and dimensions.

Procedure

Horizontal alignment shall be reckoned with respect to the centerline of the carriageway as shown on the drawings. The permitted tolerances for the edges of the carriageway and the roadway and lower layers of pavement in plain and rolling terrain and in hilly terrain are given below.

	Permitted tolerances	
	In Plain and Rolling Terrain	In Hilly Terrain
Edges of carriageway	± 20 mm	± 30 mm
Edges of roadway and lower layers of pavement	± 30 mm	± 50 mm

301.10 Surface Levels

Purpose

Checking of levels of subgrades and different pavement courses is required to ensure that design thickness of various layers are actually transferred on to the ground.

Procedure

The levels of the subgrade and different pavement courses as constructed, shall not vary from those calculated with reference to the longitudinal and cross-profile of the road shown on the drawings or as directed by the Engineer beyond the tolerances mentioned in Table 301.10.1.

Table 301.10.1 Tolerances in Surface Levels**

S. No.	Layer	Tolerance Limits
1	Subgrade	+20mm -25mm
2	Subbase	
	a) Flexible pavement	+10mm - 20mm
	b) Concrete pavement (Dry lean concrete or rolled concrete)	+6mm - 10mm
3	Base course for flexible pavement	
	a) Bituminous course	+ 6mm - 6mm
	b) Other than bituminous	
	i) Machine laid	+ 10mm - 10mm
	ii) Manually laid	+ 15mm -15mm
4	Wearing course for flexible pavement	
	i) Machine laid	+ 6mm - 6mm
	ii) Manually laid	+ 10mm -10mm
5	Cement concrete pavement	+5mm - 6mm*

* This may not exceed 8 mm at 0-300 mm from the edges

** This Table 301.10.1 will be referred to for construction of various pavement layers dealt with in subsequent Sections.

Provided, however, that the negative tolerance for wearing course shall not be permitted in conjunction with the positive tolerance for base course, if the thickness of the former is thereby reduced by more than 6 mm for flexible pavements and 5 mm for concrete pavements.

For checking compliance with the above requirement for subgrade, sub-base and base courses, measurements of the surfaces levels shall be taken on a grid of points placed at 10 m longitudinally and 2.5 m transversely. For any 10 consecutive measurements taken longitudinally or transversely, not more than one measurement shall be permitted to exceed the tolerance as above, this one measurement being not in excess of 5 mm above the permitted tolerance.

For checking the compliance with the above requirement for bituminous wearing courses and concrete pavements, measurements of the surface levels shall be taken on a grid of points spaced at 6.25 m along the length and at 0.5 m from the edges and at the centre of the pavement. In any length of pavement, compliance shall be deemed to be met for the final road surface, only if the tolerance given above is satisfied for any point on the surface.

301.11 Surface Regularity
(Using a 3 m Straight Edge)

Purpose

Regularity of surface is essential for a smooth riding on the road surface.

Procedure

1. The 3 metre straight edge may be made of steel or seasoned hard wood. When made of wood, it may be 75 mm wide and 125 mm deep and its test face should preferably be shod with a metallic plate. The edge should be perfectly straight and free from warps, rots or defects of any kind.
2. Periodically, the straight edge should be checked for its trueness with a string or a metallic master straight edge. The straight edge should be rectified or replaced as soon as the same has lost its trueness.
3. The depressions under the straight edge are to be measured with a graduated wedge. The wedge should be metallic. The depressions should be graduated to read undulations up to 25 mm with a least count of at least 3 mm.
4. For recording depressions in the longitudinal profile of the road surface, the straight edge is placed longitudinally, parallel to the centre line of the road. Measurements along two parallel lines are sufficient for a single lane road.
5. The straight edge may be placed at the starting point with the wedge inserted between it and the test surface, where the gap is maximum. Take the reading.
6. The straight edge may then be slid forward by about 1.5 m distance and the wedge reading repeated. This process may be continued. .
7. Mark the locations with depressions in excess of the specified magnitude.
8. Count the number of undulations exceeding the specified magnitude.

Note: (i) A team of three persons consisting of two workmen and a supervisor would be required for one straight edge and two graduated wedges. The two workmen will operate the straight edge, while the supervisor will record measurements with the wedges and do the markings on the road.

(ii) At vertical curves, additional templates will be required.

302 EARTHWORK IN CUTTING

Sec No.	Title	Test Ref No.
A) Materials		
302.1	Grain Size Analysis	301.1
302.2	Liquid Limit, Plastic Limit and Plasticity Index	301.2
302.3	Proctor Density	301.3
302.4	Free Swell Index	301.4
302.5	Deleterious Content (Organic Content)	301.5
302.6	Deleterious Content (Soluble Sulphate)	301.6
302.7	CBR of Remoulded and Soaked Samples	302.7
B) Construction & Workmanship		
302.8	Determination of Moisture Content	
	(a) Oven-drying Method	301.7 (a)
	(b) Sand Bath Method	301.7 (b)
	(c) Alcohol Method	301.7 (c)
	(d) Infrared Lamp Torsion Balance Method	301.7 (d)
	(e) Rapid Method of Determining Moisture Content	301.7 (e)
302.9	In-situ Density / Degree of Compaction	
	(a) Sand Replacement Method	301.8 (a)
	(b) Core Cutter Method	301.8 (b)
	(c) Nuclear Density Gauge	301.8 (c)
302.10	Horizontal Alignment	301.9
302.11	Surface Levels	301.10
302.12	Surface Regularity	301.11

302.7 CBR of Remoulded and Soaked Soil Samples

(Static Method and Dynamic Method)

Purpose

CBR value of a soil is an index which is related to its strength, modulus of subgrade reaction, modulus of resilience and plasticity index. The index is highly dependent on the condition of material at the time of testing.

The test will be performed on remoulded specimens which may be compacted either statically or dynamically.



LABORATORY CBR TEST APPARATUS

Preparation of Specimens

Remoulded Specimens: The dry density for remoulding should be either the field density or if the subgrade is to be compacted, at the maximum dry density value obtained from the Proctor Compaction test. If it is proposed to carry out the CBR test on an unsoaked specimen, the moisture content for remoulding should be the same as the equilibrium moisture content which the soil is likely to reach subsequent to the construction of the road. If it is proposed to carry out the CBR test on a soaked specimen, the moisture content for remoulding should be at the optimum and soaked under water for 96 hours.

Soil Sample – The material used in the remoulded specimen should all pass through a 19 mm IS sieve. Allowance for larger material may be made by replacing it by an equal amount of material which passes a 19 mm sieve but is retained on a 4.75 mm IS sieve. This procedure is not satisfactory if the size of the soil particles is predominantly greater than 19 mm. The specimen may be compacted statically or dynamically.

Procedure

I. Compaction by Static Method

- 1.1 Find the weight of oiled empty CBR mould with base plate and filter paper placed in.
- 1.2 Calculate the weight of soil required at OMC by using the formula:

$$\text{Percentage Compaction Required} \times \text{MDD (g/cc)} \times \left(1 + \frac{\text{OMC}}{100}\right) \times \text{volume of mould}$$

- 1.3 Take about 6 kg of dry soil and mix it thoroughly after adding the quantity of water required to bring it to OMC at which it can be compacted to attain its maximum dry density.

- 1.4 Take the required quantity of this soil as calculated in step 1.2.
- 1.5 Place this soil in the mould and obtain compaction by pressing in the displacer disc, placing a filter paper between the disc and the soil.

2. Compaction by Dynamic Method

- 2.1 Take 6 kg of oven dried soil.
- 2.2 Add water (optimum water content required to attain max. dry density) to it and mix it thoroughly.
- 2.3 Take the empty weight of oiled CBR mould.
- 2.4 Fit the extension collar to the mould.
- 2.5 Place a spacer disc in it and then place one filter paper over it.
- 2.6 Fill the soil mixture in the mould in 3 layers by giving 55 blows of 2.6 kg rammer with a drop of 310 mm to each layer.
- 2.7 Remove the collar and trim off by a straight edge.
- 2.8 Then remove the mould from base plate, take the spacer disc out.
- 2.9 Invert the mould and fix it in position on the base plate after placing a filter paper. The dynamically compacted specimen is now ready for testing.

3. Finding degree of compaction

- 3.1 After compaction, weigh the mould with specimen.
- 3.2 Find the weight of the specimen.
- 3.3 Take a portion of the remaining sample left in the tray and find the moisture content. (As in Test EW-7)
- 3.4 Find the dry density and compare it with the maximum dry density and find the degree of compaction (%) by comparing this with the maximum dry density.

4. Determining Swelling Index

- 4.1 After weighing the moulds, place weights to produce a surcharge equal to the weight of the base material and pavement to the nearest 2.5 kg shall be placed on the compacted soil specimen. Place this assembly in the mould.
- 4.2 Place the tripod having the micrometer in place and adjust the stem to touch the micrometer indicator and find the initial reading on the micrometer.
- 4.3 Then place the mould in water tank and soak it for 96 h.
- 4.4 After 96 h, find the micrometer reading.
- 4.5 Find the difference in readings.
- 4.6 Find the swelling index by dividing the swelling by the height of the specimen before soaking. Express this in percentage. (Form EW-11)

Determining Swelling Index

Mould Nos.	Height of specimen	Dial gauge reading		Least Count of dial gauge	Total Swelling (C-B) x D	Swelling Index $\frac{E \times 100}{A}$
	(mm)	Initial	Final	(mm)	(mm)	(Percent)
	(A)	(B)	(C)	(D)	(E)	

5. Determining CBR

CBR in Dry Condition

The material used for conducting the test will be in a dry condition. The mould containing the specimen with the base plate in position but the top face exposed shall be placed on the lower platen of the testing machine. Surcharge weights, sufficient to produce an intensity of loading equal to the weight of the base material and the pavement shall be placed on the testing machine.

Rest of the procedure will be same as described below for the test in soaked condition

CBR in Soaked Condition

- 5.1 After 96 h of soaking and after measuring the swelling, find the weight of the mould with soaked specimen (to be used for finding degree of compaction after soaking).
- 5.2 Drain the excess water by keeping the specimen vertically or by tilting for 10- 15 min (for sandy specimen no tilting is to be done).
- 5.3 Remove the filter paper on the specimen and keep it in the CBR testing machine to show penetration when the specimen is loaded.
- 5.4 Place the same surcharge weight as used while soaking.
- 5.5 Adjust the penetration measuring micrometer and the platform on which the CBR mould containing the specimen rests, to show penetration when the specimen is loaded.
- 5.6 Start loading the specimen, after adjusting the penetration dial and the proving ring to zero mark.
- 5.7 Note the deflections in the dial gauge of the proving ring for corresponding penetrations as per the requirement. (deflections are noted for penetrations of 0.5, 1.0, 1.5, 2.0, 2.5, 4.0, 5.0, 7.5, 10.0 and 12.5 mm of the plunger).
- 5.8 Plot the deflections against the penetration (in mm) in a semi-log graph. (Alternatively, deflections can be converted into loads and plot penetration versus load).
- 5.9 Find the correction required to be applied for the deflections (when an S-type curve is formed, the lower bend can be avoided by drawing a straight line), see Figure 1.

- 5.10 Correct the deflection by shifting the points actually plotted, (if a correction of 0.5 mm is observed, instead of taking deflection for penetration of 2.5 mm, deflection for 3 mm shall be taken).
- 5.11 Take the deflection for 2.5 mm and, 5 mm (for corrected curves, corrected deflection shall be taken).
- 5.12 Convert these deflections into loads by applying the calibration factors.

Find the CBR values for these penetrations by using the formula.

$$\text{CBR} = \frac{P_T \times 100}{P_s}$$

Where P_T = Load corresponding to the chosen penetration.

P_s = Standard load for the penetration from the table given below.

Table 302.7.1: Standard Loads for the CBR Test

Penetration Depth	Unit Standard Load	Total Standard Load
2.5 mm	70 kg/sqm	1370 kg
5 mm	105 kg/sqm	2055 kg

- 5.14 The higher of the two values is reported as CBR (Form EW-12).

Generally the CBR value at 2.5 mm penetration will be higher than that at 5 mm penetration and in such case, the former shall be taken as the CBR value for design purpose. If the CBR value corresponding to a penetration of 5 mm exceeds that for 2.5 mm, the test shall be repeated. If identical results follow, the CBR corresponding to 5 mm penetration shall be taken for design.

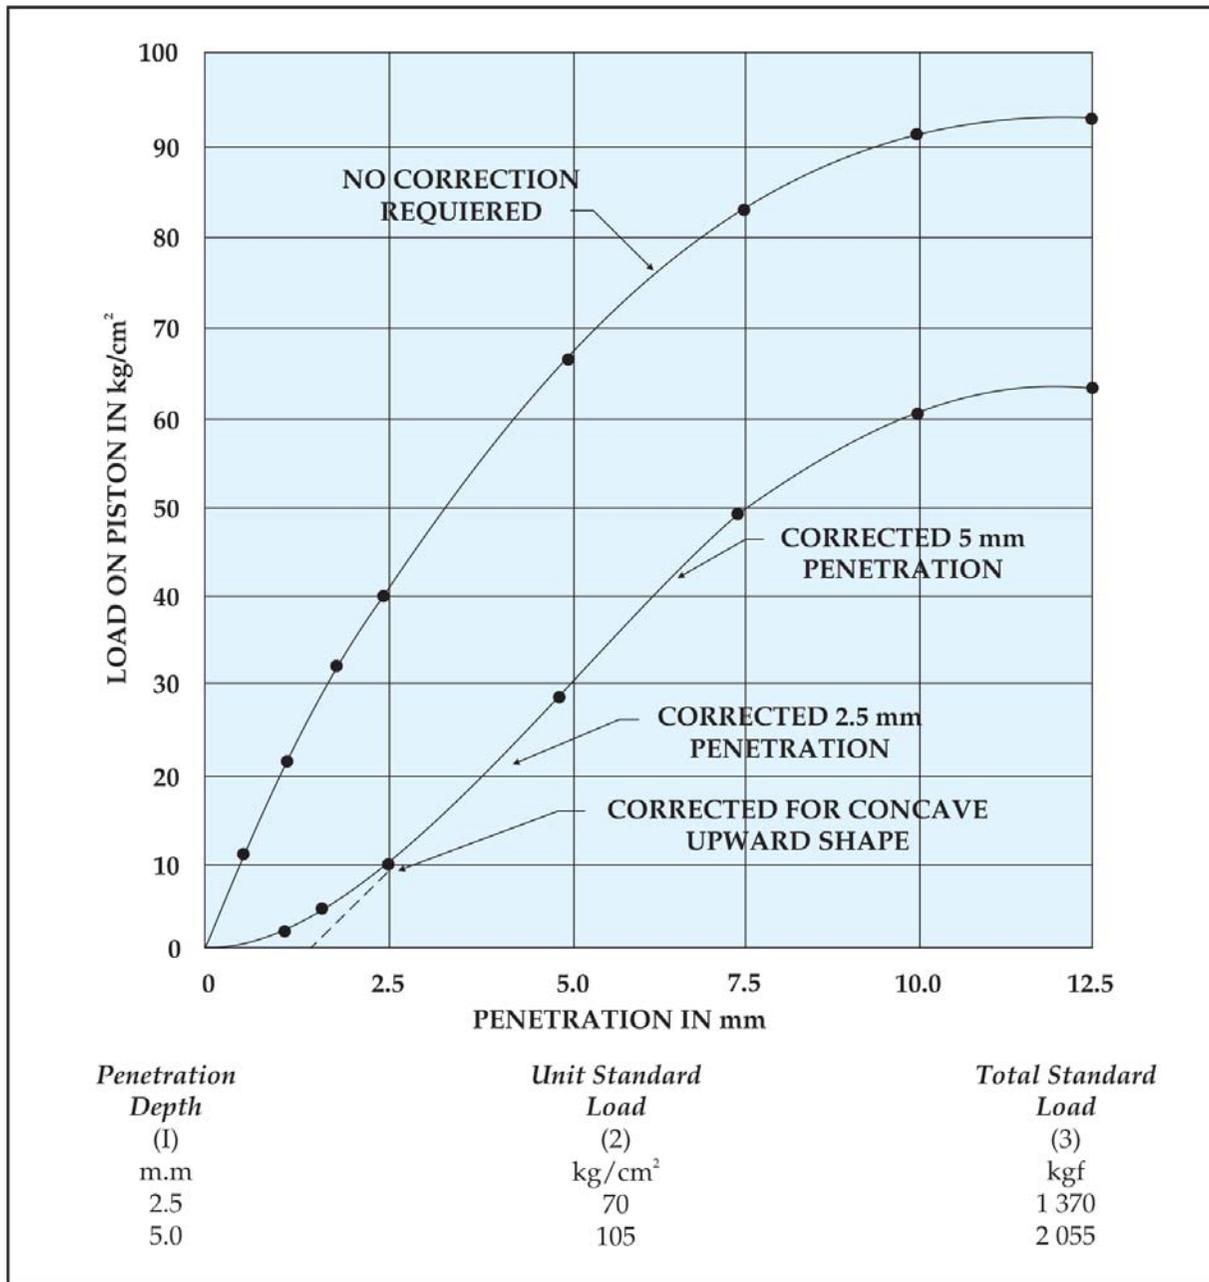


Figure 6 Correlation of Load Penetration Curves

6. Determining degree of compaction after soaking

- 6.1 Before testing itself, the weight of the specimen is noted as explained earlier.
- 6.2 After testing, take a portion of soil from the specimen (top portion where penetration tested) and find the moisture content as explained in test EW-3.
- 6.3 Find the degree of compaction.

CBR Test of Soil

Time of Penetration min - sec	Penetration in mm	Proving Ring ReadingNo. of divisions			Corrected Load (3) x value of one division.In (kN)			Standard Load on Plunger area.(kN) on 19.64cm ²	Unsoaked/ Soaked CBR (%) $\frac{C \times 100}{D}$			Average CBR(%)
		1	2	3	I	II	III		I	II	III	
0- 0	0.0											
0- 24	0.5											
0- 48	1.0											
1- 12	1.5											
1- 36	2.0											
2- 0	2.5							13.43 KN				
2- 24	3.0											
3- 12	4.0											
4- 0	5.0							20.14 KN				
6- 0	7.5							25.78 KN				
8- 0	10.0							31.17 KN				
10- 0	12.5							35.28 KN				

Average CBR at 2.5 mm penetration (%)

Average CBR at 5.0 mm penetration (%)

Average Saturation Moisture Content (%)

Average Swelling (%)

Reference: IS : 2720 (Part – 16) 1987

303 SUBGRADE CONSTRUCTION

Sec No.	Title	Test Ref No.
A) Materials		
303.1	Grain Size Analysis	301.1
303.2	Liquid Limit, Plastic Limit and Plasticity Index	301.2
303.3	Proctor Density	301.3
303.4	Free Swell Index	301.4
303.5	Deleterious Content (Organic Content)	301.5
303.6	Deleterious Content (Soluble Sulphate)	301.6
303.7	CBR of Remoulded and Soaked Samples	302.7
B) Construction & Workmanship		
303.8	Moisture Content of In-situ Soil	
	(a) Oven-drying Method	301.7 (a)
	(b) Sand Bath Method	301.7 (b)
	(c) Alcohol Method	301.7 (c)
	(d) Infrared Lamp Torsion Balance Method	301.7 (d)
	(e) Rapid Method of Determining Moisture Content	301.7 (e)
303.9	In-situ Density / Degree of Compaction	
	(a) Sand Replacement Method	301.8 (a)
	(b) Core Cutter Method	301.8 (b)
	(c) Nuclear Density Gauge	301.8 (c)
303.10	Horizontal Alignment	301.9
303.11	Surface Levels	301.10
303.12	Surface Regularity	301.11

304 ROCK CUTTING

Sec No.	Title	Test Ref No.
Construction & Workmanship		
304.1	Deviations of Pre-Split Face from Plane passing through adjacent holes.	304.1
304.2	Deviation from Drawings	304.2

B Construction & Workmanship

304.1 Deviations of pre-split face from plane passing through adjacent holes

Purpose

The purpose of pre-splitting is to make sure that the rock plane created after blasting is as smooth and free from disturbance as possible.

Procedure

The extent of rock projecting outside the plane shall be measured in the direction perpendicular to the plane.

The maximum projection shall not exceed 300 mm. Also the drains shall not be encroached due to irregular surface of the plane.

304.2 Deviation from Drawings

Purpose

This is to check whether all construction activities at site are carried out as per drawings; issued by a competent authority.

Procedure

All dimensions must be measured at site to check whether all constructions are being carried out as per authorized drawings.

306 Flyash Embankment Construction

Sec No.	Title	Test Ref No.
A) Materials		
306.1	Grain Size Analysis of Flyash	301.1
306.2	Grain Size Analysis of Soil for Cover	301.1
306.3	Liquid Limit and Plastic Limit of Soil for Cover	301.2
306.4	Proctor Density of Fly Ash (Pond Ash)	301.3
306.5	Proctor Density of Soil for Cover	301.3
306.6	Free Swell Index of Soil for Cover	301.4
306.7	Free Swell Index of Subgrade Material	301.4
306.8	Deleterious Content (Organic Matter) of Soil	301.5
306.9	Deleterious Content (Soluble Sulphate) of Soil	301.6
306.10	CBR on Remoulded samples of Soil for Cover	301.7
B) Construction & Workmanship		
306.11	Measurement of Field Density	302.9
306.12	Horizontal Alignment	301.9
306.13	Surface Levels	301.10
306.14	Surface Regularity	301.1

307. Surface Drains

Sec No.	Title	Test Ref No.
307.1	Colour and Size of Bricks	600.1
307.2	Water Absorption of Bricks	600.2
307.3	Efflorescence of Bricks	600.3
307.4	Compressive Strength of Bricks	600.4
Cement for Brick Masonry Drains		
307.5	Initial and Final Setting Time of Cement	600.5
Lime in Lime - Cement Composite Mortar		
307.6	Purity of Lime (Available CaO)	403.1
Sand / Stone Dust / Marble Dust		
307.7	Grain Size Analysis	301.1
307.8	Deleterious Material and Organic Impurities	800.6
Water		
307.9	Suitability of Water for Masonry Work	600.8
Cement and Mortar		
307.11	Consistency of Mortar	600.10
307.12	Water Retentivity of Mortar	600.11
307.13	Compressive Strength of Mortar	600.12
Construction and Workmanship of Masonry Drains		
307.14	Dimensional Tolerances of Bricks	600.1
307.15	Thickness of Joints for General Brick Work - Tolerance	600.13
307.16	Thickness of Joints for Arches - Tolerance	600.14
307.17	Plaster Finish - Tolerance	600.15
Stone Masonry for Drains		
307.18	Cement for Stone Masonry for Drains	800.1, 800.2, 800.3
Sand or Stone Dust or Marble Dust for Stone Masonry for Drains		
307.19	Grain Size Analysis	600.7
Cement Sand Mortar for Stone Masonry for Drains		
307.20	Compressive Strength of Mortar	600.12
307.21	Water Retentivity of Mortar	600.11
Stones for Stone Masonry Drains		
307.22	Dimensional Tolerance of Stones	700.1
307.23	Water Absorption of Stones	700.2
307.24	Consumption of Mortar in Stone Masonry	700.18
307.25	Water Cement Ratio of Mortar	700.12
307.26	Compressive Strength of Stones	700.9

—◆—
SECTION 400

**GRANULAR
CONSTRUCTION**



401 Granular Sub Base

Sec No.	Title	Test Ref No.
A)	Materials	
401.1	Gradation Analysis of GSB Materials(Wet Sieve Analysis)	401.1,301.1
401.2	Liquid Limit and Plastic Limit of Material passing 425Micron size	301.2
401.3	Grading and Plasticity Index Tests on Combined Materials from Different Sources	401.1, 301.1, 301.2
401.4	Proctor Compaction Test	301.3
401.5	Aggregate Impact Value	401.5
401.6	CBR on Representative Sample compacted at 100% Proctor Density	302.7
B)	Construction & Workmanship	
401.7	Wet Sieve Analysis on Combined GSB Material	401.1,301.1
401.8	Liquid Limit and Plastic Limit	301.2
401.9	Placement Moisture Content	301.7
401.10	Compacted Thickness	401.10
401.11	In-situ Density / Degree of Compaction	301.8
401.12	Aggregate Impact Value	401.5
401.13	Horizontal Alignment	301.9
401.14	Surface Levels	301.10
401.15	Surface Regularity	301.11

A Material

401.1 Gradation Analysis of Aggregates

Purpose

A combination of well graded coarse and fine aggregates is essential for producing a durable granular mix for pavement courses.



SIEVES FOR AGGREGATES

Procedure

1. The coarse aggregates used for granular construction are normally of the sizes 80 mm, 40 mm, 20 mm, 10 mm and 4.75 mm. The fractions from 4.75 mm to 150 micron are termed as fine aggregates. The size 4.75 mm is a common size appearing in both the fractions.
2. Grading pattern of aggregates – coarse, fine or combined – is determined by sieving a sample successively through all the sieves mounted one over the other in order of size, with the larger sieve on the top. The material retained on each sieve after shaking, represents the fraction of aggregate coarser than the sieve in question and finer than the sieve above.
3. Sieve analysis gives the gradation and the fineness modulus which is an empirical factor obtained by adding the cumulative percentages of aggregates retained on each of the dividing standard sieves and dividing by 100. The larger the figure, the coarser the material.
4. Bring the sample to an air dry condition either by drying at room temperature or in oven at a temperature of 100°C to 110°C. Take the weight of the sample.
5. Clean all the sieves and sieve the sample successively on the appropriate sieve starting with the largest.
6. Shake each sieve separately over a clean tray.
7. On completion of sieving, note down the weight of the material retained on each sieve.
8. Report the results as percentage by weight of sample passing each of the sieves as shown in Form SB-1

Form SB-1

**Granular Base / Sub Base
Gradation Analysis of Aggregates**

Road / Section Details :

Weight of Sample Taken (g) :

Sample No. :

Date of Testing :

I. S. Sieve * Designation	Wt. of Sample Retained (g)	Percent of Wt. Retained	Cumulative Percent of Wt. Retained (%)	Percentage of Wt. Passing (%)	Permissible Range

401.5 Aggregate Impact Value (Dry and Wet)

Purpose

The purpose of determining the Aggregate Impact Value is to assess its resistance to disintegration against impact loading.

Procedure

1. Take the test sample consisting of aggregates the whole of which passes 12.5 mm IS sieve and is retained on 10 mm IS sieve. Dry the aggregate comprising the test sample in an oven for a period of four hours or till such time that its weight becomes constant at a temperature of 105°C to 110°C. Cool the aggregates.
2. Use the aggregates as obtained above for conducting the test in a dry condition, following the procedure described below. For conducting the test under wet conditions, immerse the oven dried sample in water for 3 days. Surface dry the sample by suitable cloth and follow the procedure described later in this Section.
3. Aggregate shall be filled in the cylindrical measure in 3 layers by tamping each layer by 25 blows. Determine the net weight of aggregate in the measure (W_d). Transfer the sample from the measure to the cup of the aggregate impact testing machine and compact it by tamping 25 times.
4. The hammer is raised to height of 38 cm above the upper surface of the aggregate in the cup and is allowed to fall freely on the specimen.
5. After subjecting the test specimen to 15 blows, the crushed aggregate is sieved on IS 2.36 mm sieve.
6. Weigh the fraction passing through IS 2.36 mm sieve (W_2). Form SB-2

$$7. \text{ Aggregate Impact Value (AIV)} = \frac{W_2}{W_1} \times 100$$



IMPACT TESTER

Aggregate Impact Value (AIV)

Observation	Test Nos.			Average
	1	2	3	
Weight of aggregate sample filling in the cylinder = W_1 (g)				
Weight of aggregate passing 2.36 mm sieve after the test = W_2 (g)				
AIV = $(W_2/W_1) \times 100$				

Note : Permissible Limit Max 50 subbase; 40 base; 30 wearing course.

Reference: IS : 2386 (Part 4) – 1963

Aggregate Impact Value (Wet)

1. Submerge the sample in water for three days. Make it surface dry, and put the sample in the cup of Testing Machine. Fix the cup firmly on position on the base of the machine.
2. Raise the hammer until its full face is 380 mm above the upper surface of aggregate in the cup and allow it to fall freely.
3. Subject the test sample to 15 such blows.
4. Remove the crushed aggregate from the cup and sieve it on 2.36 mm IS sieve. Wash it with water till no further significant amount passes in one minute.
5. Dry the fraction retained on the sieve at 105°C to 110°C and weigh to an accuracy of 0.1 g. Subtract the weight of the portion retained on the sieve (weight B) from the weight of the oven dried sample to get the weight of the portion passing the sieve.
6. Express this weight as the percentage of original weight to get the Aggregate Impact Value as shown below

$$A - B$$

$$\text{Aggregate Impact Value} = \frac{\text{-----}}{A} \times 100$$

A

where A = weight of oven dried sample

B = weight of fraction retained on 2.36 mm IS sieve

Reference IS 5640 - 1970 (Reprinted in 1991)

B Construction & Workmanship

401.10 Compacted Thickness

The thickness of the compacted layer shall be measured at a few places and average taken.

402 GRAVEL/ SOIL AGGREGATE BASE AND SURFACE COURSE

Sec No.	Title	Test Ref No.
A) Materials		
402.1	Gradation Analysis	401.1,301.1
402.2	Aggregate Impact Value (Dry and Wet)	401.5
402.3	Flakiness Index	402.3
402.4	Water Absorption of Aggregates	402.4
402.5	Soundness with Sodium Sulphate	402.5
402.6	Soundness with Magnesium Sulphate	402.6
B) Construction & Workmanship		
402.7	Wet Sieve Analysis on Combined GSB Material	401.1,301.1
402.8	Liquid Limit, Plastic Limit and Plasticity Index	301.2
402.9	Placement Moisture Content	301.7
402.10	Compacted Thickness	401.10
402.11	In-situ Density and Degree of Compaction	301.8
402.12	Aggregate Impact Value	401.5
402.13	Horizontal Alignment	301.9
402.14	Surface Levels	301.10
402.15	Surface Regularity	301.11

402.3 Flakiness Index

Purpose


Use of flaky aggregate results in loss of strength of granular base and surface course.

Procedure

1. The sample is sieved through IS sieve 63, 50, 40, 31.5, 25, 20, 16, 12.5, 10 and 6.3 mm
2. Minimum 200 pieces of each fraction to be tested are taken and weighed (W_1 g).
3. Separate the flaky material by using the standard flakiness gauge.
4. Take the weight of flaky material which passes through standard gauge (W_2 g)

$$5. \text{ Flakiness Index (FI) = } \frac{\text{Weight of material passing the gauge } W_2}{\text{Total weight of sample } W_1} \times 100$$

6. Report the observations in Form GB-1.

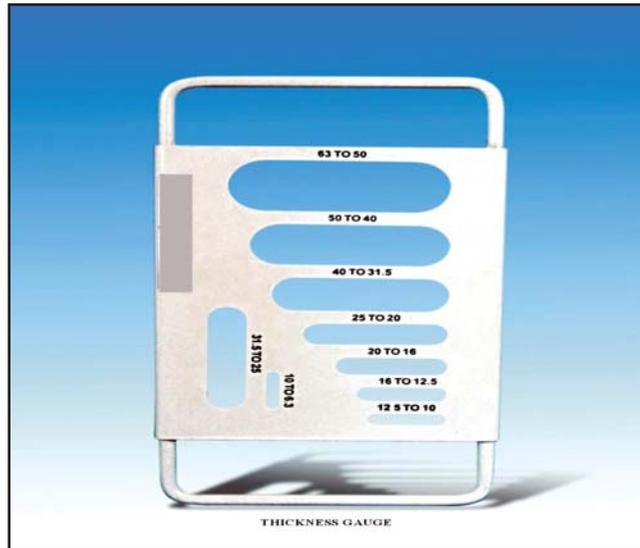

Form GB-1

Flakiness Index of Aggregates

Size of Aggregate		Wt. of the fraction consisting of at least 200 pieces (g)	Thickness gauge size, (0.6 times the mean sieve) (mm)	Weight of aggregate in each fraction passing thickness gauge, (g)
Passing through IS Sieve, (mm)	Retained on IS Sieve (mm)			
63	50	$W_1 =$	33.90	$M_1 =$
50	40	$W_2 =$	27.00	$M_2 =$
40	31.5	$W_3 =$	21.50	$M_3 =$
31.5	25	$W_4 =$	16.25	$M_4 =$
25	20	$W_5 =$	13.50	$M_5 =$
20	16	$W_6 =$	10.80	$M_6 =$
16	12.5	$W_7 =$	8.55	$M_7 =$
12.5	10	$W_8 =$	6.75	$M_8 =$
10	6.3	$W_9 =$	4.89	$M_9 =$
Total		$W =$		$M =$

$$\text{Flakiness Index (F.I.)} = \frac{M}{W} \times 100 = (\%)$$

Note : Permissible Limit Max 30 in sub base, 25 in Base and 20 in Surface Course

Reference: IS : 2386 (Part 1) – 1963

402.4 Water Absorption of Aggregates

Purpose

Water absorption shows the porosity of aggregates in one way. The more, it absorbs, the less it is durable.

Procedure

The test piece about 1 kg shall be washed to remove dust and immersed in distilled water in a glass vessel at a room temperature 20°C to 30°C for 24 h. Soon after immersion and again at the end of the soaking period, entrapped air shall be removed by gentle agitation. This will be done by rapid clockwise and anticlockwise rotation. The vessel shall then be emptied and test piece be allowed to drain. The test piece shall then be placed on a dry cloth and gently surface dried with the cloth. It shall be transferred to a second dry cloth when the first one removes no further moisture. It shall be spread out not more than one stone deep on the second cloth and left exposed to atmosphere away from direct sunlight or any other source of heat for less than 10 min until it appears to be completely surface dry. The sample shall then be weighed (B).

The sample will be dried in an oven at 100 to 110°C for not less than 24 h. It shall then be cooled in a desiccator to room temperature and weighed (A) The water absorption shall be calculated from the formula.

$$\text{Water Absorption} = \frac{(B - A)}{A} \times 100$$

Report the results in the form GB-2

Form GB-2

Water Absorption of Aggregates

S.No.	Specimen No.	Wt of Saturated Surface Dry Sample B (g)	Wt of Oven Dried Sample A (g)	Water Absorption (%) = $\frac{B-A}{A} \times 100$

402.5 Soundness with Sodium Sulphate

Purpose

The test determines the resistance to disintegration of aggregate by saturated solution of Sodium Sulphate. It indicates soundness against weathering action.

Acceptance Criterion

The average loss of weight after 5 cycles should not exceed 12% when tested with sodium sulphate.

Procedure

1. Prepare saturated solutions of Sodium Sulphate by adding sufficient quantities of salt into water at a temperature of 25 to 30°C. The solution may be cooled to $27 \pm 1^\circ\text{C}$. and kept at that temperature at least for 48 h before use.
2. Prepare the samples as given below:

Fine Aggregate

Fine aggregates for the test shall pass through 10 mm IS Sieve. The sample shall be of such a size that it will yield not less than 100g of each of the following sizes, which shall be available in amount of 5% or more expressed in terms of the following sieves:

Passing IS Sieve	Retained on IS Sieve
600 micron	300 micron
1.18 mm	600 micron
2.36 mm	1.18 mm
4.75 mm	2.36 mm
10 mm	4.75 mm

Coarse Aggregate

Coarse Aggregates for the test shall consist of materials from which sizes finer than 4.75 mm have been removed. The sample shall be of such a size that it will yield not less than the following amounts of the different sizes which shall be available in amounts of 5% or more.

Size -Square hole sieve	Yield
10 mm to 4.75 mm	300 g
20 mm to 10 mm	1000 g
Consisting of	
12.5 mm to 10 mm	33 percent
20 mm to 12.5 mm	67 percent
40 mm to 20 mm	1500 g
Consisting of	
25 mm to 20 mm	33 percent
40 mm to 25 mm	67 percent

63 mm to 40 mm	3000 g
Consisting of	
50 mm to 40 mm	50 percent
63 mm to 50 mm	50 percent

80 mm and larger size by 20 mm

Spread in sieve size, each fraction 3000 g.

3. Wash the sample and dry to the constant weight at 105°C to 110°C. Separate into different sizes as shown above by sieving to refusal. Weigh out the samples and keep them in separate containers.
4. Immerse the samples in prepared solutions of sodium sulphate for not less than 16 h and not more than 18 h in such a manner that the solution covers them to a depth of at least 15 mm.
5. Cover the container to reduce evaporation and maintain the solution at a temperature of 27±1°C.
6. Remove the sample after the immersion period and allow it to drain for 15±5 min. Place it in the drying oven at a temperature of 105° to 110°C; and dry it to a constant weight.
7. Repeat a number of cycles and determine the loss of weight of specimen after each cycle in accordance with the procedure given below.
8. After the sodium sulphate solution has been removed, each fraction of the sample shall be dried to constant weight at 105 °C to 110°C and weighed. Fine aggregates shall be sieved over the same sieve on which it was retained before the test, and coarse aggregate over the sieve shown below for the appropriate size of particle.

Size of Aggregate	Sieve used to Determine Loss
63 mm to 40 mm	31.5 mm
40 mm to 20 mm	16 mm
20 mm to 10 mm	8 mm
10 mm to 4.75 mm	4 mm

9. Report percentage loss of weight (Form GB-3)

Soundness with Sodium Sulphate

Sample No.:

Date of Sampling :

Name of Quarry / Location:

Date of Testing :

Type of Reagent Used :

No. of Cycles :

Sieve Size, mm		Grading of Original Sample (%)	Wt. Of each fraction before test (g)	Percentage passing finer sieve after test (actual percent loss)	Weighted average (corrected percentage loss)
Passing	Retained				
1	2	3	4	5	6
60	40				
40	20				
20	10				
10	4.75				
Number of particles coarser than 20mm before test			Number of particles affected, classified as to the number disintegrating, splitting, crumbing, cracking or flanking		
Passing	Retained	Number before test			
40 mm	20 mm				
60 mm	40 mm				

Layer	Value	Permissible Limit
		Maximum 12 percent (Sodium Sulphate Solution in 5 cycles)

Checked by :

Tested by :

402.6 Soundness with Magnesium Sulphate**Purpose**

To see if the aggregate disintegrates by saturated solutions of Magnesium Sulphate. It indicates soundness against weathering action.

Acceptance Criterion

The average loss of weight after 5 cycles should not exceed 18% when tested with magnesium sulphate.

Procedure

1. Prepare the saturated solution of Magnesium Sulphate by adding sufficient quantities of salt into water at a temperature of 25 to 30°C. The solution may be cooled to $27 \pm 1^\circ\text{C}$. and kept at that temperature at least for 48 h before use.
2. Prepare the samples as given below:

Fine Aggregate

Fine aggregates for the test shall pass through 10 mm IS Sieve. The sample shall be of such a size that it will yield not less than 100g of each of the following sizes, which shall be available in amount of 5% or more expressed in terms of the following sieves:

Passing IS Sieve	Retained on IS Sieve
600 micron	300 micron
1.18 mm	600 micron
2.36 mm	1.18 mm
4.75 mm	2.36 mm
10 mm	4.75 mm

Coarse Aggregate

Coarse Aggregate for the test shall consist of materials from which sizes finer than 4.75 mm have been removed. The sample shall be of such a size that it will yield not less than the following amounts of the different sizes which shall be available in amounts of 5% or more.

Size - Square hole sieve	Yield
10 mm to 4.75 mm	300 g
20 mm to 10 mm	1000 g
Consisting of	
12.5 mm to 10 mm	33 percent
20 mm to 12.5 mm	67 percent
40 mm to 20 mm	1500 g
Consisting of	
25 mm to 20 mm	33 percent
40 mm to 25 mm	67 percent
63 mm to 40 mm	3000 g
Consisting of	
50 mm to 40 mm	50 percent
63 mm to 50 mm	50 percent

80 mm and larger size by 20 mm

Spread in sieve size, each fraction 3000 g.

3. Wash the sample and dry to the constant weight at 105°C to 110°C. Separate into different sizes as shown above by sieving to refusal. Weigh out the samples and keep them in separate containers.
4. Immerse the samples in prepared solutions of Magnesium Sulphate for not less than 16 h and not more than 18 h in such a manner that the solution covers them to a depth of atleast 15 mm.
5. Cover the container to reduce evaporation and maintain the solution at a temperature of $27 \pm 1^\circ\text{C}$.

6. Remove the sample after the immersion period and allow it to drain for 15±5 min. Place it in the drying oven at a temperature of 105° to 110°C; and dry it to a constant weight

Repeat a number of cycles and determine the loss of weight of specimen after each cycle in accordance with the procedure given below.

7. After the magnesium sulphate solution has been removed, each fraction of the sample shall be dried to constant weight at 105 °C to 110 °C and weighed. Fine aggregates shall be sieved over the same sieve on which it was retained before the test, and coarse aggregate over the sieve shown below for the appropriate size of particle.

Size of Aggregate	Sieve used to Determine Loss
63 mm to 40 mm	31.5 mm
40 mm to 20 mm	16 mm
20 mm to 10 mm	8 mm
10 mm to 4.75 mm	4 mm

Form GB - 4

Soundness with Magnesium Sulphate

Sample No.:

Date of Sampling :

Name of Quarry / Location:

Date of Testing :

Type of Reagent Used:

No. of Cycles :

Sieve Size, mm		Grading of Original Sample (%)	Wt. Of each fraction before test (g)	Percentage passing finer sieve after test (actual percent loss)	Weighted average (corrected percentage loss)
Passing	Retained				
1	2	3	4	5	6
60	40				
40	20				
20	10				
10	4.75				
Number of particles coarser than 20mm before test			Number of particles affected, classified as to the number disintegrating, splitting, crumbing, cracking or flanking		
Passing	Retained	Number before test			
40 mm	20 mm				
60 mm	40 mm				

Layer	Value	Permissible Limit
		Maximum 18 percent (Magnesium Sulphate Solution in 5 cycles)

Checked by :

Tested by :

403 LIME TREATED SOIL FOR IMPROVED SUBGRADE/ SUB-BASE

Sec No.	Title	Test Ref No.
A) Materials		
403.1	Purity of Lime	403.1
403.2	Determination of Optimum Quantity of Lime	403.2
403.3	Plasticity Index of Lime Treated Soil	301.2
403.4	CBR of Lime Treated Soil	302.7
403.5	Unconfined Compressive Strength of Treated Soil	403.5
B) Construction & Workmanship		
403.6	Pulverisation of Soil Clods	403.6
403.7	Placement Moisture Content	301.7
403.8	Maximum Dry Density and Degree of Compaction	301.8
403.9	Plasticity Index of Lime Treated Soil	301.2
403.10	Unconfined Compressive Strength of Sample extracted from compacted layer	403.5
403.11	Horizontal Alignment	301.9
403.12	Surface Levels	301.10
403.13	Surface Regularity	301.11

403.1 Purity of Lime (Determination of Total Calcium Oxide in Lime)

Purpose

The lime should have a purity of at least 70% by weight of CaO when tested as follows:

Procedure

1. Take one gram of powdered lime, accurately weighed, in a platinum crucible. Place it in an oven maintained at $105 \pm 2^\circ\text{C}$ until, on cooling and weighing, constant mass is obtained.
2. Heat the crucible first gently and then ignite in a muffle furnace at 1000°C . Cool the crucible in a desiccator and weigh to a constant mass.
3. Transfer the ignited lime, to a beaker, add 50 ml of water and mix well, add 10 to 15 ml of concentrated hydrochloric acid, and boil for 15 min. Filter, wash with hot water, ignite and weight to constant mass.
4. To the filtrate, add concentrated hydrochloric acid, if necessary, in sufficient amount to make the total amount equivalent to 10 to 15 ml of concentrated hydrochloric acid. Add a few drops of nitric acid and boil. Dilute to 200-250 ml. Add slight excess of ammonium hydroxide and keep just below the boiling point until the odour of ammonia is barely perceptible. Filter off the iron and aluminium hydroxide while hot, collecting the filtrate in a 250 ml volumetric flask. Wash with hot water. Ignite the residue in a platinum crucible, blast, cool in a desiccators and weigh as aluminium oxide and ferric oxide. Make up the filtrate to 250 ml.

5. Pipette out 50 ml of the filtrate in a beaker and dilute to 100 ml. Heat to boiling and add slowly about 35 ml of boiling ammonium oxalate solution. Continue boiling for 2 or 3 min and allow the precipitated calcium oxalate to settle for half an hour.
6. Filter the precipitated calcium oxalate through filter paper. Wash thoroughly with small portions of dilute ammonium hydroxide (1 N) and then with hot water until the washing do not decolourise a hot dilute potassium permanganate solution in the presence of dilute sulphuric acid.
7. Puncture the filter paper and transfer the precipitate to the beaker already used for precipitation with a fine jet of hot water. Add about 50 ml of dilute sulphuric acid, heat to 60°C and titrate with standard potassium permanganate solution with constant stirring. Towards the end of the titration, introduce the filter paper which was used for filtration into the titration vessel and carry out the titration till the end point is reached.
8. Carry out a blank with all reagents following the procedure as outlined for this method. In the case of magnesium limes, decant through a filter paper, redissolve the calcium oxalate in the beaker and in the filter paper with dilute hydrochloric acid and wash the filter paper four times with hot water and finally with dilute ammonium hydroxide (5 N) in a slight excess and proceed as before. For the second filtration, use the same filter paper as was used before.
9. If it is desired to complete the analysis in as short a time as possible, a portion of 50 ml of the filtrate from the ferric and aluminium oxide determination should be precipitated in the usual way with excess of ammonium oxalate. Boil for about 5 min and let the calcium oxalate settle clear. Decant through a qualitative filter paper and cool the filtrate (with ice water if possible). Add diammonium hydrogen phosphate solution in large excess and 5 to 10 ml of ammonium hydroxide solution. Stir rapidly with rubber 'policeman'. From the amount of precipitate thus formed, one can judge whether the lime contains sufficient magnesium oxide to require a double precipitate or not. For accurate work, if there is more than a slight amount of magnesium oxide, a double precipitation should be carried out, using a fresh 50 ml aliquot.

Calculation

$$\text{Total calcium oxide (as CaO), percent by mass} = \frac{14.02 (V_1 - V_2) N}{M}$$

Where

V_1 = volume, in ml, of standard potassium permanganate solution used for the test;

V_2 = volume, in ml of standard potassium permanganate solution used for the blank;

N = normality of standard potassium permanganate solution; and

M = mass, in g, of the material taken for the test

Reference: IS : 1514 - 1990

403.2 Determination of Optimum Quantity of Lime to Attain the Specified Reduction in PI and \ or to achieve the Specified CBR

Purpose

When clayey soils with high plasticity are treated with lime, the plasticity index is decreased and the soil becomes friable and easy to be pulverised, having less affinity with water. All these modifications are considered desirable for stabilization work.

Procedure

The various factors on which the properties of soil-lime depend are soil type, lime content, compaction, curing and additives, if any. However, there is no standard method of mix design. If lime is used mainly for highly plastic clay, then the lime content may be decided based on lime fixation limit or at a higher value to reduce the plasticity index and swelling values up to the desired limits. Unconfined Compressive Strength Tests may be considered as a criterion for the design of mix. A number of trials may be required to arrive at the optimum proportions.

403.5 Unconfined Compressive Strength of Stabilised Soils

Purpose

Unconfined Compressive Strength of stabilised soil is an indication of the suitability of modified soil.

Section A Test for Fine and Medium Grained Stabilised Soil

Procedure

For the purpose of this test, soils shall be grouped as follows :

- a) Fine Grained Soils – Not less than about 90 percent of the soil passing a 2.36 mm IS Sieve
- b) Medium Grained Soils – Not less than about 90 percent of the soil passing a 20 mm IS Sieve.
- c) Coarse Grained Soils – Not less than about 90 percent of the soil passing a 40 mm IS Sieve.

Tapered Moulds shall be used :

- a. For fine grained soil 100 mm high x 50 mm mean diameter
- b. For medium grained soils 200 mm high x 100 mm mean diameter

Ejecting plungers and displacing collars for use with the above moulds will be used.

The weight of the stabilised soil (W_1) required for moulding into a specimen of the required dry density shall be calculated in accordance with the mould used. In the case of soils stabilised with a solid stabiliser, for example, cement, this weight shall be calculated from the formulae :

For fine grained soils (100 x 50 mm moulds) :

$$W_1 = (V_f + \frac{V_r m}{100}) \gamma_{dg} = (196 + 1.96 m) \gamma_{dg}$$

For medium grained soils (20 mm x 100 mm moulds)

$$W_1 = \left(V_m + \frac{V_m m}{100} \right) \gamma_d g = (1570 + 15.7m) \gamma_d g$$

Where

V = volume of mould for fine grained soil in cm³

m = the moisture content of the soils plus stabiliser in percent

γ_d = density of dry soil plus stabiliser in g/cm³, and

V_m = volume of mould for medium grained soils in cm³.

The appropriate weight of material shall be placed in the mould into which, using a displacing collar, the lower plug has been inserted to a distance of 15 mm. During filling, the stabilised soil shall be tamped gently and uniformly so that the upper plug can be inserted at a distance of 15 mm. The upper plug should be inserted and the mould assembly placed in the compression device or testing machine. After removal of the displacing collars, pressure shall be applied to the plugs until the flanges are in contact with the barrel of the mould. After the pressure has been maintained for about ½ min, the load shall be released and the mould removed from the press. The plugs shall then be removed from the mould. The plunger shall then be inserted into the end of the mould having the smaller diameter and the specimen released from the taper by gentle hammering or pressure. The specimen shall then be removed from the mould and weighed to the nearest 1 g (W_2).

Curing

The specimen shall be completely coated with paraffin wax or other suitable wax or otherwise suitably protected by methods such as wrapping in polyethylene to maintain it at its specified moisture content care being taken not to leave holes in the wax film and to complete the coating as quickly as possible to prevent the absorption of wax, and it shall then be weighed to the nearest 1 g (W_3). It shall subsequently be stored for a period depending on the process and type of stabiliser employed, under conditions in which it is protected from mechanical damage and kept at a temperature of $27 \pm 2^\circ\text{C}$.

After the curing period and before testing, the specimen shall again be weighed to the nearest 1 g (W_4). Any 100 mm high x 50 mm diameter specimen which has lost more than 2 g in weight and any 200 mm high x 100 mm diameter specimen which has lost more than 5g in weight during the curing period shall be discarded.

Test Procedure

After weighing, the wax shall be removed from the end of the specimen and, if desired, from the sides, care being taken to avoid damaging the soil surface.

The length of the specimen (L) shall be measured to the nearest 0.25 mm by means of the callipers, and recorded.

The specimen shall then be placed centrally on the lower platen of the compression testing machine and the load shall be applied to the ends of the specimen. The load shall be applied so that the rate of deformation is uniform, approximately 1.25 mm/min. The maximum load exerted by the machine during the test shall be recorded P kg.

The moisture content shall be determined on a representative sample of fragments taken from the interior of the specimen, and recorded.

Calculations

The unconfined compressive strength (p) of the specimen shall be calculated from the formulae :

- a) for fine grained soils

$$p = P/A_f = P/1963 \text{ MN/m}^2$$

- b) for medium grained soils

$$p = P/A_m = P/7854 \text{ MN/m}^2$$

where

P = maximum recorded load, N

A_f = cross sectional area of specimen for fine grained soils (mm²)

A_m = cross sectional area of specimen for medium grained soils (mm²)

In the case of soils stabilised with solid stabiliser, the weight of the dry solids /cm³ [dry soil plus stabiliser density (•_d)] in the specimen shall be calculated from the formulae :

For fine grained soils

$$\gamma_d = \frac{100 W_2}{A_f L (100 + m)} = \frac{100 W_2}{19.63 L (100 + m)} \text{ g/cm}^3$$

For Medium grained soils

$$\gamma_d = \frac{100 W_2}{A_m L (100 + m)} = \frac{100 W_2}{78.54 L (100 + m)} \text{ g/cm}^3$$

Where

W₂ = weight of specimen before coating with wax in g;

A_f = cross sectional area of specimen for fine grained soils (cm²);

A_m = cross sectional area of specimen for medium grained soils (cm²);

L = length of specimen (cm); and

M = moisture content of the soil plus stabiliser after curing, in percent.

Report

The unconfined compressive strength of the specimen shall be reported as follows :

- Values of compressive strength up to 2 MN/m² (20 kg/cm²) report to the nearest 0.05 MN/m² (0.5 kg/cm²)
- Values of compressive strength above 2 MN/m² (20 kg/cm²) report to the nearest 0.1 MN/m² (1 kg/cm²)

Section B Test for Medium and Coarse Grained Stabilised Soil

For the purpose of this test, soils shall be grouped as follows :

- Fine Grained Soils – Not less than about 90 percent of the soil passing a 2.36 mm IS Sieve
- Medium Grained Soils – Not less than about 90 percent of the soil passing a 20 mm IS Sieve.
- Coarse Grained Soils – Not less than about 90 percent of the soil passing a 40 mm IS Sieve.

Preparation of Specimen

For Specimens Compacted to a Pre-determined Dry Density

Using only material passing the 20 mm IS Test Sieve for medium grained soils, and only material passing the 40 mm IS test sieve for coarse grained soils, the stabilised soil shall be prepared as described in IS : 4332 (Part 2) – 1967.

The weight of the stabilised soil (W_1) required for moulding into a specimen of the required dry density shall be calculated from the formulae :

For soils stabilised with solid stabiliser :

$$W_1 = (V + \frac{m}{100} V) \gamma_d g = (3375 + 33.75m) \gamma_d g$$

Where

V = volume of mould in cm^3

m = the moisture content of the soils plus stabiliser in percent, and

γ_d = density of dry soil plus stabiliser in g/cm^3 ,

The material (W_1) shall be divided into three equal parts by weight. One of the parts shall be placed in an assembled mould and the surface levelled off. Using a tamper fitted with a collar at the 10cm mark and a vibrating hammer, the material shall be compacted uniformly until the collar comes into contact with the upper surface of the mould. The surface of the layer shall be scarified with the palette knife before adding the next layer, which shall be compacted in similar manner to the first layer, but using a tamper fitted with a collar at the 5 cm position. A 150 mm cube mould, less base plate shall then be placed squarely on top of the cube mould, the compacted surface scarified with the palette knife, and the final layer added using the tamper with the collar at the 150 mm position. The upper mould shall then be removed and the surface of the specimen carefully levelled off the end of the mould using the trowel and vibrating tamper, care being taken not to spill any loose material during this final operation. The mould containing the specimen shall then be covered with a metal plate and stored at temperature of $27^\circ\text{C} \pm 2^\circ\text{C}$ until the following day when the specimen shall be removed from the mould for further curing. The specimen shall then be weighed to the nearest 1 g (W_2).

Curing

The curing tin shall be placed over the specimen, and the tin and specimen then inverted. The lid shall then be placed in position and sealed with suitable tape. The tin containing the specimen shall then be weighed to the nearest 1g (W_2). It shall subsequently be stored for a period depending on the process and type of stabiliser employed, at a temperature of $27^\circ\text{C} \pm 2^\circ\text{C}$.

After the curing period, and before testing, the tin containing the specimen shall again be weighed to the nearest 1 g (W_1). Any specimen that has lost more than 10g in weight during the storage period shall be discarded.

Test Procedure

- After weighing, the specimen shall be removed from the tin.
- The specimen shall then be placed centrally on the lower platen of the compression testing machine in such a manner that the load shall be applied to opposite sides of the cube as cast, that is, not to the top and bottom. The load shall be applied without shock and increased continuously at a rate of approximately 35 kgf/cm²/min until the resistance of the cube to the increasing load breaks down and no greater load can be sustained. The maximum load exerted by the machine can be recorded (P kg).
- The moisture content shall be determined on a representative sample of fragments taken from the interior of the specimen and recorded.
- The unconfined compressive strength (p) of the specimen shall be calculated from the formula :

$$p = P/A \text{ MN/ m}^2 = P/22\ 500 \text{ MN/m}^2$$

Where

P = maximum recorded load, N; and

A = area of cross-section of specimen in mm²

In the case of soils stabilised with a solid stabiliser, the weight of dry solids per cubic foot (dry soil plus stabiliser density γ_d) in the specimen shall be calculated from the formula

$$\begin{aligned} \gamma &= \frac{100.W_2}{V(100+m_1)} \text{ g/cm}^3 \\ &= \frac{100.W_2}{3375 (100+m_1)} \text{ g/cm}^3 \end{aligned}$$

Where

W_2 = weight of specimen after removal from the mould in g,

V = volume of mould in cm³, and

m_1 = moisture content of soil plus stabiliser after curing in percent.

Report

The unconfined compressive strength of the specimen shall be reported as follows:

- Values of compressive strength up to 3.5 MN/m² (35 kg/cm²), report to the nearest 0.1 MN/m² (1 kg/cm²).
- Values of compressive strength above 3.5 MN/m² (35 kg/cm²), report to the nearest 0.15 MN/m² (1.5 kg/cm²).

Reference : IS :4332 (Part 5) – 1970

403.6 Pulverisation of Soil Clods

Purpose

Better the pulverisation and degree of mixing, higher is the strength. Presence of unpulverised dry lumps of soil reduces strength and durability of stabilised soil.

Procedure

1. Pulverise the soil using agricultural implements like tractor – towed disc harrows and rotavators to the extent that it passes the requirements given below.

Table 403.6.1 SOIL PULVERISATION REQUIREMENTS FOR LIME STABILISATION

IS Sieve Designation	Minimum per cent by Weight Passing the IS Sieve
26.5 mm	100
5.6 mm	80

2. Take a sample of pulverised soil approximately 1 kg in weight. Weigh it accurately (W_1).
3. Spread it on the 425 micron sieve and shake it gently, Taking care to break the soil lumps as little as possible. Sieve the soil and weigh the soil retained on the sieve (W_2). Break the lumps of finer soil in the retained material until all the individual particles finer than the aperture size of the sieve are separated.
4. Place the soil again on the sieve and shake until sieving is complete. Weigh the retained material on the sieve (W_3).
5. Calculate the per cent soil passing the sieve from the following expression

$$\frac{(W_1 - W_2) \times 100}{(W_1 - W_3)}$$

404 CEMENT TREATED SOIL SUBBASE AND BASE

Sec No.	Title	Test Ref No.
A)	Materials	
404.1	Quality of Cement	801.1 to 801.3
404.2	Purity of Lime	403.1
404.3	Unconfined Compressive Strength Test	403.5
B)	Construction & Workmanship	
404.4	Degree of Compaction	301.8
404.5	Unconfined Compressive Strength	403.5
404.6	Horizontal Alignment	301.9
404.7	Surface Levels	301.10
404.8	Surface Regularity	301.11

405 WATER BOUND MACADAM SUB-BASE / BASE / SURFACING

Sec No.	Title	Test Ref No.
A) Materials		
405.1	Aggregate Impact Value (Dry and Wet)	401.5
405.2	Water Absorption of Aggregates	402.4
405.3	Soundness with Sodium Sulphate	402.5
405.4	Soundness with Magnesium Sulphate	402.6
405.6	Gradation Analysis of Aggregates and Screenings	402.1
405.7	Liquid Limit and Plastic Limit of Binder Material	301.2
B) Construction & Workmanship		
405.8	Grading of Stone Aggregates and Screenings	401.1
405.9	Flakiness Index of Stone Aggregates	402.3
405.10	Plasticity Index of Crushable Screenings/Binding Material	301.2
405.11	Aggregate Impact Value	401.5
405.12	Layer Thickness	402.10
405.13	Volumetric Analysis	405.13
405.14	Horizontal Alignment	301.9
405.15	Surface Levels	301.10
405.16	Surface Regularity	301.11

405.13 Volumetric Analysis

Purpose

The test is conducted to make sure that adequate quantity and composition of material have been used in the construction.

Procedure

1. Dig a pit 0.5 m x 0.5 m in the area where random checking is to be carried out. Take out all the WBM material from the pit. One of the test procedures given below can be used.
2. **Test 1**
 Refill the pit with the dug material without compacting. If the pit can be filled by using not more than 65% of the dug material, it is indicative of adequate compaction and use of specified quantity of all materials combined together.
3. **Test 2**
 - (i) Separate out the portions of the WBM material passing and retained on 11.2 mm size sieve when type B Screenings have been used. When Type A Screenings have been used, the proportions of WBM material passing and retained on 13.2 mm size sieve should be determined.

- (ii) Measure the loose volumes of the two portions using cylinders of known volume and compare the combined volume with the combined specified quantities of Coarse Aggregate + Screenings + Binding Material.
- (iii) The volume of material retained on 11.2 mm size sieve (or 13.2 mm size sieve, as the case may be) shall be compared with the specified quantities of coarse aggregate viz 0.91 to 1.07 cu. M per 10 sq m for WBM gradings 2 and 3. Due allowance shall be made for crushing during rolling.
- (iv) The material passing 11.2 mm size sieve (or 13.2 mm size sieve, as the case may be) shall be compared with the specified quantities of Stone Screenings and Binding Material or Crushable Screenings as the case may be.
- (v) For the Coarse Aggregates, the quantity may be checked by conducting an Aggregate Impact Test and determining the presence of any oversize aggregate.
- (vi) For the finer fractions passing 425 micron size sieve, the Plasticity Index shall be determined to check that it is less than 6.

406 WET MIX MACADAM BASE

Sec No.	Title	Test Ref No.
A) Materials		
406.1	Aggregate Impact Value of Coarse Aggregates	401.5
406.2	Flakiness Index	402.3
406.3	Soundness with Sodium Sulphate	402.5
406.4	Soundness with Magnesium Sulphate	402.6
406.5	Gradation Analysis	401.1
406.6	Liquid Limit and Plastic Limit of Aggregate passing 425 Micron sieve	301.2
406.7	Proctor Compaction Test	301.3
B) Construction & Workmanship		
406.8	Grading Analysis	401.1
406.9	Placement Moisture Content	301.7
406.10	Density of Compacted Layer	301.8
406.11	Horizontal Alignment	301.9
406.12	Surface Levels	301.10
406.13	Surface Regularity	301.11
406.14	Compacted Thickness	401.10
406.15	Aggregate Impact Value	401.5

407 SHOULDER CONSTRUCTION

Sec No.	Title	Test Ref No.
A)	Materials and Workmanship	
407.1	Earthen Shoulders	303
407.2	Hard Shoulders	401
407.3	Brick Edging	600
407.4	Stone Edging	700

408 LOCAL MATERIALS FOR ROAD CONSTRUCTION

Sec No.	Title	Test Ref No.
A)	Materials	
408.1	Aggregate Impact Value (Dry and Wet) of Kankar, Laterite, Dhandla	401.5
408.2	Liquid Limit and Plastic Limit of Naturally Occurring Gravels	301.2
408.3	CBR on Soaked Material for Soil-Gravel Material	302.7
408.4	Gradation Analysis for Soil Gravel Mix	401.1
408.5	Determination of Total Calcium Oxide in Lime	403.1
408.6	Placement Moisture Content	301.7
408.7	Unconfined Compressive Strength	403.5
408.8	Compressive Strength of Cement	800.3
408.9	Setting time of Cement	800.1
408.10	Tests on Water for Use in Cement Stabilisation	600.9
B)	Construction & Workmanship	
408.11	Placement Moisture Content	301.7
408.12	Degree of Compaction	301.8
408.13	Horizontal Alignment	301.9
408.14	Surface Levels	301.10
408.15	Surface Regularity	301.11

409 LIME – FLYASH STABILISED SOIL SUB-BASE

Sec No.	Title	Test Ref No.
A) Materials		
409.1	Fineness of Flyash by Blaine Apparatus	409.1
409.2	Particles Retained on 75 Micron IS Sieve	301.1
409.3	Lime Reactivity	409.3
409.4	Soundness by Autoclave Expansion	409.4
409.5	Soundness by Le Chatelier Method	409.5
409.6	Quality of Water	600.9
B) Construction & Workmanship		
409.7	Unconfined Compressive Strength of Lime-Flyash Mix	403.5
409.8	Horizontal Alignment	301.9
409.9	Surface Levels	301.10
409.10	Surface Regularity	301.11

409.1 Fineness of Cement / Flyash

Purpose

The fineness of cement / flyash has an important bearing on the rate of hydration and hence on the rate of gain of strength and also on the rate of evolution of heat. Finer the cement, faster the gain in strength.



BLAINE'S TEST APPARATUS

Procedure

Two methods are used for the determination of fineness of cement.

Sieve Test

1. Weigh correctly 100g of cement and take it on a standard IS Sieve No.9 (90 micron)
2. Break down the air-set lumps in the sample with fingers.
3. Continuously sieve the sample by giving circular and vertical motions for a period of 15 min. A sieve shaker may also be used.
4. Weigh the residue left on the sieve.
5. This residue should not be more than 10 per cent, for ordinary cement.

Air Permeability Method

1. This method is based on the relationship between the flow of air through the cement bed and the surface area of particles comprising the cement bed. The cement bed is 1cm high and 2.5cm in diameter.
2. Knowing the density of cement, calculate the weight required to make a cement bed of porosity 0.500 (= 0.500 x ρ x V where ñ – density of cement, V – volume). Place this quantity of cement in the permeability cell in a standard manner.
3. Slowly pass on air through the cement bed at a constant velocity against the rate of air flow until flow metre shows a difference in level of 30-50cms.
4. Read the difference in level (h₁) of manometre and the level of the flowmetre. Repeat these observations to ensure that steady conditions have been reached as shown by a constant h₁/h₂ value.
5. Specific surface S_w is calculated as

$$S_w = \frac{K}{\rho} \frac{\sqrt{e^3}}{(1-e)} \frac{\sqrt{t}}{\sqrt{0.1\eta}} \text{ cm}^2/\text{g}$$

Where

- K is the apparatus constant
- e is the porosity of the bed
- t is the measured time (S)
- ρ is the density of cement (g/cm³), and
- η is the viscosity of air at the test temperature

with the specified porosity of e = 0.500, and temperature 27°C +/- 2°C,

$$s = \frac{521.08 k \sqrt{t}}{\rho} \text{ (cm}^2/\text{g)}$$

The Apparatus constant can be determined from the use of Standard Cement as follows:

$$K = \frac{S_o \rho_o (1 - e) \sqrt{0.1 \eta}}{\sqrt{e^3} \sqrt{t_o}}$$

Where

S_o = Specific surface of Standard Cement

ρ_o = Density of Reference Cement

t_o = Mean of three measured time

η_o = Air viscosity at mean of the three temperatures

with $e = 0.500$, the equation reduces to

$$K = 1.414 S_o \rho_o = \frac{\sqrt{0.1} \eta_o}{\sqrt{t_o}}$$

6. The specific surface (sq.cm/g) should not be less than 2250 for Ordinary Cements.

Determination of Fineness of Cement

S.No	Measurement of Time			Average of three values	Calculations
	(1)	(2)	(3)		

Determination of Specific Surface

S.No	Measurement of Time			Average value of time	Calculations $S_w = \frac{521.08 \times k^2 t}{p}$
	(1)	(2)	(3)		

Reference I.S. 4031 (Part2) - 1988

409.3 Lime Reactivity

This method of test covers the procedure for determining the reactivity of the pozzolanic material with hydrated lime, as represented by compressive strength of standard mortar test cubes prepared and tested under specific conditions.

Size and Number of Test Specimens - The tests specimen shall be 50 mm cubes. At least three specimens shall be made for each period of test specified.

Apparatus

Cube Moulds - Mould for the 50 mm cube specimens shall be of metal not attacked by cement-pozzolana or lime-pozzolana mortar and there shall be sufficient strength and stiffness to prevent spreading and wrapping. The moulds shall be rigidly constructed in such a manner as to facilitate the removal of the moulded specimen without damage. The moulds shall be machined so that when assembled ready for use the dimensions and internal faces shall be accurate to the following limits:

The height of the moulds and the distance between the opposite faces shall be 50 ± 0.1 mm for new moulds, and 50 ± 0.5 mm for moulds in use. The angle between adjacent interior faces and between interior faces and top and bottom planes of the mould shall be 90 ± 0.5 degrees. The interior faces of the moulds shall be plane surfaces with a permissible variation of 0.02 mm for new moulds and 0.05 mm for moulds in use. Each mould shall be provided with a base plate having a plane surface machined to a tolerance of 0.1 mm and made of non-absorbent and non-corrodable material. The base plate shall be of such dimensions as to support the mould during the filling without leakage.

Preparation of Moulds - The interior faces of the specimen moulds shall be thinly covered with mineral oil or light cup grease. After assembling the moulds, excessive oil or grease shall be removed from the interior faces and the top and bottom surfaces of each mould. Moulds shall then be set on plane, non-absorbent base plates that have been thinly coated with mineral oil, or light cup grease.

Preparation of Mortar - Clean appliances shall be used for mixing. The temperature of the water and that of the test room at the time when the mixing operation is being performed shall be from $27^{\circ}\text{C} \pm 2^{\circ}\text{C}$

The dry materials of the standard test mortar shall be lime : pozzolana : standard sand in proportion 1 : 2M : 9 by weight blended intimately.

where

$$M = \frac{\text{Specific gravity of pozzolana}}{\text{Specific gravity of lime}}$$

The amount of water for gauging shall be equal to that required to give a flow of 70 ± 5 percent with 10 drops in 6 sec (as determined by the procedure given below)

The following quantities of materials are suggested for preparation of mortar:

150 g	Hydrated lime
300 x Mg	Pozzolana
1350 g	Standard sand

These quantities will suffice for preparing six test specimens.

Determination of Flow

Trial mixing - With dry material as given above, make mortars with different percentages of water until specified flow is obtained. Make each trial with fresh mortar. The mixing shall be done mechanically by means of mixing apparatus. Place the dry paddle and the dry bowl in the mixing position in the mixer. Then introduce the materials for batch into the bowl and mix in the following, manner:

- Place all the mixing water in the bowl.
- Add the pozzolanic mixture to the water, then start the mixer and mix at the slow speed (140 ± 5 rev/min) for 30 sec.
- Add the entire quantity of sand slowly over a period of 30 sec, while mixing at slow speed.
- Stop the mixer, change to medium speed (285 ± 10 rev/min), and, mix for 30 sec.
- Stop the mixer, and let the mortar stand for one and a half min. During the first 15 sec of this interval, quickly scrape down into the batch any mortar that may have collected on the side of the bowl, then for the remainder of this interval, cover that bowl with the lid.
- Finish by mixing for one minute at medium speed (285 ± 10 rev/min).
- In any case requiring a remixing interval, any mortar adhering to the side of the bowl shall be quickly scraped down into a batch with the scraper prior to remixing.

Upon the completion of mixing, the mixing paddle shall be shaken to remove excess mortar into the mixing bowl.

Carefully wipe the flow-table top clean and dry and place the mould at the centre. Place a layer of mortar about 25 mm in thickness in the mould and tamp 20 times with the tamping rod. The tamping pressure shall be first sufficient to ensure uniform filling of the mould. Then fill the mould with mortar and tamp as specified for the first layer. Cut off the mortar to a plane surface flush with the top of the mould by drawing the straight edge of a trowel (held nearly perpendicular to the mould) with a sawing motion across the top of the mould. Wipe the table top clean and dry, particularly taking care to remove any water from around the edge of the flow mould. Lift the mould away from the mortar one minute after completing the mixing operation. Immediately drop the table through a height of 12.5 mm ten times in 6 sec.

The flow is the resulting increase in average base diameter of the mortar mass, measured on at least four diameters at approximately equi-spaced intervals expressed as a percentage of the original base diameter.

The materials for each batch of moulds shall be mixed separately using the quantities of dry materials, conforming to the proportions specified and the quantity of water as determined. Mixing of mortar shall be done mechanically as described.

Moulding Test Specimen - Immediately following the preparation of the mortar place the mortar in a 50 mm cube mould in a layer of about 25 mm thickness and tamp 25 times with the tamping rod. The tamping shall be just sufficient to ensure uniform filling of the mould. Then fill the mould to overflow and tamp as specified for the first layer. On the completion of the tamping, the tops of all cubes shall extend slightly above the tops of the moulds. Cut off the mortar to a plane surface flush with the top of the mould by drawing the straight edge of a trowel (held nearly perpendicular to the mould) with a sawing motion across the top of the mould.

Storage and Curing of Specimens – Cover the surface of the specimen in the mould with a smooth and greased glass plate. Keep the specimens with the moulds along with the cover plates under wet gunny bags for 48 hour. Then remove the specimens from the moulds and cure at 90 to 100 percent relative humidity at $50^{\circ}\text{C} \pm 2^{\circ}\text{C}$ for a period of eight days. Samples shall not be cured under water.

Note - This may be achieved by keeping the specimens in a one liter capacity wide mouth jar with screwed lid over a galvanised iron sheet platform placed at bottom of the jar. The platform is covered with a piece of paper. Water is kept to a depth of about 10 mm at the bottom, below the level of the platform. After placing the specimen fitting the lid, the jar is sealed with insulation tape and kept in an incubator adjusted for $50^{\circ} \pm 2^{\circ}\text{C}$ for eight days.

Procedure for Test - Remove the specimens after curing for eight days in the incubator as described above and test for compressive strength after, they reach the room temperature. Test not less than three cubes. The cubes shall be tested on their sides without any packing between the cube and steel platens on the testing machine. One of the platens shall be carried on a ball and shall be self-adjusting, and the load shall be steadily and uniformly applied, starting from zero and at a rate of $35 \text{ kg/cm}^2/\text{min}$.

Calculation - Calculate the compressive strength from the crushing load and the average area over which the load is applied. Express the result nearest to 1 kg/cm^2 .

Faulty Cubes and Retests - Cubes that are manifestly faulty or that give strength differing by more than 15 percent from the average value of all test specimens, made from the same sample and tested at the same period, shall not be considered in determining the compressive strength. After discarding such cubes, if less than two strength test values are left for determining the compressive strength at any given period, a retest shall be made.

409.4 Soundness by Autoclave Expansion

The test shall be done as specified in 307.5 except that a mixture of pozzolana and cement in the proportion as indicated shall be used in place of cement.

When determining soundness by this method, not less than six specimens shall be tested at a time for arriving at an average result.

Determination of Initial and Final Setting Time

The test for initial and final setting time of pozzolana with lime and cement shall be done in accordance with the requirements of IS: 4031- 1968. except that a mixture of pozzolana and cement in the proportion 0.2N : 0.8 by weight shall be used in place of cement for making the paste.

The determination of standard consistency shall also be carried out in accordance with IS: 4031-1968* using the mixture of pozzolana and cements in the proportion as indicated above instead of cement for making the paste.

Where

$$N = \frac{\text{Specific gravity of pozzolana}}{\text{Specific gravity of cement}}$$

409.5 Soundness by Le Chatelier Method

The test shall be done as specified in IS : 4031-1968, which is same as except that in place of cement, a mixture of pozzolana and cement in the proportion 0.2 N : 0.8 by weight, blended intimately shall be used :

Where

$$N = \frac{\text{Specific gravity of pozzolana}}{\text{Specific gravity of cement}}$$

410 INDUSTRIAL WASTES FOR ROAD CONSTRUCTION

Sec No.	Title	Test Ref No.
A)	Material	
Fly-Ash (Pond Ash) in Embankment Construction		
410.1	Grain Size Analysis of Fly Ash (Pond Ash)	301.1
410.2	Grain Size Analysis of Soil for Cover	301.1
410.3	Liquid Limit and Plastic Limit of Soil for Cover	301.2
410.4	Proctor Density of Fly Ash (Pond Ash)	301.3
410.5	Proctor Density of Soil for Cover	301.3
410.6	Free Swell Index of Soil for Cover	301.4
410.7	Free Swell Index of Subgrade Material	301.4
410.8	Deleterious Content(Organic Matter) of Soil	301.5
410.9	Deleterious Content (Soluble Sulphate) of Soil	301.6
410.10	CBR on Remoulded Samples of Soil for Cover	302.7
Fly Ash in Lime-Fly Ash Stabilised Soil Base		
410.11	Fineness of Flyash by Blaine Apparatus	409.1
410.12	Particles Retained on 75 Micron IS Sieve	301.1
410.13	Lime Reactivity	409.3
410.14	Soundness by Autoclave Expansion	409.4
410.15	Soundness by Le Chatelier Method	409.5
410.16	Quality of Water	600.8
Fly Ash in Lime Fly Ash Bound Macadam		
410.17	Aggregate Impact Value (Dry and Wet)	401.5
410.18	Water Absorption of Aggregates	402.4
410.19	Soundness with Sodium Sulphate	402.5
410.20	Soundness with Magnesium Sulphate	402.6
410.21	Gradation Analysis of Aggregates and Screenings	401.1
410.22	Liquid Limit and Plastic Limit of Binder Material	301.2
410.23	Horizontal Alignment	301.9
410.24	Surface Level	301.10
410.25	Surface Regularity	301.11
Slag in Gravel/Soil-Aggregate Base/Surfacing		
410.26	Gradation Analysis	401.1
410.27	Aggregate Impact Value (Wet)	401.5
410.28	Flakiness Index	402.3
410.29	Water Absorption of Aggregates	402.4
410.30	Soundness with Sodium Sulphate	402.5
410.31	Soundness with Magnesium Sulphate	402.6
Slag in Water Bound Macadam		
410.32	Aggregate Impact Value (Dry and Wet)	401.5
410.33	Water Absorption of Aggregates	402.4

Sec No.	Title	Test Ref No.
410.34	Soundness with Sodium Sulphate	402.5
410.35	Soundness with Magnesium Sulphate	402.6
410.36	Gradation Analysis of Aggregates and Screenings	401.1
410.37	Liquid Limit and Plastic Limit of Binder Material	301.2
	Slag in Cement Treated Sub Base / Base	
410.38	Quality of Cement	800
410.39	Purity of Lime	403.1
410.40	Unconfined Compressive Strength Test	403.5
B	Construction & Workmanship	
410.41	Horizontal Alignment	301.9
410.42	Surface Levels	301.10
410.43	Surface Regularity	301.11

411 CRUSHER RUN MACADAM BASE

Sec No.	Title	Test Ref No.
A)	Materials	
411.1	Aggregate Impact Value	401.5
411.2	Flakiness Index	402.3
411.3	Water Absorption	402.4
411.4	Liquid Limit and Plastic Limit of Material passing 425 Micron	301.2
411.5	Soundness of Crusher Run Macadam Base	402.5, 402.6
411.6	Gradation Analysis	401.1
411.7	Density of Compacted Layer	301.8
B)	Construction & Workmanship	
411.8	Horizontal Alignment	301.9
411.9	Surface Level	301.10
411.10	Surface Regularity	301.11

412 BRICK SOLING

Sec No.	Title	Test Ref No.
A) Materials		
412.1	Size and Colour of Bricks	600.1
412.2	Compressive Strength of Bricks	600.4
412.3	Water Absorption	600.2
412.4	Efflorescence of Bricks	600.3
B) Construction & Workmanship		
412.5	Horizontal Alignment	301.9
412.6	Surface Levels	301.10
412.7	Surface Regularity	301.11

413 STONE SET PAVEMENT

Sec No.	Title	Test Ref No.
A) Materials		
413.1	Aggregate Impact Value	401.5
413.2	Water Absorption	402.4
B) Construction & Workmanship		
413.3	Horizontal Alignment	301.9
413.4	Surface Level	301.10
413.5	Surface Alignment	301.11

—◆—
SECTION 500

**BITUMINOUS
CONSTRUCTION**



501 PREPARATION OF SURFACE

Sec No.	Title	Test Ref No.
A) Materials		
501.1	Crusher Dust passing 4.75 mm size	301.1
501.2	Viscosity of Bitumen Emulsion (Saybolt Furol)	502.2
501.3	Test of Bitumen Emulsion : Residue on 600 micron IS Sieve	502.3
501.4	Storage Stability Test on Emulsion	502.4
501.5	Flash Point of Cutback Bitumen	502.5
501.6	Paving Bitumen	504.1
B) Construction & Workmanship		
501.7	Horizontal Alignment	301.9
501.8	Surface Level	301.10
501.9	Surface Regularity	301.11

502 PRIME COAT OVER GRANULAR BASE

Sec No.	Title	Test Ref No.
A) Materials		
502.1	Slow Setting Emulsion	502.2 to 502.4
502.2	Viscosity of Bitumen Emulsion (Saybolt Furol)	502.2
502.3	Residue of Bitumen Emulsion on 600micron	502.3
502.4	Storage Stability Test	502.4
502.5	Flash Point Test for Bitumen Cutback	502.5
502.6	Viscosity of Bitumen Cutback	502.6
B) Construction & Workmanship		
502.7	Temperature of Binder	502.7
502.8	Rate of Spread of Binder	502.8

A) Materials

502.2 Test for Bitumen Emulsion : Viscosity by Saybolt – Furol Viscometer

Purpose

Viscosity indicates the resistance to flow due to its internal friction. Higher the viscosity lower the rate of flow. The test is conducted to see if it is in the specified range. The Saybolt Furol Viscometer is used for determining the Viscosity. The Test result is expressed in seconds for the flow of 60 cc of the emulsion sample through a 3.8 mm diameter orifice under the specified conditions of the test. Procedure using the special equipment is given below.


Procedure

1. Clean the oil tube with a solvent, such as benzene, and remove excess solvent from the gallery. Pass the entire material through a 150 micron wire strainer before introducing into the oil tube.
2. After the tube is cleaned, pour into the tube a quantity of the material to be tested, sufficient to wet the entire surface of the tube. Allow to drain out.
3. The plunger commonly supplied with the viscometer shall never be used on instruments maintained as standards. Insert the cork stopper not less than 6.0 mm and not more than 9.5 mm into the lower end of the air chamber at the bottom of the oil tube, taking care that the cork fits tightly enough to prevent the escape of air, as tested by the absence of oil on the cork after it is withdrawn.
4. If the test temperature is above that of the room, heat the material to not more than 1.5°C below the temperature of test.
5. Pour the material into the oil tube until it ceases to overflow into the gallery. Keep it well stirred with the oil tube thermometer, care being taken to avoid touching the outflow tube. Adjust the bath temperature until the temperature of the material remains constant.
6. After thermal equilibrium has been attained, no further adjustment shall be made in the bath temperature. The test results shall be discarded if the indicated bath temperature varies by more than $\pm 0.03^\circ\text{C}$.
7. After the temperature of the material in the oil tube has remained constant within $+0.02^\circ\text{C}$ of the desired temperature for one minute with constant stirring, withdraw the oil tube thermometer and remove the surplus liquid quickly from the gallery by means of the withdrawal tube so that the level of the material in the gallery is below the level in the oil tube proper. Insert the tip of the withdrawal tube at one point in the gallery.
8. The test shall be started over again if the tip of the withdrawal tube touches the overflow rim. Under no condition shall the excess liquid be removed by rotating the withdrawal tube around the gallery.
9. Place the receiving flask in position so that the stream of liquid from outlet tube strikes the neck of the flask, care being taken that the graduation mark on the receiving flask is not less than 10cm, not more than 13cm, from the bottom of the bath. Snap the cork from its position and at the same instant start the timer. Stop the timer when the bottom of the meniscus of the liquid reaches the mark on the neck of the receiving flask.
10. Time in seconds as determined by the prescribed procedure, with the proper calibration correction, is the Saybolt Furol viscosity of the material at the temperature at which the test is made.
11. Report the results to the nearest 0.1 second for viscosity values below 200 seconds and to the nearest whole second for values 200 seconds or above.

Requirement Criterion

Type of Emulsion	Acceptance Limits at 50°C
Rapid Setting (RS-1)	20-100
Rapid Setting (RS-2)	100-300
Medium Setting (MS)	50-400
Slow Setting (SS-1)	20-100
Slow Setting (SS-2)	30-150

Reference : IS 3117 - 1965 (Appendix A) and IS 8887 - 2004

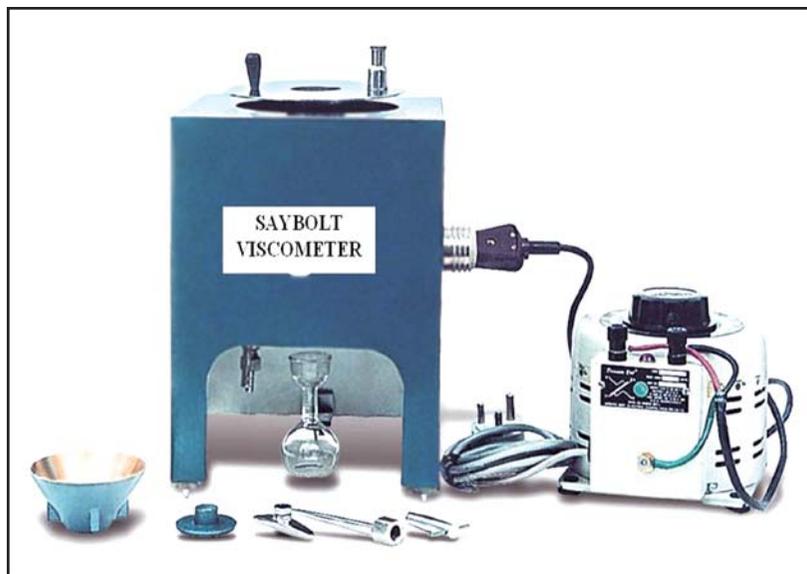

Saybolt Furol Viscometer

502.3 Residue of Bitumen Emulsion on 600 Micron Sieve

Purpose

Three tests are required to assess the suitability of Bituminous material for road construction work.

Procedure

1. Wash the 600 micron IS sieve with xylene and then acetone. Place it in the dish, dry in the oven at 100°C to 110°C for one hour, cool and weigh, together with the dish, to the nearest 0.01g (W_1).
2. Remove the sieve from the dish and moisten with the solution. Remove uniformly the 4-litre sample by gentle agitation and strain immediately through the sieve into the clean, dry weighed container (W_4).
3. Sieve the low and high viscosity emulsion at room temperature and 50 °C respectively. When whole of the emulsion has passed through the sieve, remove the sieve and weigh the container to the nearest 1 g (W_2).

4. Wash the sieve repeatedly with distilled water until the washings run clear. Place the sieve in the small dish to dry for two hours in the oven at $105 \pm 5^\circ\text{C}$. Cool and reweigh together to nearest 0.01 g (W_3).

Calculate the Residue as follows:

$$\text{Residue, percentage retained} = \frac{W_3 - W_1}{W_2 - W_4} \times 100$$

where

- W_1 = mass in g, of sieve and small dish
 W_2 = mass in g, of container and emulsion
 W_3 = mass in g, of sieve, small dish and residue; and
 W_4 = mass in g, of container

Take the average of three values obtained for residue, percent.

Requirement Criterion

Residue on 600 micron IS sieve (percentage by mass, max)	Type of Emulsion				
	RS-1	RS-2	MS	SS-1	SS-2
	0.05	0.05	0.05	0.05	0.05

Reference IS 8887 - 2004

502.4 Storage Stability Test on Emulsions

Purpose

This test is used to determine the ability of an emulsion to remain as a uniform dispersion during storage

Procedure

- Place 500 ml of emulsion sample in each of the two cylinders.
- Stopper the cylinders and allow them to stand undisturbed for 24 h.
- About 55 ml is siphoned from the top and placed in oven for about 2 h at a temperature of $163^\circ\text{C} \pm 2.8^\circ\text{C}$.
- They are removed, allowed to cool and weighed.
- After removal of the top sample, another 390 ml is siphoned off from each of the cylinders. Weigh about 50 g and place in oven for about 2 h at a temperature of $163^\circ\text{C} \pm 2.8^\circ\text{C}$.
- Remove the samples from the oven, allow the sample to cool and weigh.
- The storage stability is expressed as the numerical difference between the average percentage of bituminous residue found in two top samples and two bottom samples (Form BC-1).

Storage Stability Test

Sample No.	Percentage of residue from top sample (A)	Percentage of residue from bottom sample (B)	Settlement (B-A)
1			
2			
Average			

Requirement Criterion

	Grade of Emulsion				
Storage Stability after 24 h, percent, <i>Max</i> ,	2	1	1	2	2
	0.05	0.05	0.05	0.05	0.05

Reference: IS : 8887-2004

502.5 Flash Point Test of Bitumen Cutback

Purpose

The **flash point** of bitumen that contains a volatile distillate is the temperature at which it begins to give off ignitable vapour. The principal purpose of flash-point testing is to determine maximum safe mixing and applying temperatures.

Procedure

- Clean and dry all parts of the cup and its accessories thoroughly before conducting the test. Take particular care to avoid the presence of any solvent used to clean the apparatus after a previous test.
- Fill bitumen into the cup up to the indicated mark.
- Place the lid and set in the stove to heat the bitumen.
- Insert the thermometer.
- Apply heat at 5° - 6°C per minute.
- Stir at the rate of 60 rpm.
- First apply the test flame at a temperature at least 17°C below the actual flash point and then at interval of 1°C to 3°C.
- Discontinue the stirring during the application of test flame.
- Record the temperature reading on the thermometer at the time of the flame application which causes a bright flash to give the flash point of bitumen (Form BC - 2).

Flash point of Bitumen

Sample No.	Flash Point °C	Corrected flash point

Requirement Criterion


Type of Cutback Bitumen Medium Curing	Flash Point Pensky Martens Closed Type (minimum)
MC 30	38
MC 70	38
MC 250	65

Reference IS 217 - 2004

502.6 Viscosity of Bitumen Cutback (Kinematic Viscosity)

Purpose

Kinematic Viscosity of Bitumen Cutback is determined to ascertain its suitability as a construction material for roads.

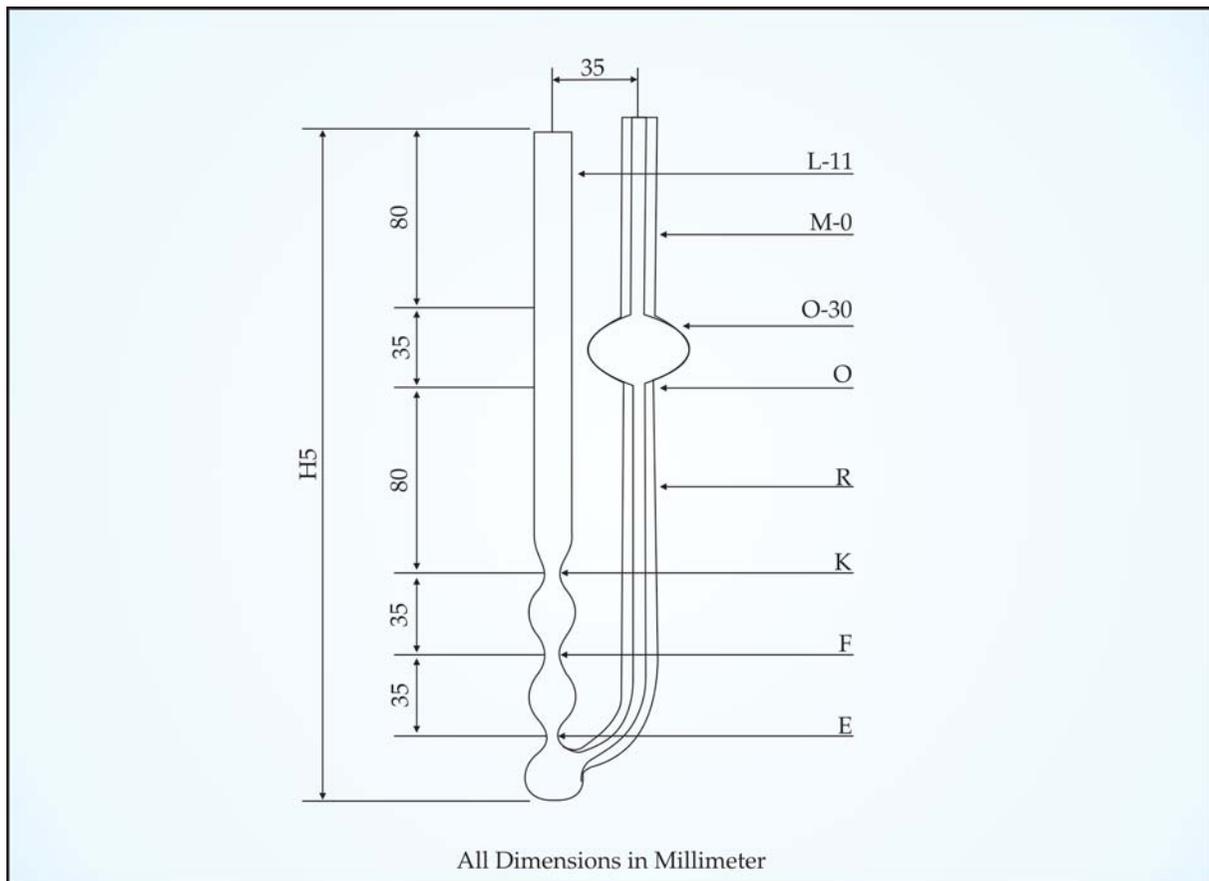

Procedure

1. Capillary type of Viscometers either Cannon-Fenske Viscometer (for opaque liquids) or BS U-Tube Modified Reverse Flow Viscometer shall be used for the test.
2. To calibrate, charge the clean dry viscometer by pouring the reference material. Place the charged viscometer in the viscometer bath long enough to reach the test temperature. Measure to within 0.1s the time required for the leading edge of the meniscus to pass from the first timing mark to the second. Calculate the Viscometer constant as follows :

$$C = V / t$$

Where

V = viscosity in centistokes for the standard liquid, and

t = efflux time in seconds

Procedure for Cannon-Fenske Viscometer

3. Charge the Cannon-Fenske Viscometer by inverting it and applying suction to the tube L immersing tube N in the liquid sample. Draw liquid through the tube N filling bulbs D to the fill mark G. Wipe excess sample off the tube N and invert the viscometer to its normal position.
4. Align the viscometer vertically in the bath. Visual observation for this purpose is sufficient, however, it can be done more accurately and quickly by suspending a plumb bulb in the tube L.
5. Allow the viscometer to remain in the constant temperature bath for a sufficient time to ensure that the sample reaches temperature equilibrium. It takes about 20 min. at 38°C, 25 min at 100°C and 30 min at 135°C.
6. When the test temperature is reached, remove the stoppers in the tubes N and L respectively and allow the sample to flow by gravity. Measure to the nearest 0.1 s the time required for the leading edge of the meniscus to pass from timing mark E to timing mark F. If this efflux time is less than 60 s select a viscometer of smaller capillary diameter and repeat the operation.
7. Upon completion of the test, clean the viscometer thoroughly by several rinsings with an appropriate solvent completely miscible with the sample, followed by a completely volatile solvent. Dry the tube by passing a slow stream of filtered dried air through the capillary for 2min or until last trace of solvent is removed.

Procedure for BS U-Tube Modified Reverse Flow Viscometer

1. Mount the BS U-Tube viscometer in the constant temperature bath keeping tube L vertical. pour sample through the tube N to a point just above filling mark G. Allow the sample to flow through capillary R, taking care that the liquid column remains unbroken until the lower mark H and then arrest its flow by closing the timing tube with a cork or rubber stopper in tube L. Add more liquid, if necessary, to bring the upper meniscus slightly above mark G.
2. After allowing the sample to attain bath temperature and any air bubble to rise to the surface (usually 20-30 minutes are required), gently loosen the stopper allowing the sample to flow until it is approximately at the lower filling mark H and press back the stopper to arrest the flow.
3. Remove the excess sample above filling mark G by inserting the special pipette until its cork rests on top of the tube N and apply gentle suction until air is drawn through. The upper meniscus shall coincide with the mark G. Allow the viscometer to remain in the constant temperature bath for a sufficient time to ensure that the sample reaches temperature equilibrium. It takes about 20 min at 38 °C, 25 min at 100 °C and 30 min at 135 °C
4. Remove the stopper in the tube N and L respectively and allow the sample to flow by gravity. Measure to the nearest 0.1 s the time required for the leading edge of the meniscus to pass from timing mark E to timing mark F. If this efflux time is less 60 s, select a viscometer of smaller diameter and repeat the operation.
5. Upon completion of the test, clean the viscometer thoroughly, following the procedure described earlier.
6. Calculate the kinematic viscosity up to three significant figures with the help of the following equation :

$$\text{Kinematic viscosity cSt} = Ct$$

where

C = calibration constant of the viscometer in centistokes per second, and

t = efflux time in seconds

Requirement Criterion

Type of Cutback Bitumen	Kinematic Viscosity at 60°C, cSt	
	<i>Min</i>	<i>Max</i>
Medium Curing		
MC 30	30	60
MC 70	70	140
MC 250	250	500

Reference IS : 1206 (Part 3) - 1978

B) Construction & Workmanship

502.7 Temperature of Binder

Temperature of binder shall be measured by using metallic contact thermometer with digital display to ensure that it has been heated to the required extent. The range of thermometer for different type of bituminous materials and their accuracy shall be as under,

- (1) Melted Bitumen : ambient to 200°C accuracy $\pm 1.0^\circ\text{C}$
- (2) Cutback Bitumen : ambient to 100°C, accuracy $+ 0.5^\circ\text{C}$
- (3) Bitumen Emulsion : ambient to 80°C, accuracy $+ 0.5^\circ\text{C}$

Form BC-3

Determination of Temperature of Binder

Sl.No.	Time	Temperature	Range and Least Count of Thermometer

Acceptance Limit : As per Contract Document

502.8 Rate of Spread of Binder

Purpose

The test gives a measure of variation in rate of spread of bitumen along the road and a good approximation to the average rate of spread of bitumen.

Procedure

- 1. Take light metal trays of 20cm x 20cm size and 3cm depth. Put a thick paper in the bottom of all the trays to save them from bitumen sticking . Place them along the road in the path of the bitumen distributor between the wheel tracks.
- 2. After the distributor has passed over, remove the trays and wrap them in sheets of paper so that they can be handled, stocked and weighed as soon as convenient.
- 3. Use at least five trays, suiting conditions at site.
- 4. Weigh the trays correctly to the first decimal place.
- 5. The maximum longitudinal distribution error in rate of spread of bitumen should be within ± 10 percent of the specified rate of spread of bitumen.

6. Similarly check the transverse distribution by placing a number of trays to collect bitumen sprayed over each 5cm width of spray bar. The variation in transverse distribution should be within ± 20 percent from the mean.
7. Do not take the extreme 15 cm width on either side into account.
8. Record the results in Form BC – 4.

Form BC-4

Rate of Spread of Binder

Tray No.	Wt. of Bitumen on tray	Rate of spread

503 TACK COAT

Sec No.	Title	Test Ref No.
A) Materials		
503.1	Rapid Setting Emulsion	502.2 to 502.4
503.2	Viscosity of Bitumen Emulsion (Using Saybolt – Furol Viscometer)	502.2
503.3	Residue (Bitumen Emulsion) on 600 Micron IS Sieve	502.3
503.4	Storage Stability Tests	502.4
503.5	Flash Point Test for Bitumen Cutback	502.5
503.6	Viscosity of Bitumen Cutback	502.6
B) Construction & Workmanship		
503.7	Temperature of Binder	502.7
503.8	Rate of Spread of Binder	502.8

504 BITUMINOUS MACADAM

Sec No.	Title	Test Ref No.
A) Materials		
504.1	Quality of Binder – Straight –run Bitumen	504.1
504.1(a)	Penetration Test	504.1(a)
504.1 (b)	R&B Softening Point	504.1 (b)
504.1 (c)	Ductility of Bitumen	504.1 (c)
504.2	Quality of Binder – Modified Bitumen	504.2
504.2 (a)	Penetration Test	504.2 (a)
504.2 (b)	R&B Softening Point	504.2 (b)
504.2 (c)	Elastic Recovery Test	504.2 (c)
504.2 (d)	Separation Test	504.2 (d)
504.3	Aggregate Impact Value	401.5
504.4	Flakiness Index Test	402.3
504.5	Bituminous Stripping of Aggregate Test	504.5
504.6	Water Absorption of Aggregates	402.4
504.7	Soundness with Sodium Sulphate	402.5
504.8	Soundness with Magnesium Sulphate	402.6
B) Construction & Workmanship		
504.9	Grading of Aggregates	401.1
504.10	Binder Content	504.10
504.11	Density of Compacted Layer	301.8
504.12	Temperature of Binder before Mixing	502.7
504.13	Temperature of mix during Laying and Compaction	502.7
504.14	Thickness of Compacted Layer	401.10
504.15	Horizontal Alignment	301.9
504.16	Surface Level	301.10
504.17	Surface Regularity	301.11

A) Materials

504.1 Quality of Binder – Straight-run Bitumen

504.1 (a) Penetration Test

Purpose

Penetration is the consistency test used to designate grades of Bitumen. The greater the penetration, the softer the material.

Procedure

1. Heat the bitumen to softening point + 90°C.
2. Pour the bitumen into the container at least 10 mm above the expected penetration.
3. Allow the sample containers to cool in atmospheric temperature for one hour.

4. Place the sample containers in temperature controlled water bath at a temperature of $25.0^{\circ}\text{C} \pm 0.1^{\circ}\text{C}$ for a period of one hour.
5. Fill the transfer dish with water from water bath to cover the container completely.
6. Take off the sample container from the water bath, place in the transfer dish and place under the needle of penetrometer.
7. Adjust the needle to make contact with surface of the sample.
8. See the dial reading and release the needle exactly for 5 s
Note the final reading.

The difference between the initial and final readings is taken as the penetration value in one tenth of mm. (Form BC-5)

Form BC-5

Penetration of Bitumen

1.	Pouring Temperature, °C							
2.	Period of cooling in atmosphere, min							
3.	Room Temperature, °C							
4.	Period of cooling in water bath, min							
5.	Actual test temperature, °C							
Penetrometer dial reading	Sample No.				Sample No.			
	Test 1	Test 2	Test 3	Mean value	Test 1	Test 2	Test 3	Mean value
Initial								
Final								
Penetration value								
Mean penetration value								

Reference : IS 1203 - 1978

504.1 (b) R&B Softening Point Test

Purpose

Softening point is the temperature measured in °C at which a bituminous binder attains a particular degree of softness under specified test conditions. It signifies the temperature at which bitumen passes from semi solid state to liquid state and indicates the atmospheric temperature at which the bitumen is likely to bleed.



Ring and Ball Apparatus

Procedure

1. Heat the bitumen to a temperature between 75°C and 100°C above its softening point, stir until it is completely fluid and free from air bubbles and water, and filter, if necessary, through IS Sieve 30 (see IS : 460-1962).
2. Heat the rings at same temperature on a hot plate and place it on a glass plate coated with equal parts of glycerine and dextrine.
3. Fill up the rings with bitumen.
4. Cool it for 30 min in air and level the surface with a hot knife.
5. Set the ring in the assembly and place it in the bath containing distilled water at 5°C and maintain that temperature for 15 min.
6. Place the balls on the rings and raise the temperature uniformly at $\pm 0.5^\circ\text{C}$ per minute till the material softens and ball passes through the ring.
7. Note the temperature at which each of the ball and sample touches the bottom plate of the Support.
8. Temperature shall be recorded as the softening point of the bitumen (Form BC – 6).
9. In case, the softening point is above 80°C, use glycerine in place of water in the bath and start the test at a temperature of 35°C.

Softening Point of Bitumen

Grade of bitumen	
Approximate softening point	
Liquid used in water bath (water/glycerine)	
Period of air cooling (min)	
Period of cooling in water bath (min)	

Test Property	Sample No.1 Ball No.		Sample No.2 Ball No.	
	Temperature at which sample touches bottom plate (°C)	1	2	1
Mean Value, softening point				

Reference : IS : 1205-1978

504.1 (c) Ductility Test

Purpose

Ductility indicates the amount of stretch that the bitumen will undergo without breaking. It signifies the property by virtue of which bitumen can exist in a thin film without breaking.

Procedure

1. The bitumen sample is melted to a temperature of 75°C to 100°C above the approximate softening point until it becomes thoroughly fluid.
2. It is strained through IS sieve 30 (see US: 460-1962), poured in the mould assembly and placed on a brass plate, after a solution of glycerine and dextrine is applied at all surfaces of the mould exposed to bitumen.
3. Thirty to forty min after the sample is poured into the moulds, the plate Assembly along with the sample is placed in water bath maintained at 27.0°C ± 0.5°C for 30 min.



Ductility Test Apparatus

4. The sample and mould assembly are removed from water bath and excess bitumen material is cut off by levelling the surface using hot knife.
5. After trimming the specimen, the mould assembly containing sample is replaced in water bath maintained at $27.0^{\circ}\text{C} \pm 0.5^{\circ}\text{C}$ for 85 to 95 min.
6. The sides of the mould are then removed and the clips are carefully hooked on the machine without causing any initial strain.
7. The pointer is set to read zero.
8. The machine is started and the two clips are thus pulled apart horizontally.
9. While the test is in operation, it is checked whether water in the tank of the testing machine covers the specimen both above and below it by at least 25 mm and is maintained continuously within $\pm 0.5^{\circ}\text{C}$ of the specified temperature.
10. The distance at which the bitumen thread breaks is recorded (in cm) and reported as ductility value (Form BC - 7).

Form BC- 7

Ductility of Bitumen

1	Grade of Bitumen				
2	Pouring temperature, $^{\circ}\text{C}$				
3	Test temperature, $^{\circ}\text{C}$				
4	Period of cooling, (min)				
4.1	In Air				
4.2	In water bath before trimming				
4.3	In water bath after trimming				
Test Property		Briquette Number			Mean Value
		(a)	(b)	(c)	
Ductility value (cm)					

Reference: IS: 1208-1978

504.2 Quality of Binder – Modified Bitumen

(a) Penetration Test

The test will be conducted as per the procedure described in 504.1 (a)

Reference IS 15462 - 2004

504.2 (b) R&B Softening Point

The test will be conducted as per the procedure given in 504.1 (b)

Reference IS : 15462 - 2004

504.2 (c) Elastic Recovery Test**Purpose**

The test is conducted to find out the property which indicates its elastic recovery after a stretch.

Procedure

1. Prepare three test specimens and condition it at a temperature of 15°C.
2. Elongate the test specimen to 10 cm in the ductility machine at the rate of 5 ± 0.25 cm per minute.
3. Immediately cut the test specimen into two halves at the mid point using Scissors.
4. Keep the test specimen in water bath in an undisturbed condition for one hour.
5. After one hour, move the elongated half of the test specimen back into position near the fixed half of the test specimen so that the two pieces of modified bitumen just touch.
6. Record the length of the recombined specimen as X
7. Calculate the per cent elastic recovery as under

$$\text{Elastic Recovery (\%)} = \frac{10 - X}{10} \times 100$$

Form BC-8

Elastic Recovery Test

Sample No.	Length of recombined Specimen after 1 hour	Elastic Recovery $\frac{10 - X}{10} \times 100$

Reference IS 15462 – 2004

504.2 (d) Separation Test**Purpose**

The separation of modifier and bitumen during hot storage is a property that indicates how long will it take to separate and thus controls the laying operations

Procedure

1. The separation is evaluated by comparing the ring and ball softening point of the top and bottom samples taken from a conditioned, sealed tube of polymer modified bitumen.
2. Place the empty tube, with sealed end down in the rack Heat the sample carefully until sufficiently fluid to pour.

3. Pass the molten sample through IS Sieve of 600 micron mesh size. After thorough stirring, pour 50.0 g into the vertically held tube. Fold the excess tube over two times and crimp and seal.
4. Place the rack containing the sealed tubes in a $163 \pm 5^{\circ}\text{C}$ oven. Allow the tubes to stand undisturbed in the oven for a period of 24 ± 4 h. At the end of the period, remove the rack from the oven and place immediately in the freezer at $6.7 \pm 5^{\circ}\text{C}$, taking care to keep the tubes in a vertical position at all the times. Leave the tubes in the freezer for a minimum of 4 h to solidify the sample completely.
5. Upon removing the tube from the freezer, place it on a flat surface. Cut the tube into three equal length portions with the spatula and hammer. Discard the centre section, and place the top and bottom portions of the tube into separate beakers. Place the beakers into a $163 \pm 5^{\circ}\text{C}$ oven until the bitumen is sufficiently fluid to remove the pieces of aluminium tube.
6. After thoroughly stirring, pour the top bottom samples into appropriately marked ring and ball softening point test. Prepare the rings and apparatus according to the test procedure given in 504.1(b). The top and bottom sample from the same tube should be tested at the same time in the softening point test.
7. Report the difference, in $^{\circ}\text{C}$, between the softening points of the respective top and bottom samples.

Reference : IS 15462 - 2004

504.5 Bituminous Stripping of Aggregates Test

Purpose

The stripping value indicates the property of adhesion of aggregates with different types of bituminous binders so that the suitability of aggregates could be ascertained.

Procedure

1. Take about 200g of aggregates passing 20 mm sieve and retained on 12.5 mm sieve.
2. Dry, clean and mix with 5 percent binder by weight in a small casserole, binder being heated previously to 160°C if bitumen and 110°C if tar.
3. Heat the aggregate before mixing to a temperature of 150°C and 100°C if these are to be mixed with bitumen and tar respectively.
4. Transfer the contents to a 500 ml beaker after complete coating of the mixture and allow to cool at the room temperature for about two h.
5. Cover the beaker and keep it in a water bath taking care that the level of water in water bath comes upto at least half the height of beaker.
6. Take out the beaker after 24 h, cool it at room temperature and estimate the extent of stripping visually when the specimen is still under water.
7. Calculate the stripping value as the ratio of uncovered area to the total area expressed as a percentage.
8. Conduct three tests and express the mean of three results to the nearest whole number as the stripping value. (Form BC – 9)

Stripping Test of Aggregate

Type of Aggregate		
Type of Binder		
Percentage of Binder Used		
Total Weight of Aggregate		
Total Weight of Binder		
Temp. of Water Bath		
No. of Observations	Stripping (%)	
1.		
2.		
3.		
Average Value		

Reference: IS : 6241-1971

504.10 Binder Content

Purpose

The test determines the bitumen content in the bituminous mix by cold solvent extraction.



Centrifuge Apparatus

Procedure

1. Take a representative sample of about 500 g, weigh it exactly and place it in the bowl of the extraction apparatus (W₁).
2. Cover the sample with commercial grade trichloroethylene.
3. Let the mixture stand for about one hour before starting the centrifugal machine.
4. Weigh the dried filter ring and then fit it around the edge of the bowl. Clamp the cover of the bowl tightly.
5. Place a beaker under the drain to collect the extract.
6. The machine is revolved slowly and then gradually the speed is increased to a maximum of 3600 rpm. The speed is maintained till the solvent ceases to flow from the drain.
7. The machine is allowed to stop, 200 ml of solvent is added and the above procedure is repeated. A number of 200 ml solvent additions (not less than three) are used till the extract is clear and not darker than a light straw colour.
8. Remove the filter ring from the bowl, dry it first in the air and then in the oven at 115°C to a constant weight, and weigh it.
9. Collect back the fine material that might have passed through the filter, by centrifuging. Wash and dry the material to a constant weight, as before.
10. Calculate the percentage of binder in the bituminous mix sample as follows :
11. Present the results in Form BC -10

$$\text{Percentage of Binder} = \frac{W_1 - (W_2 + W_3 + W_4)}{W_1} \times 100$$

Where

- W₁ = Weight of the sample g
- W₂ = Weight of the sample after extraction, g
- W₃ = Weight of the fine material recovered from the extract, g
- W₄ = Increase in weight of filter ring, g

Percentage of Binder

Sl.No.	Observations	1	2	3
1.	Wt. of mix taken before extraction (W_1)			
2.	Wt. of filter paper before extraction (B)			
3.	Wt. of mix after extraction (W_2)			
4.	Wt. of filter paper after extraction (D)			
5.	Wt. of filler collected from extract after allowing for setting (W_4)			
6.	Wt. of filler collected in filter paper (B-D) = W_3			
7.	Wt. of Aggregate + filler collected after extraction = $W_2 + W_3 + W_4$			
8.	Percentage of Bitumen (in the mix) $(W_1 - (W_2 + W_3 + W_4)) * 100 / W_1$			

505 BUILT UP SPRAY GROUT

Sec No.	Title	Test Ref No.
A)	Materials	
505.1	Quality of Binder - Straight -run Bitumen	
505.1(a)	Penetration Test	504.1 (a)
505.1 (b)	R&B Softening Point	504.1 (b)
505.1 (c)	Ductility of Bitumen	504.1 (c)
505.2	Quality of Binder - Modified Bitumen	
505.2 (a)	Penetration Test	504.2 (a)
505.2 (b)	R&B Softening Point	504.2 (b)
505.2 (c)	Elastic Recovery Test	504.2 (c)
505.2 (d)	Separation Test	504.2 (d)
505.3	Aggregate Impact Value	401.5
505.4	Flakiness Index	402.3
505.5	Bituminous Stripping of Aggregate Test	504.5
505.6	Water Absorption of Aggregates	402.4
505.7	Soundness with Sodium Sulphate	402.5
505.8	Soundness with Magnesium Sulphate	402.6
B)	Construction & Workmanship	
505.9	Rate of Spread of Binder	502.8
505.10	Rate of Spread of Aggregates	505.10
505.11	Grading of Aggregates	401.1
505.12	Temperature of Binder during Spraying	502.7
505.13	Thickness of Compacted Layer	401.10
505.14	Horizontal Alignment	301.9
505.15	Surface Level	301.10
505.16	Surface Regularity	301.11

505.10 Rate of Spread of Aggregates

The rate of spread of aggregates by the aggregate spreader or any other suitable means can be checked by measuring the area covered by each lorry/truck/any other device of known capacity. This can also be checked by removing the spread aggregates from small areas of the road and weighing them. A 20 cm square metal frame is laid on the new surface dressing, and all the aggregates within the enclosed area are collected, washed in solvent to remove bitumen and then weighed, and the rate of spread of aggregates is calculated. It is measured along the road at intervals of between 4 m to 8 m. The variation in the rate of spread of aggregates should be within ± 20 per cent of the mean.

506 MODIFIED PENETRATION MACADAM

Sec No.	Title	Test Ref No.
A) Materials		
506.1	Quality of Binder – Straight –run Bitumen	
506.1(a)	Penetration Test	504.1 (a)
506.1 (b)	R&B Softening Point	504.1 (b)
506.1 (c)	Ductility of Bitumen	504.1 (c)
506.2	Quality of Binder – Modified Bitumen	
506.2 (a)	Penetration Test	504.2 (a)
506.2 (b)	R&B Softening Point	504.2 (b)
506.2 (c)	Elastic Recovery Test	504.2 (c)
506.2 (d)	Separation Test	504.2 (d)
506.3	Aggregate Impact Value	401.5
506.4	Flakiness Index	402.3
506.5	Bituminous Stripping of Aggregate Test	504.5
506.6	Water Absorption of Aggregates	402.4
506.7	Soundness with Sodium Sulphate	402.5
506.8	Soundness with Magnesium Sulphate	402.7
B) Construction & Workmanship		
506.9	Rate of Spread of Binder	502.8
506.10	Rate of Spread of Aggregates	505.10
506.11	Grading of Aggregates	401.1
506.12	Temperature of Binder during Spraying	502.7
506.13	Thickness of Compacted Layer	401.10
506.14	Horizontal Alignment	301.9
506.15	Surface Level	301.10
506.16	Surface Regularity	301.11

507 SURFACE DRESSING

Sec No.	Title	Test Ref No.
A)	Materials	
507.1	Quality of Binder – Straight –run Bitumen	
507.1(a)	Penetration Test	504.1 (a)
507.1 (b)	R&B Softening Point	504.1 (b)
507.1 (c)	Ductility of Bitumen	504.1 (c)
507.2	Quality of Binder – Bitumen Emulsion	
507.2 (a)	Viscosity	502.2
507.2 (b)	Residue on 600 Micron IS Sieve	502.3
507.2 (c)	Storage Stability Test	502.4
507.3	Quality of Binder – Modified Bitumen	
507.3 (a)	Penetration Test	504.2 (a)
507.3 (b)	R&B Softening Point	504.2 (b)
507.3 (c)	Elastic Recovery Test	504.2 (c)
507.3 (d)	Separation Test	504.2 (d)
507.4	Aggregate Impact Value	401.5
507.5	Flakiness Index	402.3
507.6	Bituminous Stripping of Aggregate Test	504.5
507.7	Water Absorption of Aggregates	402.4
507.8	Soundness with Sodium Sulphate	402.5
507.9	Soundness with Magnesium Sulphate	402.6
B)	Construction & Workmanship	
507.10	Rate of Spread of Binder	502.8
507.11	Rate of Spread of Aggregates	505.10
507.12	Grading of Aggregates	401.1
507.13	Temperature of Binder during Spraying	502.7
507.14	Horizontal Alignment	301.9
507.15	Surface Level	301.10
507.16	Surface Regularity	301.11

508.1 20 mm Thick Premix Carpet using Bitumen

Sec No.	Title	Test Ref No.
A) Materials		
508.1.1	Quality of Binder – Straight –run Bitumen	
508.1.1(a)	Penetration Test	504.1 (a)
508.1.1 (b)	R&B Softening Point	504.1 (b)
508.1.1 (c)	Ductility of Bitumen	504.1 (c)
508.1.2	Quality of Binder – Bitumen Emulsion	
508.1.2 (a)	Viscosity	502.2
508.1.2 (b)	Residue on 600 Micron IS Sieve	502.3
508.1.2 (c)	Storage Stability Test	502.4
508.1.3	Quality of Binder – Modified Bitumen	
508.1.3 (a)	Penetration Test	504.2 (a)
508.1.3 (b)	R&B Softening Point	504.2 (b)
508.1.3 (c)	Elastic Recovery Test	504.2 (c)
508.1.3 (d)	Separation Test	504.2 (d)
508.1.4	Aggregate Impact Value	401.5
508.1.5	Flakiness Index	402.3
508.1.6	Bituminous Stripping of Aggregate Test	504.5
508.1.7	Water Absorption of Aggregates	402.4
508.1.8	Soundness with Sodium Sulphate	402.5
508.1.9	Soundness with Magnesium Sulphate	402.6
B) Construction & Workmanship		
508.1.10	Grading of Aggregates	401.1
508.1.11	Binder Content Before Seal Coat	504.10
508.1.12	Temperature of Binder	502.7
508.1.13	Thickness Before and After Compaction	401.10
508.1.14	Horizontal Alignment	301.9
508.1.15	Surface Levels	301.10
508.1.16	Surface Regularity	301.11

508.2 20 mm THICK PREMIX CARPET USING BITUMEN EMULSION

Sec No.	Title	Test Ref No.
A) Materials		
508.2.1	Quality of Binder (Bitumen Emulsion)	
508.2.1 (a)	Penetration	504.1 (a)
508.2.1 (b)	Softening Point Test	504.1 (b)
508.2.1 (c)	Elastic Recovery	504.2 (c)
508.2.1 (d)	Separation Test	504.2 (d)
508.2.2	Aggregate Impact Value	401.5
508.2.3	Flakiness Index	402.3
508.2.4	Bitumen Stripping of Aggregates	504.5
508.2.5	Water Absorption	402.4
508.2.6	Soundness with Sodium Sulphate	402.5
508.2.7	Soundness with Magnesium Sulphate	402.6
B) Construction & Workmanship		
508.2.8	Grading of Aggregates	401.1
508.2.9	Binder Content before Seal Coat	504.10
508.2.10	Temperature of Binder	502.7
508.2.11	Thickness before and after Compaction	401.10
508.2.12	Thickness of Layer with Seal Coat	401.10
508.2.13	Horizontal Alignment	301.9
508.2.14	Surface Level	301.10
508.2.15	Surface Regularity	301.11

509 MIX SEAL SURFACING

Sec No.	Title	Test Ref No.
A) Materials		
509.1	Flakiness Index of Aggregate	402.3
509.2	Aggregate Impact Value	401.5
509.3	Soundness with Sodium Sulphate	402.5
509.4	Soundness with Magnesium Sulphate	402.6
509.5	Water Absorption	402.4
509.6	Coating and Stripping of Bitumen Aggregate Mixture	504.5
509.7	Gradation Analysis	401.1
509.8	Binder	508.1
B) Construction & Workmanship		
509.9	Horizontal Alignment	301.9
509.10	Surface Level	301.10
509.11	Surface Regularity	301.11

510 SEAL COAT

Sec No.	Title	Test Ref No.
A) Materials		
510.1	Gradation Analysis	401.1
510.2	Flakiness Index of Aggregate	402.3
510.3	Aggregate Impact Value	401.5
510.4	Soundness with Sodium Sulphate	402.5
510.5	Soundness with Magnesium Sulphate	402.6
510.6	Water Absorption	402.4
510.7	Coating and Stripping of Bitumen Aggregate Mixture	504.5
510.8	Temperature of Binder	502.7
510.9	Penetration on Paving Bitumen/Modified Emulsion	504.2 (a)
510.10	Softening Point on Paving Bitumen / Modified Emulsion	504.2 (b)
510.11	Ductility on Paving Bitumen	504.1 (c)
510.12	Elastic Recovery of Modified Bitumen	504.2 (d)
510.13	Viscosity	502.2
510.14	Residue on 600 Micron	502.3
510.15	Storage Stability Test for Emulsion	502.4
B) Construction & Workmanship		
510.16	Rate of Spread of Binder	502.8
510.17	Rate of Spread of Aggregates	505.10

512 MODIFIED BITUMEN

Sec No.	Title	Test Ref No.
A)	Materials	
512.1	Penetration	504.2 (a)
512.2	Softening Point	504.2 (b)
512.3	Elastic Recovery	504.2 (c)
512.4	Separation	504.2 (d)

—◆—
SECTION 600

**BRICKWORK FOR
STRUCTURES**



600 BRICK WORK FOR STRUCTURES

Sec No.	Title	Test Ref No.
A) Materials		
600.1	Colour and Dimensional Check of Bricks	600.1
600.2	Water Absorption of Bricks	600.2
600.3	Efflorescence of Bricks	600.3
600.4	Compressive Strength of Bricks	600.4
600.5	Setting Time of Cement	800.1
600.6	Purity of Lime	403.1
600.7	Grain Size Analysis of Sand / Stone / Marble dust	301.1
600.8	Water for Construction	600.8
B) Construction & Workmanship		
600.9	Height, Bond and Verticality by Plumb Bob	600.9
600.10	Consistency of Cement Mortar	600.10
600.11	Water Retentivity of Mortar	600.11
600.12	Compressive Strength of Mortar	600.12
600.13	Thickness of Joints in General Brick Work	600.13
600.14	Thickness of Joints in Arches	600.14
600.15	Plaster Finish	600.15

600.1 Colour and Dimensional Check of Bricks

Purpose

It is necessary to check the size and colour of bricks before using them.

Procedure

It should be seen that the bricks have a uniform colour and are free from cracks, organic matter and flows and nodules of free lime. They should have rectangular faces with sharp corners and emit a ringing sound when struck.

The size should be as per local practice with tolerance of ± 5 percent.

600.2 Water Absorption of Bricks

Purpose

Bricks which absorb more water than normal will produce weaker masonry, as they will make the mortar dry.

Procedure

Dry the specimen in a ventilated oven at a temperature of 105 to 115°C till it attains substantially constant mass. Cool the specimen to room temperature and obtain its weight M_1 . Do not use specimen which are warm to touch.

Immerse completely dried specimen in clean water at a room temperature of $27 \pm 2^\circ\text{C}$ for 24 h. Remove the specimen and wipe out any traces of water with a damp cloth and weigh the specimen. Complete the weighing 3 min after the specimen has been removed from water (M_2). Water absorption, percent by mass after 24 hour immersion in cold water is given by the following formula

$$\text{Water Absorption} = \frac{M_2 - M_1}{M_1} \times 100$$

Observations are recorded in Form BR-1

Water Absorption of Bricks**Form- BR-1**

S.No.	Weight of the dried specimen cooled at air temperature M_1	Weight of the specimen after immersion in water for 24 h M_2	Water absorption percent by mass $\frac{M_2 - M_1}{M_1} \times 100$

Reference: IS : 3495 (Part 2) - 1992

600.3 Efflorescence of Bricks**Purpose**

Bricks that show moderate to serious efflorescence are considered unfit for use in road structures.

Procedure

A shallow flat bottom dish containing sufficient distilled water to completely saturate the specimens is used for the test. Place the end of the bricks in the dish, the depth of immersion in water being 25 mm. Place the whole arrangement in a warm (between 20°C and 30°C) well ventilated room until all the water in the dish is absorbed by the specimens and the surplus water evaporates. Cover the dish containing the brick with a suitable glass cylinder so that excessive evaporation from the dish may not occur. When the water has been absorbed and brick appears to be dry, place a similar quantity of water in the dish and allow it to evaporate as before. Examine the bricks for efflorescence after the second evaporation and report the results.

The liability to efflorescence shall be reported as 'Nil', 'Slight', 'Moderate', 'Heavy' or 'Serious' in accordance with the following definitions.

- (a) Nil : When there is no perceptible deposit of efflorescence
- (b) Slight : When not more than 10 percent of the exposed area of brick is covered with a thin deposit of salts
- (c) Moderate : When there is a heavier deposit than under 'Slight' and covering up to 50 percent of the exposed area of the brick surface but unaccompanied by powdering or flaking of the surface.
- (d) Heavy : When there is a heavy deposit of salts covering 50 percent or more of the exposed area of the brick surface but unaccompanied by powdering or flaking of the surface.
- (e) Serious : When there is a heavy deposit of salts accompanied by powdering and / or flaking of the exposed surfaces.

600.4 Compressive Strength of Bricks

Purpose

The Compressive Strength of bricks broadly indicates the overall quality of the raw material and its manufacturing process.

Procedure

Remove unevenness observed in the bed faces of bricks to provide two smooth and parallel faces by grinding. Immerse in water at room temperature for 24 h. Remove the specimen and drain out any surplus moisture at room temperature. Fill the frog and all voids in the bed face flush with cement mortar (1 cement, clean coarse sand of grade 3 mm and down). Store under the damp jute bags for 24 h followed by immersion in clean water for 3 days. Remove and wipe out any traces of moisture.

Places the specimen with flat faces horizontal, and mortar filled face facing upwards between two 3 ply plywood sheets each of 3 mm thickness and carefully centered between plates of testing machine. Apply load axially at a uniform rate of 14 N/mm² per minute till failure occurs. Note the maximum load at failure. The load at failure is considered the maximum load at which the specimen fails to produce any further increase in the indicator reading on the testing machine. Observations are recorded in Form BR-2.

Sl.No.	Length of bed no.1 (mm)	Width of bed face no.1 (mm)	Area of bed face no.1 mm ²	Length of bed face no.2 (mm)	Width of bed face no.2 (mm)	Area of bed face no. 2(mm ²)	Average Area of bed face (mm ²)	Maximum load at failure in Newtons	Compressive Strength = Maximum load / Average Area of bed faces

Form for the Test on Compressive Strength of Bricks BR-2

Reference: IS : 3495 (Part 1) - 1992

600.8 Suitability of Water for Construction

Purpose

Water plays an important part in deciding the quality of the final concrete.

Acceptance Criterion

1. The pH value of water shall not be less than 6.
2. Limits of Acidity - To neutralize 100ml of water, using phenolphthalein as an indicator it shall not require more than 5ml of .02 normal NaOH. (IS : 3025 Part 22).
3. Shall not require more than 25ml of 0.02 normal H₂SO₄. (IS : 3025 part 23).
4. Permissible Limits of Solids

Table 600.8.1: Permissible Limits of Solids in Construction Water

Organic	200mg/litre (IS : 3025 part 18)
Inorganic	3000mg/litre (IS : 3025 part 18)
Sulphat es (as SO ₄)	400mg/litre (IS : 3025 part 24)
Chlorides	2000 mg/liter for plain concrete (IS : 3025 part 32)
Suspended Matter	2000mg/litre (IS : 3025 part 17)

5. Permissible loss in strength - The 28 days compressive strength of at least three 150mm concrete cubes prepared with the proposed water shall not be less than 90 percent of the average strength of three similar cubes prepared with distilled water.
6. Setting Time – The initial setting time of test blocks with the appropriate cement and water proposed to be used shall not be less than 30 minutes and shall not differ by ± 30 mtrs from the initial setting of control test blocks prepared.

Reference: IS : 3025 (Parts 17, 18, 22, 23, 24, 32)

600.9 Height, Bond and Verticality by Plumb Bob

Purpose

It is necessary to check the height of each course, its bond and vertically for ensuring long term durability

Procedure

All bricks shall be thoroughly soaked in water and made skin dry before use. All brickwork shall be laid in English Bond even time to time, in accordance with the drawings or as directed by the Engineer. The vertically will be measured with a plumb. The height will be measured with a steel tape to the nearest millimeters.

600.10 Consistency of Cement Mortar

Purpose

The consistency of mortar determines its behavior during application. It depends upon initial fluidity, water retentivity etc.

Procedure

A standard cone weighing 300 ± 2 g; 150 mm in height and a diameter of 75 mm at the base. The cone is mounted on a vertical shaft fastened to an adjustable holder (Fig. 2). The holder has a mechanism which releases the shaft. The apparatus also has an instrument dial which records the depth of penetration of the cone into a mortar mix kept in a conical container below. The conical container for mortar is 180 mm deep with a diameter of 150 mm at the top.

Fill the conical container with mortar mix to a level 1cm below its rim. Place the mortar mix in the conical mould in one continuous operation and compact it by a tamping rod, which is 25 mm square and 200 mm long. Bump the mould filled with mortar mix 5 or 6 times over a flow table so as to level the surface of the mortar.

Place the container over the base below the penetration cone of the apparatus. Bring the apex of the penetrating cone in contact with the surface of the mortar and clamp the cone in position. Release the cone now and allow it to sink into the mortar mix. After the cone has stopped penetrating into the mortar, set the dial once more to record the position of cone. The difference between dial readings before and after penetration gives the depth of penetration of the cone into the mortar.

Repeat the test on another sample; report the average of two determinations as the consistency of the mortar.

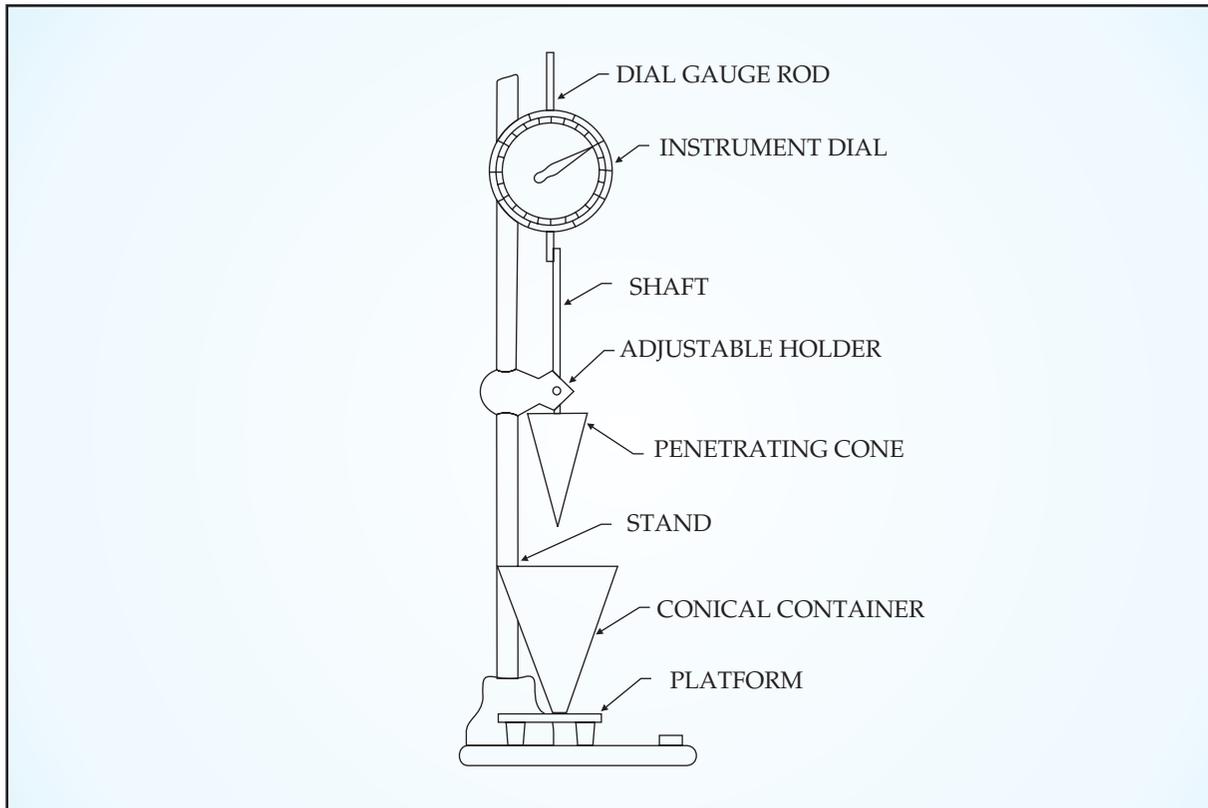


Figure 7 Standard Cone Apparatus

Reference : IS : 2250 - 1981

600.11 Water Retentivity of Mortar

Purpose

Water retentivity is the ability of mortars to retain water against suction and evaporation in general . It is indirectly a measure of the workability of mortars.

Procedure

The apparatus used for this test consists of a water aspirator or other source of vacuum controlled by way of a three way stopcock to a funnel upon which rests a perforated dish. The perforated dish shall be made of metal, not attacked by masonry mortars. The metal in the base of the dish shall have a thickness of 1.7 to 1.9 mm and shall conform to the outline shown in figure . The bore of the stopcock shall have a minimum inside diameter of 4 mm.

A mercury manometer, connected as shown in Fig. 3 , indicates the vacuum. A synthetic rubber gasket shall be permanently sealed to the top of the funnel and shall be lightly coated with petroleum or light cup grease during the test to ensure a seal between the funnel and the dish. Care shall be taken to ensure that none of the holes in the perforated dish is clogged from the grease used on the rubber gasket. Hardened filter paper of a grade equivalent to Carl Schleicher and Schuell filter paper No.576 or to Whatman No.50 filter paper shall be used. It shall be of such diameter that it will lie flat and completely cover the bottom of the dish.

Adjust the mercury relief column so as to maintain a vacuum of 5cm as measured on the manometer. Seat the perforated dish on the greased gasket of the funnel. Place a wetted filter paper in the bottom of the dish. Turn the stopcock to apply the vacuum to the funnel and check the apparatus for leaks and to determine that the required suction is obtained. Then turn the stopcock to shut off the vacuum from the funnel.

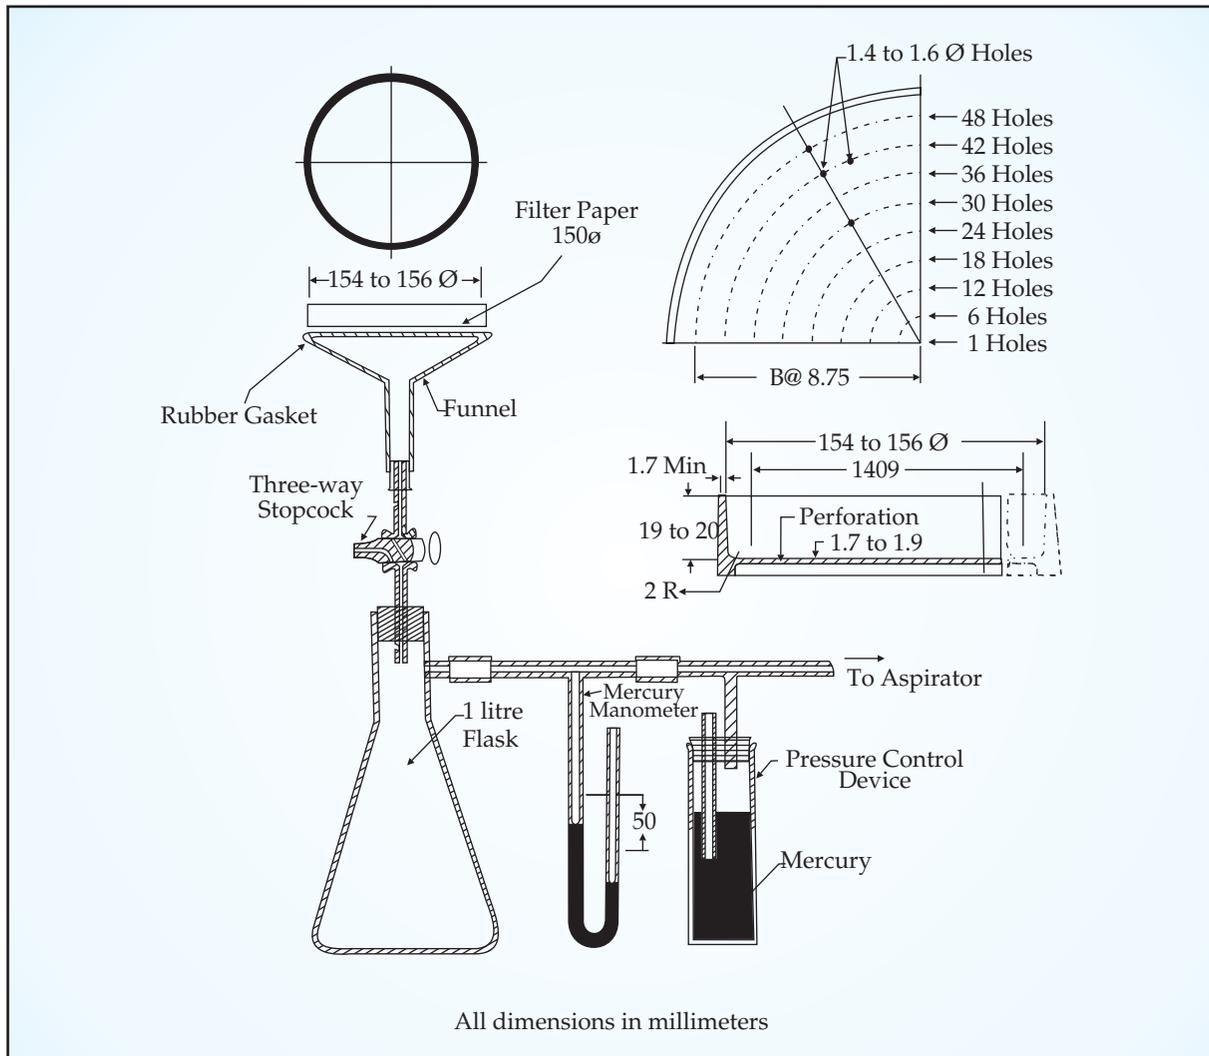


Figure 8 Apparatus Assembly for Water Retention Test

Mix the mortar to a consistency to give a flow of 110 to 115. Immediately after making the flow test return the mortar on the flow table to the mixing bowl and remix the entire batch for 15 sec at medium speed. Immediately after remixing of the mortar, fill the perforated dish with the mortar to slightly above the rim. Tamp the mortar 15 times with the tamper. Ten of the tamping strokes shall be applied at approximately uniform spacing adjacent to the rim of the dish and with the long axis of the tamping face held at right angles to the radius of the dish. The remaining five tamping strokes shall be applied at random points distributed over the central area of the dish. The tamping pressure shall be just

sufficient to ensure filling of the dish. On completion of tamping, the top of the mortar should extend slightly above the rim of the dish. Smooth off the mortar by drawing the flat side of the straight edge (with the leading edge slightly raised) across the top of the dish. Then cut off the mortar to a plane surface flush with the rim of the dish by drawing the straight edge with a sawing motion across the top of the dish in two cutting strokes, starting each cut from near the center of the dish. If the mortar is pulled away from the side of the dish during the process of drawing the straight edge across the dish, gently press the mortar back into contact with the side of the dish using the tamper.

Turn the stopcock to apply the vacuum to the funnel. The time elapsed from the start of mixing the cement and water to the time of applying the vacuum shall not exceed 8 min. After suction for 60 sec quickly turn the stopcock to expose the funnel to atmospheric pressure. Immediately slide the perforated dish off from the funnel, touch it momentarily on damp cloth to remove droplets of water and set the dish on the table. Then, using the bowl scraper, flow and mix the mortar in the dish for 15 sec. Upon completion of mixing, place the mortar in the dish for 15 sec. Upon completion of mixing, place the mortar in the flow mould and determine the flow. The entire operation shall be carried out without interruption and as quickly as possible, and shall be completed within an elapsed time of 11 min after the start of mixing the cement and water for the first flow determination.

Calculation :

Calculate the water retention value for the mortar as follows ;

$$\text{Water retention value} = A/B \times 100$$

Where

A = flow after suction and

B = flow immediately after mixing

Reference: IS : 2250 – 1981

600.12 Compressive Strength of Mortar

Purpose

Compressive strength of mortar indicates overall quality of the mortar.

Procedure

The following equipment shall be used

Specimen and Moulds - The test specimens shall be cubes of size 50 mm and shall conform to the requirements given below:

Cube Moulds - The moulds for the 50 mm cube specimen shall be metal not attacked by cement, cement-pozzolana mixture or lime--pozzolana mixture and there shall be sufficient strength and stiffness to prevent spreading and warping. The moulds shall be rigidly constructed in such a manner as to facilitate the removal of the moulded specimen without damage. The moulds shall be machined so that when assembled ready for use, the dimensions and internal faces shall be accurate to the following limits:

The height of the mould and the distance between the opposite faces shall be 50 ± 0.1 mm. The angle between adjacent interior faces and between interior faces and top and bottom planes of the mould shall

be 90 ± 0.5 degrees. The interior faces of the moulds shall be plane surfaces with a permissible variation of 0.03 mm. Each mould shall be provided with a base plate having a plane surface machined to a tolerance 0.10 mm and made of non-absorbent, non-corrodible and non-reactive material. The base plate shall be of such dimensions as to support the mould during the filling without leakage.

The parts of the mould when assembled shall be positively held together, and suitable methods of ensuring this, both during the filling and on subsequent removal of the filled mould shall be provided in order to prevent the moulded specimen from damage.

Mixing Apparatus - The mixing apparatus shall conform to the requirements specified below:

Mixer - The mixer shall be an electrically driven mechanical mixer which shall consist essentially of the following:

- a) A stainless steel mixing bowl with a nominal capacity of 5 litres of the shape and dimensions as shown in Fig. 4 and provided with means by which it can be securely fixed to the mixing frame during mixing, and
- b) A mixer blade of the form and dimensions shown in Fig 5 revolving about its axis as it is driven in a planetary movement around the bowl by an electric motor.

The two directions of rotation shall be opposite. The speed of rotation during mixing shall be as follows:

- a) Blade revolving about its own axis 140 ± 5 rev/min
- b) Planetary movement 62 ± 5 rev/min

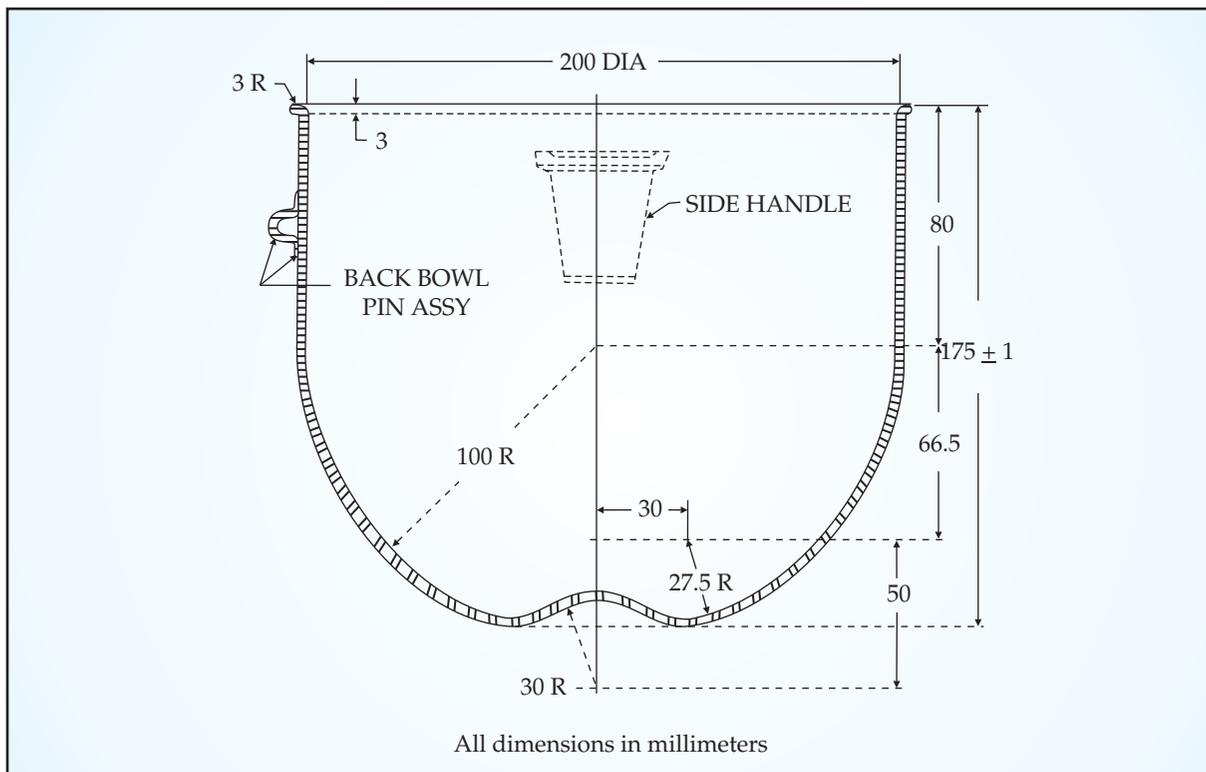


Figure 9 Mixing Bowl

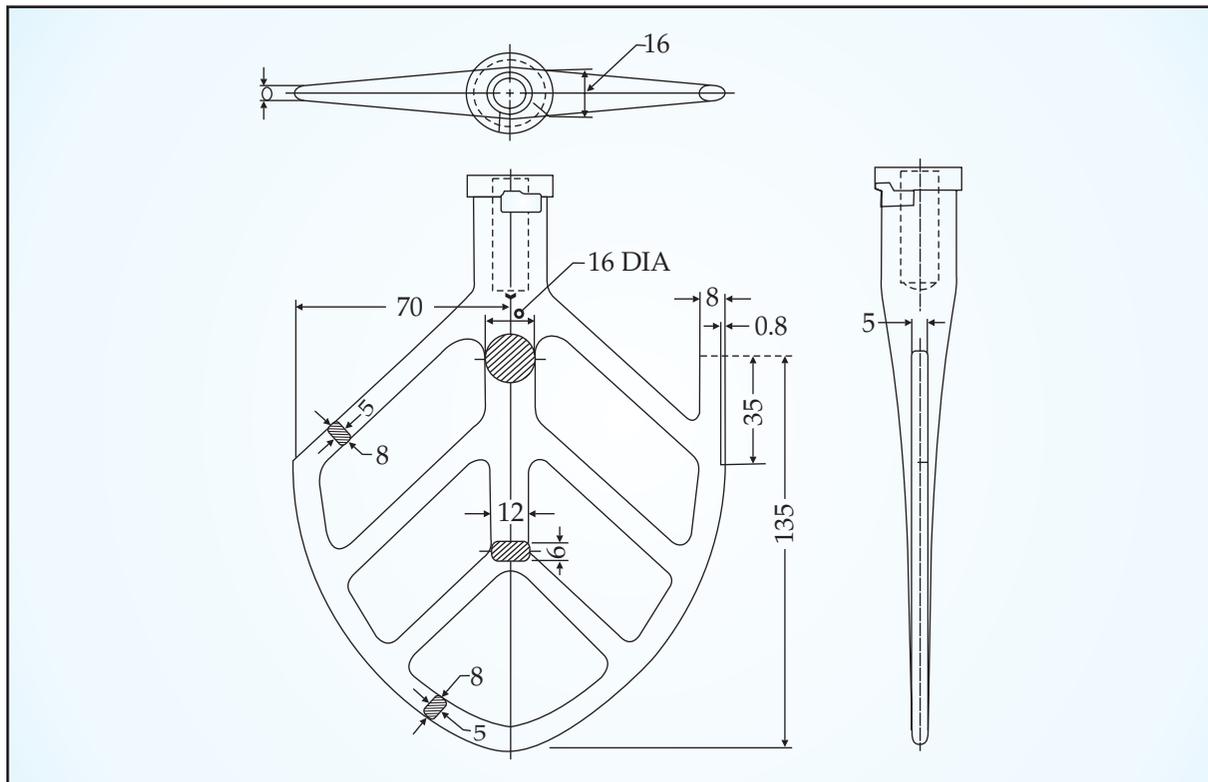


Figure 10 A Mixer Blade

A plastic scraper.

Tamping Rod- A metal bar 25 mm square and 200 mm long.

Trowel- This shall have a steel blade 100 to 150 mm in length with straight edges.

Flow Table – The standard table

Preparation of Moulds - The interior faces of the specimen moulds shall be thinly covered with mineral oil or light cup grease. After the moulds are assembled, excessive oil or grease shall be removed from the interior faces and the top and bottom surfaces of each mould. Moulds shall then be set on plane, non-absorbent, non-corrodible and non-reactive base plates that have been thinly coated with mineral oil or light cup grease.

Preparation of Mortar - The mortar shall be of the materials and proportions intended for use in the construction mixed to give a flow of 110 to 115. The mixing procedure for sample made in the laboratory shall be as given above.

Trial Mixing - Trial mortars shall be made with specified proportion of dry ingredients and adding different percentages of water until the specified flow is obtained. Each trial shall be made with fresh mortars. The mixing shall be done mechanically as described earlier.

The mixing of the ingredients shall be carried out at a temperature of $27 \pm 2^\circ\text{C}$ and all ingredients before

mixing shall be brought to the same temperature.

The dry ingredients shall then be placed in the mixing bowl and mixed for 30 sec. Over the next 30 sec, while mixing, water shall be poured at a uniform rate into the bowl and the mixing shall be continued for 60 sec. The mixer shall then be stopped and the paddle and sides of the bowl shall be cleaned down in about 15 sec with the plastic scraper. The bowl shall be covered with a damp cloth and the mortar be allowed to stand for a period of 10 min.

The mortar shall then be remixed for 60 sec.

When using lime putty, the procedure shall be as described above, except that the sand and lime putty shall be premixed by hand or in the mixer until the lime appears to be uniformly distributed.

Remixing of Mortars in the Laboratory - Samples of mortar received in the laboratory for testing shall be examined for any leakage or evaporation and segregation or bleeding of the liquid. The whole of the sample, with any liquid which has separated or has condensed inside the container, shall be transferred as completely as possible to an impermeable working surface and remixed, using a trowel, until it appears homogeneous.

The top of the flow table shall be carefully wiped clean, dried and the flow mould shall be placed at the centre. A layer of mortar about 25 mm in thickness and mixed in accordance with A-4.1.1 shall be placed in the mould and tamped 20 times with the tamping rod. The tamping pressure shall be just sufficient to ensure uniform filling of the mould. The mould shall then be filled to overflow with mortar and tamped, as specified for the first layer. The mortar shall be cut off plane and level with the top of the mould by drawing the straight edge of a trowel (held perpendicular to the mould) with a sawing motion across the top of the mould. The top of the table shall be wiped clean and dried, taking care to remove any water from around the edge of the flow mould. The mould shall then be lifted away from the mortar and the flow table shall be immediately dropped through a height of 12.5 mm, 25 times in 15 sec. The flow is the resulting increase in average base diameter of the mortar mass, measured on at least four diameters at approximately equispaced intervals expressed as a percentage of the original base diameter.

Test Specimens

Cubes - The mould as prepared shall be filled with the mortar to about half height and the layer compacted by tamping it with the tamping rod in a uniform manner over the mortar surface in such a way as to produce full compaction of the mortar with neither segregation nor excessive laitance. The mould shall then be completely filled and the upper layer of the mortar compacted in a similar manner, after which the surface of the mortar shall be struck off plane and level with the top of the mould, using a trowel.

Curing and Storage of Test Specimens - The specimens shall be stored at a place free from vibration, either in moist air at a temperature of $27 \pm 2^{\circ}\text{C}$ and relative humidity of not less than 90 percent or under damp sacks, matting or other suitable damp material covered completely with polyethylene or other similar impervious sheeting, at a temperature of $27 \pm 2^{\circ}\text{C}$ for 1 to 3 days, depending on the early strength of the mortar, from the time of adding the water to the other ingredients. The specimen shall then be marked for later identifications, removed from the moulds and stored in clean water until the time of test. The temperature of the storage water shall be $27 \pm 2^{\circ}\text{C}$.

When cubes are made at site, records of the maximum and minimum air and water storage temperature shall be kept during the period, using maximum and minimum thermometers or continuous recording instruments. The cubes shall be sent to the testing laboratory when they are not less than 3 days nor more than 7 days old, well packed in damp sand or in wet sacks, and when necessary enclosed in

polyethylene bag or sealed container, so that they arrive at the laboratory in a damp condition not less than 24 h before the time of test. On arrival at the testing laboratory, the cubes shall be stored in clean water maintained at a temperature of $27 \pm 2^\circ\text{C}$ until the time of test.

Number of Specimens - Three or more specimens shall be made for each period of test specified.

Procedure

The specimen shall be tested immediately on removal from the curing water in which it has been stored and while it is still in a wet condition. Any loose material shall be removed from the sides of the specimen. The dimensions of the specimen shall be noted before testing. The bearing surfaces of the testing machine shall be wiped clean and the specimen shall be placed in the machine in such a manner that the load shall be applied to opposite sides of the cube as cast, that is, not to the top and bottom.

The axis of the cube shall be carefully aligned with the centre of thrust of steel plates bearing the testing machine. No packing other than auxiliary steel plates shall be used between the faces of the specimen and steel platens of the testing machine.

The load on the specimen shall be applied without shock and at a uniform rate of $2\text{N}/\text{mm}^2$ to $6\text{N}/\text{mm}^2$ per min until failure occurs.

The maximum load at failure shall be noted.

Calculation

The compressive strength shall be calculated as follows :

$$\text{Compressive strength (N/mm}^2\text{)} = \frac{\text{Maximum load at failure (N)}}{\text{Cross-sectional area (mm}^2\text{)}}$$

The individual results shall be calculated to the nearest $0.05\text{N}/\text{mm}^2$.

Report

The average of all the determination shall be reported (Form BR-3).

Compressive Strength of Mortar

Form BR-3

S.No.	Specimen No.	Plan Area of Cube Mould A (mm ²)	Load at failure W (N)	Compressive Strength = W/A (N/mm ²)

600.13 Thickness of Joints for General Brick Work - Tolerance

The thickness of joints for general brick work shall be measured with a vernier calliper with a least count of 0.1 mm. The thickness of joints for general brick work shall not be more than 10 mm.

600.14 Thickness of Joints for Arches – Tolerance

The thickness of joints for arches shall be measured with a vernier calliper with a least count of 0.1 mm. The thickness of joints for arches shall not be less than 5 mm and not more than 15 mm.

600.15 Plaster Finish – Tolerances

The thickness of plaster shall be measured with a vernier calliper with a least count of 0.1mm. The plaster thickness as provided shall not be less than the specified thickness by more than 3 mm.

—◆—
SECTION 700

**STONE MASONRY FOR
STRUCTURES**



700 STONE MASONRY FOR STRUCTURES

Sec No.	Title	Test Ref No.
A) Materials		
700.1	Shape and Dimensions of Stones	700.1
700.2	Water Absorption of Stones	700.2
700.3	Dressing of Stones	700.3
700.4	Setting Times Cement	800.1
700.5	Purity of Lime	403.1
700.6	Gradation of Sand	301.1
700.7	Deleterious Material and Organic Impurities	800.6
700.8	Water for Construction	600.8
700.9	Compressive Strength of Stones	600.12
700.10	Consistency of Cement Mortar	600.10
700.11	Water Retentivity of Mortar	600.11
700.12	Mix Proportions for Different Works	700.12
700.13	Compressive Strength of Mortar	600.12
B) Construction & Workmanship		
700.14	Horizontality and Verticality	700.14
700.15	Height and Thickness	700.15
700.16	Thickness of Joints of Masonry	600.13
700.17	Thickness of Joints in Arches	600.14
700.18	Consumption of Mortar in Stone Masonry	700.18

700.1 Shape and Dimensions of Stones

Purpose

The quality and durability of stone masonry depends on the size and shape of stones besides other ingredients.

Procedure

The stone shall be hard, sound, free from defects like cavities, flaws, sand holes and patches of soft material. Stones shall conform to the requirements of IS : 1597 (Part 1).

The shape and dimensions of stones shall be checked before use.

700.2 Water Absorption of Stones

Purpose

Water absorption shows the porosity of stones in one way. The more, it absorbs, the less it is durable.

Procedure

The test piece about 1 kg shall be washed to remove dust and immersed in distilled water in a glass vessel at a room temperature 20°C to 30°C for 24 h. Soon after immersion and again at the end of the soaking period, entrapped air shall be removed by gentle agitation. This will be done by rapid clock wise and anticlock wise rotation. The vessel shall then be emptied and test piece be allowed to drain. The test piece shall then be placed on a dry cloth and gently surface dried with the cloth. It shall be transferred to a second dry cloth when the first one removes no further moisture. It shall be spread out not more than one stone deep on the second cloth and left exposed to atmosphere away from direct sunlight or any other source of heat for less than 10 min until it appears to be completely surface dry. The sample shall then be weighed (B).

The sample will be dried in an oven at 100 to 110°C for not less than 24 h. It shall then be cooled in a desiccator to room temperature and weighed (A) The water absorption shall be calculated from the formula.

$$\text{Water Absorption} = \frac{(B - A)}{A} \times 100$$

Report the results in the form ST-1

Water Absorption of Stones

Form ST-1

S.No.	Specimen No.	Wt of Saturated Surface Dry Sample B (g)	Wt of Oven Dried Sample A (g)	Water Absorption (%) = $\frac{B-A}{A} \times 100$

700.3 Dressing of Stones

Purpose

The dressing of stone is done to bring them into the required shape.

Procedure

The dressing of stones shall be done as per the requirement and methods specified in IS : 1129.

700.12 Mix Proportions for Different Works

Purpose

Mix design is required to optimize the quantity of various ingredients.

Procedure

Mix design is essentially carried out by trial and error. Taking the effect of various elements like, water cement ratio, gradation, strength etc. into account an initial mix is worked out. It is then refined on the basis of tests for the required parameters.

700.14 Horizontality and Verticality

Purpose

The durability of stone masonry depends upon these parameters.

Procedure

Horizontality is checked with spirit levels on a small scale and with a surveying instruments on a large scale. Similarly the verticality is checked with a Plumb bob.

700.15 Height and Thickness

Purpose

Height and thickness of each course effect the long term performance of the masonry.

Procedure

The height and thickness of individual courses as well as the total height needs to be measured regularly with a steel tape on a small scale and with a surveying instrument on a large scale.

700.18 Consumption of Mortar in Stone Masonry

The consumption of mortar in stone masonry should be noted. The amount of mortar should be 0.25 to 0.30 cubic meter for each cubic meter of stone masonry.

—◆—
SECTION 800

**CONCRETE FOR
STRUCTURES**



800 CONCRETE FOR CONSTRUCTION

Sec No.	Title	Test Ref No.
A) Materials		
800.1	Setting Time of Cement	800.1
800.2	Soundness of Cement	800.2
800.3	Compressive Strength of Cement	800.3
800.4	Gradation Analysis of Aggregates	401.1
800.5	Flakiness Index of Coarse Aggregate	402.3
800.6	Deleterious Materials and Organic Impurities	800.6
800.7	Water Absorption / Water Content	402.4
800.8	Crushing Strength of Coarse Aggregates	800.8
800.9	Aggregate Impact Value	401.5
800.10	Soundness	402.5, 402.6
800.11	Alkali Aggregate Reactivity	800.11
800.12	Gradation of Fine Aggregate	301.1
800.13	Deleterious Constituents of Fine Aggregates	800.6
800.14	Alkali Aggregate Reactivity	800.11
800.15	Water for Construction	600.8
800.16	Mix Design for Each Work	800.16
B) Construction & Workmanship		
800.17	Moisture Content of Coarse and Fine Aggregates	800.17
800.18	Cement Consumption	800.18
800.19	Workability of Concrete by Slump Test	800.19
800.20	Workability of Concrete by Compaction Test	800.20
800.21	Formwork and Construction Joints	900
800.22	Curing of Concrete	800.22
800.23	Schmidt's Rebound Hammer	800.23
800.24	Ultrasonic Pulse Velocity	800.24
800.25	Accelerated Curing Test	800.25
800.26	Compressive Strength of Concrete Cubes (150 mm x150 mmx150 mm) at 28 days	800.26
800.27	Flexural Strength of Concrete	800.27

800.1 Initial and Final Setting Time of Cement

Purpose

Cement, when used in construction, should set in a reasonable time. It should not set too early, so that it can be transported to the place where it is to be placed. Also it should not take too long for setting, so that the formworks can be removed and further work started.

Procedure

1. Prepare a neat cement paste by mixing the cement with 0.85 times the water required to give a paste of standard consistency, using potable or distilled water.
2. Start a stop watch at the instant when water is added to the cement.
3. Fill the Vicat mould with the cement paste, the mould resting on a non-porous plate.
4. Fill the mould completely and smooth off the surface of the paste making it level with the top of the mould.
5. Lower the needle gently until it comes in contact with the surface of the test block and quickly release, allowing it to penetrate into the test block.
6. In the beginning, the needle will completely pierce the block. Repeat this procedure until the needle fails to pierce the block beyond 5.0 ± 0.5 mm measured from the bottom of the mould.
7. The period elapsing between the time when water is added to the cement and the time at which the needle fails to pierce the test block to a point 5.0 ± 0.5 mm measured from the bottom, is called the initial setting time.

Final Setting time

1. Replace the needle by the annular attachment.
2. The cement shall be considered as finally set when, upon applying the needle gently to the surface of the test block, the needle makes an impression, thereon, while the attachment fails to do so.
3. The period elapsing between the time when water is added to the cement and the time when cement is finally set as indicated above, shall be the final setting time.
4. In the event of a scum forming on the surface of the test block, use the underside of the block for the determination.

Setting Time of Cement

Form CC-1

S.No.	Starting Time (Stop Watch) T_0	Time when Initial set has taken place (s) T_1	Time when Final set has taken place (s) T_2

$$\text{Initial Setting Time} = T_1 - T_0$$

$$\text{Final Setting Time} = T_2 - T_0$$

Reference : I.S. 4032 (Part 5) – 1988

800.2 Soundness of Cement

Purpose

The testing of soundness of cement is done to ensure that the cement does not show any appreciable subsequent expansion. The non soundness of cement is due to the presence of excess of lime, excess of magnesia or excessive proportion of sulphates.



LE-CHATelier MOULD

Procedure

Requirements

Soundness of cement can be determined by two methods, namely Le-Chatelier method and Autoclave method. The un-aerated cement should not have an expansion of more than 10 mm and 0.8 percent respectively when tested by the two methods. In the event of cements failing to comply with any or both the requirements mentioned above, further tests would be undertaken on another portion of the same sample after aeration. Aeration shall be done by spreading out the sample to a depth of 75 mm at a relative humidity of 50 to 80% for a total of 7 days. The expansion of cements 80% aerated shall be not more than 5 mm and 0.6% when tested by Le-Chatelier and Autoclave method respectively.

Method 1: Le-Chatelier Method

1. Prepare a cement paste by gauging cement with 0.78 times the water required to give a paste of standard consistency.
2. Oil the mould lightly. Keep it on a lightly oiled glass plate and fill up the mould with cement paste.
3. Cover the mould with another piece of lightly oiled glass sheet and immediately submerge the whole assembly in water at $27 \pm 2^\circ\text{C}$ and keep it there for 24 h.
4. Measure the distance separating the indicator points. Submerge the mould again in water and bring it to boil in 25-30 minutes. Keep it boiling for 3 hours. Remove the mould from water and allow it to cool.
5. Measure the distance between the indicator points. Difference between two measurements gives the expansion of cement.
6. Report the results in the Form CC-2

Soundness of Cement by Le-Chatelier Method

Form CC-2

Specimen No.	Wt. of cement W (g)	Distance separating the indicator points (mm)	
		Before submergence	After submergence

Permissible value 10 mm

Method 2 : Autoclave Method


1. A cement paste shall be made with 500g of cement and sufficient water to give standard consistency.
2. A mould of 25 mm x 25 mm size and internal length of 282 mm shall be thinly oiled; and filled with cement paste in two layers; compacting with thumb or forefingers by pressing the paste into corners. After compacting the top layer, flush it with a trowel.
3. Remove the specimen from the mould after 24 ± 0.5 h and place it in the autoclave at room temperature in a rack so that the four sides of each specimen are exposed to saturated steam.
4. Initially the air will be allowed to escape from the autoclave by keeping the vent valve open. The valve shall be closed when the steam begins to escape and the gauge pressure of autoclave allowed to reach 2.1 MPa in about 1 to 1.25 h from the time the heat is turned on.
5. Maintain the pressure of 2.1 ± 0.1 MPa for 3 hours. Shut off the heat supply and allow it to cool at a rate such that pressure comes down to 0.1 MPa at the end of one hour. Any pressure remaining shall be released.
6. Open the autoclave and immediately keep the test specimen in water, the temperature of which is above 90°C . The water surrounding the specimens is cooled at a uniform rate to $27+2^{\circ}\text{C}$ in 15 min. The temperature of water is then maintained at $27+2^{\circ}\text{C}$ for 15 min.
7. Take the specimens out of water, make them surface dry and measure their lengths.
8. The difference in lengths of the test specimen before and after autoclaving shall be calculated to the nearest 0.01 percent of the effective gauge length which is the length between the innermost points of the metal inserts used as reference points shall be reported as the autoclave expansion of the cement. A contraction (negative expansion) shall be indicated by prefixing a minus sign to the percentage expansion reported.

Reference I.S. 4031 (Part3) - 1988

800.3 Compressive Strength of Cement

Purpose

The compressive strength of hardened cement is the most important property as it controls the mix design. Strength tests are not conducted on neat cement paste because of difficulties of excessive shrinkage and subsequent cracking. Strength of cement is therefore found indirectly, by testing cement mortar in a specific proportion.

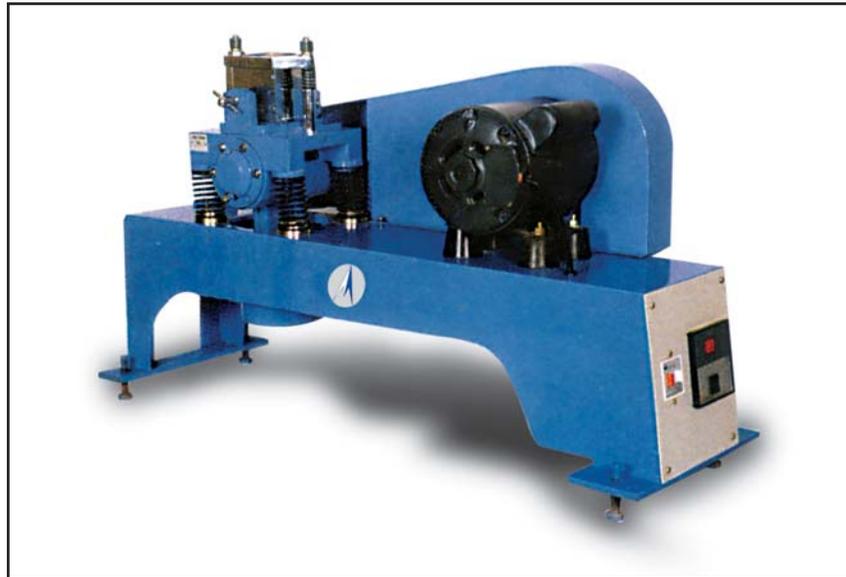

VIBRATING MACHINE FOR CEMENT CUBES



HAND OPERATED COMPRESSION TESTING MACHINE

Procedure

1. Take 200 g of Cement and 600 g of Standard Sand (Ennore) in a non-porous enamel tray and mix them with a trowel for one minute, then add water equal to $(P/4 + 3.5)$ percent of combined weight of cement and sand and mix the three ingredients thoroughly until the mixture is of uniform colour. The time of mixing should not be less than 3 min.
2. Immediately after mixing, the mixture is filled into a cube mould of 7.06cm; the area of each face being 50 sq.cm.
3. Compact the mortar either by placing it on the vibrationing table for two minutes at the specified speed of 12000 ± 400 vibrations per min.
4. Keep the compacted cube in the mould at a temperature of $27^{\circ}C \pm 2^{\circ}C$ and at least 90 percent humidity for 24 h.
5. At the end of 24 h, remove the moulds and immediately submerge them in clean fresh water and keep them there until taken out just before conducting the test.
6. Test three cubes for compressive strength after 3 days and 7 days. The cubes shall be tested on their sides without any packing. The rate of loading shall be 35 N/mm² per min.
7. The compressive strength is calculated by dividing the maximum load applied to the cubes during the test divided by the cross sectional area.

Compressive Strength of Cement**Form CC-3**

S.No.	Compressive Strength after 3 days				Compressive strength after 7 days			
	Observations			Average Strength	Observations			Average Strength
	Plan Area A (mm ²)	Load at Failure W(N)	Comp.Strength N/mm ²		PlanArea A(mm ²)	Load at FailureW(N)	Comp.Strength N/mm ²	

Reference : I.S. 4031 (Part 6) – 1988

800.6 Deleterious Materials and Organic Impurities**Purpose**

Dredged sand from river beds contains decayed vegetable matter, humus, organic matter and other impurities, particularly when there is not much flow in the river. The organic matters interface with the setting action of cement and the bond characteristics of aggregates. Moss and algae results in air entrainment reducing its strength; excessive silt and clay result in greater water requirement, increased shrinkage and increased permeability.

Procedure

1. Organic Impurities

Mix the soil sample with 3% solution of Sodium hydroxide in water. Keep it for 24 h and compare the color development with a standard color chart. If the color of sample is darker than the standard color, organic impurities are more than permissible, and either the sample should be rejected or corrective measures taken.

2. Clay, Fine silt and Fine Dust

1. Pour a sample of aggregate into a graduated measuring jar containing water and rod the aggregate nicely to remove the particles of clay and silt adhering to aggregate particles.
2. Shake the jar so that all the clay and silt particles get mixed with water and keep it in undisturbed condition.
3. Measure the thickness of layer of clay and silt standing over the fine aggregate particles to calculate the percentage of clay and silt in the sample of aggregate.
4. The limits of deleterious material as given in IS 383 1970 are given below. Please note that the sum of the percentages of all the deleterious material should not exceed 5.

Table 800.6.1 Limits of Deleterious Materials

Deleterious Substance	Fine Aggregate		Coarse Aggregate	
	Uncrushed	Crushed	Uncrushed	Crushed
Coal and Lignite	1.00	1.00	1.00	1.00
Clay Lumps	1.00	1.00	1.00	1.00
Soft Fragments	-	-	3.00	-
Material passing 75 micro sieve	3.00	3.00	3.00	3.00
Shale	1.00	-	-	-

Reference: I.S. 2386 (Part 2) - 1963

800.8 Crushing Strength of Coarse Aggregates

Apparatus

Apparatus for the standard test shall consist of the following:

- (a) A 15 cm diameter open ended steel cylinder, with plunger and base plate. The surfaces in contact with the aggregate shall be machined and case-hardened.
- (b) A compression testing machine capable of applying a load of 40 tonnes and which can be operated to give a uniform rate of loading so that the maximum load is reached in 10 min. The machine may be used with or without a spherical seating.

Preparation of Test Sample

The material for the standard test shall consist of aggregate passing a 12.5 mm IS Sieve and retained on a 10 mm IS Sieve, and shall be thoroughly separated on these sieves before testing.

Test the aggregate in a surface-dry condition. If dried by heating. The period of drying shall not exceed four h, the temperature shall be 100°C to 110°C and the aggregate shall be cooled to room temperature before testing.

The quantity of aggregate shall be such that the depth of material in the cylinder, after tamping shall be 10 cm.

The appropriate quantity may be found conveniently by filling the cylindrical measure in three layers of approximately equal depth, each layer being tamped 25 times with the rounded end of the tamping rod and

Determine the weight of material comprising the test sample and take the same weight of sample for the repeat test.

Test Procedure - Put the cylinder of the test apparatus in position on the base-plate and the test sample added in thirds, each third being subjected to 25 strokes from the tamping rod. The surface of the aggregate shall be carefully leveled and the plunger inserted so that it rests horizontally on this surface, care being taken to ensure that the plunger does not jam in the cylinder.

Place the apparatus with the test sample and plunger in position, between the platens of the testing machine and loaded at as uniform a rate as possible so that the total load is reached in 10 min. The total load shall be 40 tonnes.

Replace the load and remove the whole of the material from the cylinder and sieve on a 2.36 mm IS Sieve for the standard test. The fraction passing the sieve shall be weighed (Weight B)

In all of these operations, care shall be taken to avoid loss of the fines.

Two tests shall be made.

Calculation

Express the ratio of the weight of fines formed to the total sample weight in each test as a percentage, the result being recorded to the first decimal place:

$$\text{Aggregate crushing value} = \frac{B}{A} \times 100$$

Where

B = weight of fraction passing the appropriate sieve, and

A = weight of surface-dry sample.

Report the results in Form CC - 4

Crushing Strength of Coarse Aggregate

Form CC-4

S.No.	Wt. of the Container C (g)	Wt. of Surface Dry Specimen + Container A (g)	Wt. of Fines Passing 2.36 mm + Container B (g)	Crushing Value B - C = -----x 100 A - C


800.11 Alkali Aggregate Reactivity

Purpose

The purpose of the test is to assess the potential alkali aggregate reactivity so that the suitability of aggregates could be judged.



LENGTH COMPARATOR

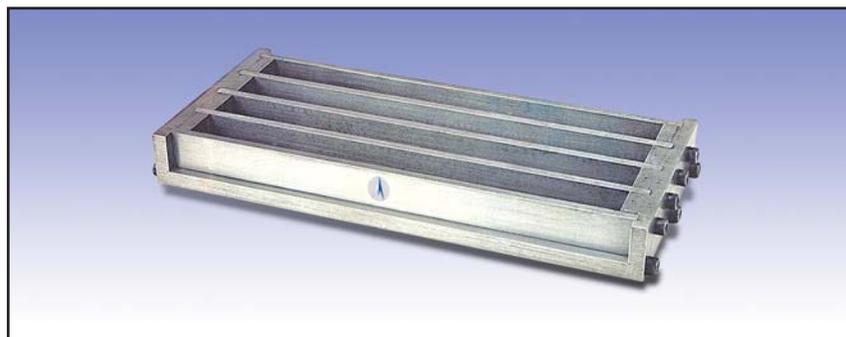

BAR MOULD

Procedure

- Using the standard moulds for the mortar bar tests, and using the grading given below, prepare at least four mortar bars for test as per the procedure given below:

Table 800.11.1 Grading of Fine Aggregates for Alkali Aggregate Reactivity Test

Sieve Size		Percentage Weight
Passing	Retained on	
4.75 mm	2.36 mm	10
2.36 mm	1.10 mm	25
1.10 mm	600 micron	25
600 micron	300 micron	25
300 micron	150 micron	15

- Cover the moulds thinly with mineral oil and set the gauge studs in position, taking care to keep them clean and free of oil.
- Apply a mixture of three parts of paraffin to five parts of resin by weight, heated between 110°C and 120°C to the outside contact lines of the moulds to make them water tight.
- Proportion the dry materials for the test mortar using 1 part of cement to 2.25 parts of graded aggregate by weight. The required quantities for 2 mortar bars are 300g of cement and 675 g of aggregate.
- Use an amount of water which gives a flow of 105 to 120 as determined on the flow table except that the flow table shall be given 12.5 mm drops in approximately 6 sec instead of twenty five, 12.5 mm drops in 15 sec.
- Place the material in the bowl using following sequence
 - Place the water in the dry bowl.
 - Add cement to water, mix for 30 sec
 - Add approximately half the aggregate and mix for 30 sec
 - Add the remainder aggregate and mix for 1 ½ min.
- Mix the mortar in the bowl by vigorous and continuous squeezing and kneading with one hand protected by a glove.
- Immediately after the mixing, fill the mould in two layers, each layer being compacted with the tamper. Work the mortar into corners, around the gauge studs and along the surface of the mould with the tamper till a homogeneous specimen is obtained. After the top layer has been compacted, cut off the mortar flush with the top of the mould and smooth the surface with a few strokes of the trowel.
- Keep the mould in the moist room immediately after filing, for a period of 24 ± 2 hours.

10. Remove the test specimen after 24 ± 2 h from the mould and measure the length using a comparator; at a temperature of $27^0 \pm 2^0$ C.
11. After the initial measurement, place the specimen on end in a metal or plastic container maintained at $38^0 \pm 2^0$ C.
12. When length measurements are to be made. Subsequently, remove the container holding the specimen from the storage and place it in a room at a temperature of $27^0 \pm 2^0$ C.
13. Each time length measurements are made clean the container and change the water after measurements, replace the specimen in inverted position as compared with the previous storage period.
14. Measure the length of the specimen at ages of 1, 2, 3, 6, 9 and 12 months and if necessary every six months thereafter. Calculate the difference in length of the specimen when removed from the moulds at one day and any subsequent period to the nearest 0.001 percent of effective gauge length as expansion.
15. Report the average of the expansion of the four specimens of a given cement aggregate combination to the nearest 0.001 percent as the expansion for a given period.
16. Note and report the following at the end of the testing period.
 - (a) Warping – measured to the nearest 0.2 mm
 - (b) Presence, location and pattern of cracking
 - (d) Appearance of surfaces, surface mottling .
 - (e) Superficial deposits or exudations, their nature thickness and continuity.

Reference IS : 2386 (Part VII) – 1963

800.16 Mix Design for Each Work

Purpose

It is necessary to develop an optimum concrete mix for use at site to ensure economy and durability.

Procedure

Concrete Mix may be developed by trial and error. Any standard procedure such as those given in Indian Standards IS : 10262-1982 and SP 23 (S & T) – 1982 may be used. The mix so developed must be approved by the Executive Engineer in charge of works before use at site.

800.17 Moisture Content of Coarse and Fine Aggregate

Purpose

The strength of concrete depends upon the amount of water present in it, hence the importance.

Procedure

Oven drying methods as described under the clause 301.7 shall be used for this purpose. The moisture content of aggregates can be determined separately for coarse and fine aggregates as well as for the combined aggregates.

800.18 Cement Consumption

Purpose

Cement being a costly commodity, its consumption affects the total cost.

Procedure

Cement must be stored properly on wooden platforms, stacking not more than eight bags high and at least 450mm clear off the walls. The contractor shall keep proper records in respect of type of cement, lot no., date of manufacture, manufacturer's certificate regarding quality, test results, and its consumption on various works from time to time.

800.19 Workability of Concrete by Slump Test

This method of test may be used in the laboratory or during the progress of work in the laboratory or during the progress of work in the field, for determining the consistency of concrete where the nominal maximum size of the aggregate does not exceed 38 mm.

Apparatus

Mould - The mould for test specimen shall be in the form of the frustum of a cone having the following internal dimensions :

Dimensions	Cm
Bottom diameter	20
Top diameter	10
Height	30

The mould shall be constructed of metal (brass or aluminum shall not be used) of at least 1.6 mm (or 16 BG) thickness and the top and bottom shall be open and at right angles to the axis of the cone. The mould shall have a smooth internal surface. It shall be provided with suitable foot pieces and also handles to facilitate lifting it from the moulded concrete test specimen in a vertical direction as required by the test. A mould provided with a suitable guide attachment may be used.

Sampling

In the case of concrete containing aggregate of maximum size more than 38 mm, screen the concrete through 1 ½ inch screen to exclude aggregate particles larger than 38 mm.

Procedure

Clean thoroughly the internal surface of the mould so that it is free from superfluous moisture and any set concrete before commencing the test. Place the mould on a smooth, horizontal, rigid and non-absorbent surface, such as a carefully leveled metal plate, the mould being firmly held in place while it is being filled. Fill the mould in four layers, each approximately one - quarter of the height of the mould. Each layer with twenty five strokes of the rounded end of the tamping rod. The strokes in a uniform manner over the cross-section of the mould and for the second and subsequent layers penetrate into the underlying layer. The bottom layer shall be tamped throughout its depth. After the top layer has been rodded, the concrete shall be struck off level with a trowel or the tamping rod, so that the mould is exactly filled. Any mortar which may have leaked out between the mould and the base plate

shall be cleaned away. The mould is removed from the concrete immediately by raising it slowly and carefully in a vertical direction. This allows the concrete to subside and the slump shall be measured immediately by determining the difference between the height of the mould and that of the highest point of the specimen being tested. The above operations shall be carried out at a place free from vibration or shock, and within a period of two min after sampling.

Slump - The slump measured shall be recorded in terms of millimetres of subsidence of the specimen during the test. Any slump specimen which collapses or shears off laterally gives incorrect result and if this occurs the test shall be repeated with another sample. If, in the repeat test also, the specimen should shear, the slump shall be measured and the fact that the specimen sheared, shall be recorded.

800.20 Workability of Concrete by Compaction Factor Test

Compacting Factor Test

This clause specifies a procedure for determining the workability of concrete, where the nominal maximum size of the aggregate does not exceed 38 mm. The test is designed primarily for use in the laboratory, but if circumstances permit, it may also be used in the field. It is more precise and sensitive than the slump test and is particularly useful for concrete mixes of very low workability as are normally used when concrete is to be compacted by vibration; such concrete may consistently fail to slump.

Procedure

The sample of concrete to be tested gently in the upper hopper, using the hand scoop. Fill the hopper with its brim and open the trap door so that the concrete falls into the lower hopper. Certain mixes have a tendency to stick in one or both of the hoppers. If this occurs, the concrete may be helped through pushing the rod gently into the concrete from the top. During this process, cover the cylinder by trowels. Immediately after the concrete has come to rest, the cylinder shall be un-covered, the trap-door of the lower hopper opened, and the concrete allowed to fall into the cylinder. The excess of concrete remaining above the level of the top of the cylinder shall then be cut off by holding a trowel in each hand, with the plane of the blades horizontal, and moving them simultaneously one from each side across the top of the cylinder, at the same time keeping them pressed on the top of the cylinder. Wipe clean the outside of the cylinder. The above operation shall be carried out at a place free from vibration or shock. The weight of the concrete in the cylinder shall then be determined to the nearest 109 g. This weight shall be known as the weight of partially compacted concrete. The cylinder shall be refilled with concrete from the same sample in layers approximately 5 cm deep, the layers being heavily rammed or preferably vibrated so as to obtain full compaction. The top surface of the fully compacted concrete shall be carefully struck off level with the top of the cylinder.

Calculation

The compacting factor is defined as the ratio of the weight of partially compacted concrete to the weight of fully compacted concrete to the weight of fully compacted concrete. It shall normally be stated to the nearest second decimal place (Form CC – 5).

Workability of Concrete

Form CC – 5

Sample Identification No. :	
Date of Testing :	No. of Sample
Quality of Concrete	Good / Bad
Weight of water (g)	

S.No.	Specimen No.	Concrete taken from (Place)	Value of Slump Test or compacting factor test

Layer	Value	Permissible Value	
		Slump	10-25 mm
		Compacting Factor	0.87 ± .03

Checked By

Tested by

800.22 Curing of Concrete**Purpose**

Curing is the process for preventing the loss of moisture from the concrete. Prevention of moisture is necessary for concrete to develop strength.

Procedure

1. Start curing immediately after the compaction of concrete.
2. Use water which is good for construction (clause 600.9)
3. Protect the concrete by covering with moist gunny bags, canvas, Hessian or similar material.
4. Keep all exposed surface of concrete after 24 hours in a wet or damp condition by pounding or by covering with a layer of sacks, canvas, Hessian or similar material.
5. Keep the surface wet for a period of not less than 14 days from the date of placing of concrete.

800.23 Schmidt's Rebound Hammer Test

Purpose

Rebound hammer test is used for assessing the likely compressive strength of concrete with the help of suitable correlation between rebound index and compressive strength.

Acceptance Criterion

A correlation should be developed by simultaneously testing the two properties on the same sample and used for establishing acceptance criterion.



REBOUND HAMMER

800.24 Ultrasonic Pulse Velocity

Purpose

Ultrasonic Pulse Velocity method is used to estimate the quality of in-situ concrete.



ULTRA SONIC PULSE VELOCITY TESTER

If the pulse velocity of concrete by cross probing is 3.0 km/sec or more, the concrete is of acceptable quality. If the velocity is less than 3 km/sec, further investigations are called for.

Method

1. Take two transducers operating in the frequency range of 20 KHz to 150 KHz. Keep one transducer in contact with one end of concrete member and the other transducer with the other surface of the concrete member.
2. Measure the length L of the pole and also time taken T for the pulse to travel this distance. Thus the average velocity = L/T
3. Use the following chart to get some idea about the quality of concrete; however, correlations developed at site are the best.

Table 800.24.1 Ultrasonic Pulse Velocity and Quality of Concrete

S.No.	Pulse Velocity km/sec	Concrete Quality Grading
1.	Above 4.5	Excellent
2.	3.5 to 4.5	Good
3.	3.0 to 3.5	Medium
4.	Below 3.0	(Doubtful further investigations necessary)

Reference IS: 13311(Part 1) - 1992

800.25 Accelerated Curing Test of Concrete

Purpose

Normally, the strength of concrete is found out after 7 days and 28 days. For some construction activities, it may be too late and no need to know the strength earlier.



ACCELERATED CURING TANK

Tolerances

Tolerances can be specified depending upon the required strength of the concrete and its importance.

Method

1. Prepare the specimen and store it in moist air of at least 90% relative humidity and at a temperature of $27 \pm 2^\circ\text{C}$ for 23 hrs \pm 15 minutes.
2. Lower the specimen, into a curing tank with water at 100 deg C and keep it totally immersed for 3 ½ hours \pm 5 minutes.
3. The temperature of water shall not drop more than 3°C after the specimens are placed and should return to boiling within 15 minutes.
4. After curing for 3 ½ hours \pm 5 minutes in the curing tank, the specimen shall be removed from the moulds and cooled by immersing in cooling water $27 \pm 2^\circ\text{C}$ for a period of at least one hour.
5. The corresponding strength at 28 days can be found out from the following correlation. (It is however suggested that a new specific correlation should be developed for the specific concrete used at site.)

$$R_{28} = \text{strength at 28 days} = 8.09 + 1.64 R_a$$

Where R_a = Accelerated Curing Strength in MPa.

Reference IS : 9013 - 1978

800.26 Compressive Strength of Concrete Cubes (150 mmx 150 mmx 150 mm) at 28 days

Purpose

The tests are required to determine the strength of concrete and therefore its suitability for the job.



HAND OPERATED COMPRESSION TESTING MACHINE



MOULDS

Tolerance Limits

Tolerances are specified depending upon the importance of structure, for roads, it may be necessary to get 80% of samples having strength more than specified.

Method

1. Representative samples of concrete shall be taken and used for casting cubes 15cmx15cmx15cm or cylindrical specimens of 15cm dia x 30cm long.
2. The concrete shall be filled into the moulds in layers approximately 5cm deep. It would be distributed evenly and compacted either by vibration or by hand tamping. After the top layer has

been compacted, the surface of concrete shall be finished level with the top of the mould using a trowel; and covered with a glass plate to prevent evaporation.

3. The specimen shall be stored at site for $24 \pm \frac{1}{2}$ h under damp matting or sack. After that, the samples shall be stored in clean water at $27 \pm 2^\circ\text{C}$; until the time of test. The ends of all cylindrical specimens that are not plane within 0.05 mm shall be capped.
4. Just prior to testing, the cylindrical specimen shall be capped with sulphur mixture comprising 3 parts sulphur to 1 part of inert filler such as fire clay.
5. Specimen shall be tested immediately on removal from water and while they are still in wet condition.
6. The bearing surface of the testing specimen shall be wiped clean and any loose material removed from the surface. In the case of cubes, the specimen shall be placed in the machine in such a manner that the load cube as cast, that is, not to the top and bottom.
7. Align the axis of the specimen with the steel platen, do not use any packing.
8. The load shall be applied slowly without shock and increased continuously at a rate of approximately 140 kg/sq.cm/min until the resistance of the specimen to the increased load breaks down and no greater load can be sustained. The maximum load applied to the specimen shall be recorded and any unusual features noted at the time of failure brought out in the report.
9. Present the results in the Form of CC- 6

Compressive Strength of Concrete Cubes

Form CC-6

Sample Identification No.:		Age (Days) 7 and 28 days			
Date of Testing :		Minimum No. of Samples = 3 for each test			
Temperature and Humidity		$27 \pm 2^\circ\text{C}$, Relative Humidity = 90%			
Mix Proportion by weight		As specified or as per Mix Design IRC :44/IS:10262-1982			
Rate of Loading		140 kg/sqcm/minute			
Workability		As per the requirement or Slump / Compaction Factor			
S.No.	Specimen No.	Plan Area of cube mould 150 mm x 150 mm A_p	Maximum Applied Load just before failure at 7 and 28 days (kg) W_f	Compressive Strength (kg/cm ²)	
				$S_a = \frac{W_f}{A_p}$ 7 days	28 days
1					
2					
3					
Average flexural strength of concrete sample (kg/cm ²) at 7 and 28 days nearest to 1 kg/sqcm					

Layer	Value	Permissible Limit	
		Specified compressive strength of concrete sample (kg/cm ²) at 7 and 28 days	Individual Variation = + 15% of the average

Checked by

Tested by

Reference IS: 516 – 1959

800.27 Flexural Strength of Concrete**Purpose**

To determine the Flexural Strength of Concrete, which comes into play when a road slab with inadequate subgrade support is subjected to wheel loads and / or there are volume changes due to temperature / shrinking.

Procedure

Test specimens shall be prepared by moulding concrete to a beam section, curing and storing in accordance with standard procedure. The section of the beam shall be square of 100 mm or 150 mm. The overall length of the specimen shall be 4d to 5d. The ratio of d to the maximum particle size of aggregate shall be not less than three.

Circular rollers manufactured out of steel having cross section with diameter 20 to 40 mm will be used for providing support and loading points to the specimens. The length of the rollers shall be at least 10 mm more than the width of the test specimen. A total of four rollers shall be used, three out of which shall be capable of rotating along their own axes. The distance between the outer rollers (i.e span) shall be 3d and the distance between the inner rollers shall be d. The inner rollers shall be equally spaced between the outer rollers, such that the entire system is systematic.

The specimen stored in water shall be tested immediately on removal from water; whilst they are still wet. The test specimen shall be placed in the machine correctly centered with the longitudinal axis of the specimen at right angles to the rollers. For moulded specimens, the mould filling direction shall be normal to the direction of loading.

The load shall be applied slowly without shock at such a rate as to increase the stress at a rate of $.06 \pm .04$ N/ mm² per second.



FLEXURE TEST APPARATUS

The Flexural Strength is given by

$$F_{ct} = \frac{F \times l}{d_1 \times d_2^2}$$

Where F is the breaking load (in N), d_1 and d_2 are the lateral dimensions of the cross section in mm.

l is the distance between supporting rollers (in mm)

Present the results in Form CC-7

Flexural Strength of Concrete Beam

Form CC-7

Sample Identification No.:			Age (Days) 7 and 28 days		
Date of Testing :			Minimum No. of Samples = 3 for each test		
Temperature and Humidity			27 ± 2°C, Relative Humidity = 90%		
Mix Proportion by weight			As specified or as per Mix Design IRC :44/IS:10262-1982		
Rate of Loading			7 kg/sqcm/minute or 100 kg/minute		
Workability			As per the requirement or Slump / Compaction Factor		
S.No.	Specimen No.	Size of beam mould 10x10x50 L - 40cm B - 10cm D - 10cm L - Effective Length B - Breadth D - Depth	Maximum Applied Load just before failure at 7 and 28 days (at two points) as per IS : 516-1959 (kg) W	Flexural Strength (kg/cm ²) ($W_f L/BD^2$) if a > 11cm ($3W_f L/BD^2$) if a less than 13.3cm but greater than 11cm a= equals the distance between the line of fracture and the nearest support measured on central line of the tensile side of the specimen	
				7 days	28 days
1					
2					
3					
Average flexural strength of concrete sample (kg/cm ²) at 7 and 28 days					
Nearest to 0.5 kg/sqcm					
Specified flexural strength of concrete sample (kg/cm ²) at 7 and 28 days					

Layer	Value	Permissible Limit	
		Specified flexural strength of concrete sample (kg/cm ²) at 7 and 28 days	Individual Variation = + 15% of the average The flexural strength of concrete for pavement quality concrete or roller compacted concrete for wearing course shall not be less than 40 kg/cm ²

Checked by

Tested by

Reference : IS : 516 - 1959

—◆—
SECTION 900

**FORMWORK AND
SURFACE FINISH FOR
STRUCTURES**



901 Materials and Design

All materials, design, erection and removal of formwork shall conform to IRC: 87 “Guidelines for Design and Erection of Falsework for Road Bridges” and these Specifications.

The forms shall be constructed with metal or timber. The Contractor shall submit the design and drawings of complete formwork (i.e. the formwork as well as its supports) for the approval of the Engineer before any erection is taken up.

902 CONSTRUCTION OPERATIONS

Forms shall be mortar-tight and shall be made sufficiently rigid by the use of ties and bracings to prevent any displacement or sagging between supports. They shall be strong enough to withstand all pressures, ramming and vibration, without deflection from the prescribed lines occurring during and after placing the concrete.

The inside surfaces of forms shall be coated with a release agent supplied by an approved manufacturer or a material approved by the Engineer to prevent adhesion of concrete to the formwork. Release agents shall be applied strictly in accordance with the instructions of the manufacturer and shall not be allowed to come in contact with the reinforcing steel.

The workmanship of formwork shall be strong and joints shall be leak-proof.

903 REMOVAL OF FORMWORK

The scheme for removal of formwork (i.e. de-shuttering and decentering) shall be planned in advance and furnished to the Engineer for scrutiny and approval

Where not approved, the time of removal of formwork (when Portland Cement is used without any admixtures at an ambient temperatures exceeding 10°C) shall as under

- | | | | |
|-----|---|---|--|
| (a) | Walls, piers, abutments, columns and vertical faces of structural members | : | 12 to 48 hours as shall be decided by the Engineer |
| (b) | Soffits of slabs (with props left under) | : | 3 days |
| (c) | Props (left under slabs) | : | 14 days |
| (d) | Soffit of girders (with props left under) | : | 7 days |
| (e) | Props (left under girders) | : | 21 days |



SECTION 1000

STEEL REINFORCEMENT



1000 STEEL REINFORCEMENT

Sec No.	Title	Test Ref No.
A) Material		
1000.1	Grade, Percentage Elongation and Ultimate Tensile Strength of Steel	1000.1
1000.2	Pitch of the Ribs and Nominal Diameter	1000.2
1000.3	Bending and Placing of Reinforcement	As specified
1000.4	Splicing, Welding and Tolerances	As specified
B) Construction & Workmanship		
1000.5	Routine Inspection and Testing	1000.5
1000.6	Tolerances and General Workmanship	As specified

A Materials

1000.1 Grade, Percentage Elongation and Ultimate Strength of Steel

The maximum load reached in a tensile test divided by the effective cross-sectional area of the gauge length portion of the test piece. Also termed as ultimate tensile strength.

Yield Stress

Stress (that is load per unit cross sectional area) at which elongation first occurs in the test piece without increasing the load during tensile test.

1000.2 Pitch of the Ribs and Nominal Diameter of Bars

Deformed steel bars for use as reinforcement in concrete are available in three strength grades as Fe 415 (N/mm²), Fe 500 (N/mm²) and Fe550 (N/mm²)

Normal Size Diametres

Their sizes are:

Nominal Size (Diameter) (mm)	Cross Sectional Area (mm ²)	Mass Per Run (kg)
4	12.6	0.099
5	19.6	0.154
6	28.3	0.222
7	38.5	0.302
8	50.3	0.395
10	78.6	0.617
12	113.1	0.888
16	201.2	1.58
18	254.6	2.00
20	314.3	2.467
22	380.3	2.985
25	491.1	3.855
28	616.0	4.836
32	804.6	6.31
36	1018.3	7.99
40	1257.2	9.869
45	1591.1	12.490
50	1964.3	15.424

Note : - The nominal size (diameter) of a deformed bar is equal to that of a plain round bar having the same mass per meter length.

Tolerances

On specified lengths + 75 mm
- 25 mm

On minimum length + 50 mm
- 0 mm

Nominal Mass - For the purpose of checking the nominal mass, the density of steel shall be taken as 0.00785 kg/mm² of cross sectional area per meter run.

Mechanical Properties of High Strength Deformed Bars and Wires

Property	Fe415	Fe500	Fe550
(i) 0.2 percent proof stress/ yield stress, Min (N/mm ²)	415.0	500.0	550.0
(ii) Elongation, percent, Min, (on gauge length of 5.65 √A, where A is the cross sectional area)	14.5	12.0	8.0

(iii) Tensile strength, Min	10 per cent more than the actual 0.2 percent proof stress but not less than 485.0 N/mm ²	8 percent more than the actual 0.2 percent proof stress but not less than 545.0 N/mm ²	6 percent more than the actual 0.2 percent proof stress but not less than 585.0 N/mm ²
-----------------------------	---	---	---

Chemical Composition

Constituent	Percent, Maximum		
	Fe 415	Fe 500	Fe 550
Carbon	0.30	0.30	0.30
Sulphur	0.060	0.055	0.055
Phosphorus	0.060	0.055	0.050
Sulphur and Phosphorus	0.11	0.105	0.10

High Tensile Steel Bars used in Prestressed Concrete

High tensile steel bars (alloy steel having tensile strength of not less than 980 N/mm²) are used in prestressed concrete.

Freedom from Defects – Finished bars shall be sound and free from splits, harmful surface flaws, rough, jagged and imperfect edges, and other defects.

Nominal Sizes – 10, 12, 16, 20, 22, 25, 28 and 32 mm diameter

Tolerances

- a) Nominal size \pm 0.50 mm for bars upto 25 mm
 \pm 0.6 mm for bars above 25 mm
- b) Mass \pm 5 percent (weight calculated on the basis that high tensile steel weighs 0.785 kg/cm² of cross sectional area per meter run) for bars upto 16mm.
 \pm 3 percent (weight calculated on the basis that high tensile steel weighs 0.785 kg/cm² of cross sectional area per meter run) for bars above 16mm.

Physical Requirement

1. Tensile Strength, Min – 980 N/mm²
2. Proof Stress – Not less than 80 percent of the minimum specified tensile strength
3. Elongation at Rupture on a gauge length $5.65 \sqrt{A}$, where A is the area of cross section – Min 10 percent.

Relaxation – Relaxation of stress shall not exceed 49 N/mm² at the end of 1000 h.

B Construction & Workmanship

1000.5 Routine Inspection and Testing

As per IS : 1786-1985, all steel shall be subject to routine inspection and testing by the manufacturer or supplier in accordance with this standard shall be kept by the manufacturer or the supplier. The records shall be available for inspection by the purchaser or his representative.

In the case of material delivered to a supplier, the manufacturer shall supply a certificate containing the results of all the required tests on samples taken from the delivered material.

Such certificates should be obtained by the quality control personnel. However, in case of any doubt, tests may be performed at a standard laboratory.

References IS : 1786 – 1985

IS : 2090 - 1983



SECTION 1100

PIPE CULVERTS



1100 PIPE CULVERTS

Sec No.	Title	Test Ref No.
A) Materials		
1100.1	Colour and Dimensional Check of Bricks	600.1
1100.2	Water Absorption of Bricks	600.2
1100.3	Efflorescence of Bricks	600.3
1100.4	Compressive Strength of Bricks	600.4
1100.5	Shape and Dimensions of Stones	700.1
1100.6	Water Absorption of Stones	700.2
1100.7	Dressing of Stones	700.3
1100.8	Dimensions of Concrete Pipes	1100.8
1100.9	Manufacturing Defects and Tolerances	As per IS 458
1100.10	Three Edge Bearing Test	1100.10
B) Construction & Workmanship		
1100.11	Height, Bond and Verticality by Plumb Bob	700.14
1100.12	Consistency of Cement Mortar	600.10
1100.13	Compressive Strength of Mortar	600.12
1100.14	Thickness of Joints in General Brick Work	600.13
1100.15	Invert Level, Longitudinal Gradient	Using Surveying Equipment
1100.16	Measurements of Length, Internal Diameter, Barrel Thickness	1100.8

A Materials

1100.8 Dimensions of Concrete Pipes (Measurement of Length, Internal Diameter, Barrel Thickness)

Purpose

To check whether dimensions are within tolerance limits.

Procedure

A vernier caliper with a least count of 0.1 mm shall be used. The measured dimensions should be within the tolerances specified in IS 458.

Typical permitted tolerances for diameter and thickness are,

- (i) Pipe diameter over 600 mm and upto and including 1200 mm is +/- 7 mm.
- (ii) Wall thickness over 80 mm and upto and including 95 mm is +/- 6 mm

1100.10 Three Edge Bearing Test

Purpose

This test is carried out on both reinforced concrete and prestressed concrete pipes and of pressure and non pressure types to evaluate whether it can take the load when put in its place.

Procedure

Three edge bearing test shall be performed when the pipe is surface dry. The test specimen shall be tested in a machine so designed that a crushing force may be exerted in a true vertical plane through one diameter and extending the full length of the barrel of the pipe but excluding the sockets, if any.

Any mechanical or hand powered device may be used in which the head that applies the load moves at such a speed as to increase the load at a uniform rate of approximately 20 percent of the expected crushing load per linear meter per min. The loading device shall be calibrated within an accuracy of ± 2 percent. The testing machine used for the load tests should produce a uniform deflection throughout the length of the pipe.

The lower bearing block shall consist of two hardwood or hard rubber strips fastened to a wooden or steel beam or direct to a concrete base, which shall provide sufficient rigidity to permit application of maximum load without appreciable deflection.

The upper bearing shall be a rigid hardwood block or a block with hard rubber facing at least 150 mm x 150 mm in cross section. After placing the specimen in the machine on the bottom strips, the top bearing shall be symmetrically aligned in the testing machine. Load shall be applied at the rate indicated above until either the formation of 0.25 mm wide crack or ultimate strength load, as may be specified, has been reached. The 0.25 mm crack load is the maximum load applied to the pipe before a crack having a width of 0.25 mm measured at close intervals, occurs throughout a length of 300 mm or more. The crack shall be considered 0.25 mm in width when the point of the measuring gauge penetrates 1.5 mm at close intervals throughout the specified distance of 300 mm. The ultimate load will be reached when the pipe will sustain no greater load.

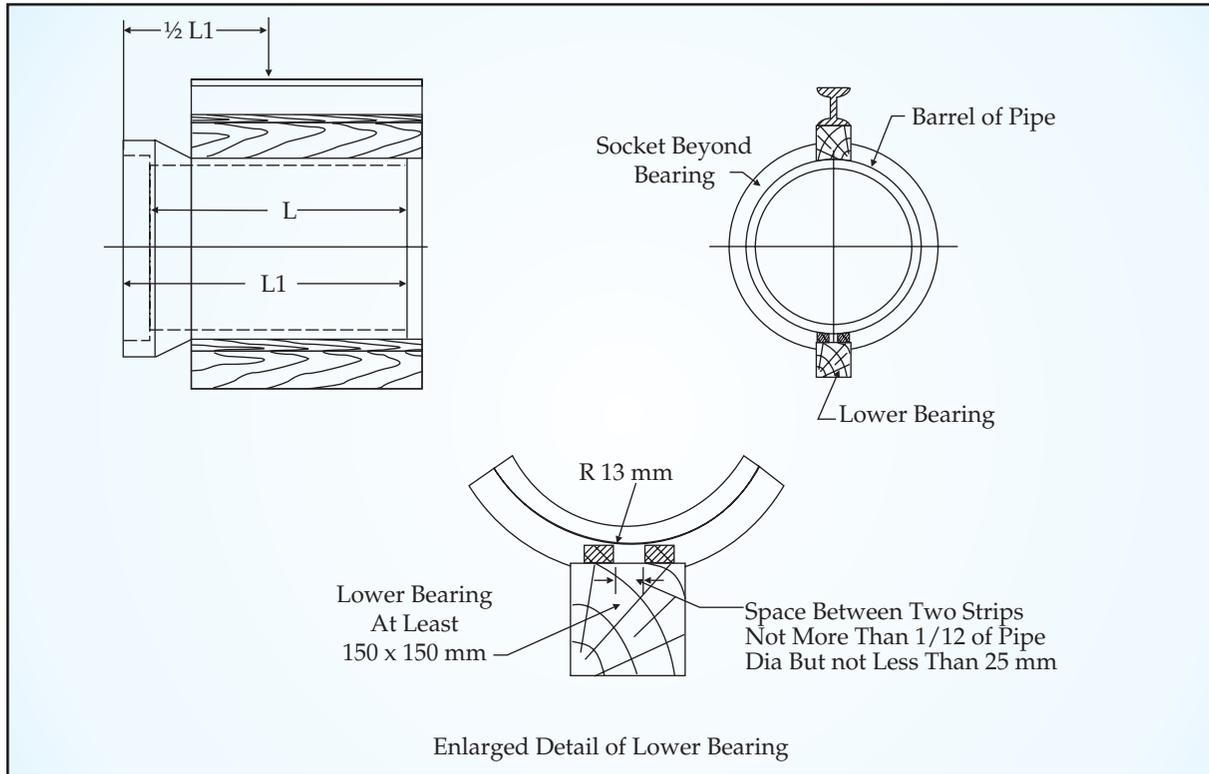


Figure 11. Three Edge Bearing

The crushing strength in Newton per linear meter of pipe shall be calculated by dividing the total load on the specimen by the nominal laying length. Effective length of the pipe shall be taken as the nominal laying length of the specimen.

Reference: IS : 3597 – 1998.



SECTION 1200

**RCC SLAB CULVERTS
AND MINOR BRIDGES**



1200 RCC SLAB CULVERTS AND MINOR BRIDGES

Sec No.	Title	Test Ref No.
A)	Materials	
1200.1	Tests on Bricks	600
1200.2	Tests on Stone	700
1200.3	Tests on Concrete Ingredients	800
1200.4	Tests on Water	600.8
1200.5	Tests on Steel Reinforcement	1000
1200.6	Certification of Composition of steel by the Manufacturer	As specified
1200.7	Certification of Mechanical Properties of steel by the Manufacturer	As specified
B)	Construction & Workmanship	
1200.8	Tolerances in Various Dimensions and Levels	Using Level, Straight Edge and Camber Board etc.
1200.9	Reinforcement Cage	
1200.10	Workability of Concrete	
1200.11	Compaction of Concrete	
1200.12	Curing of Concrete	
1200.13	Compressive Strength of Concrete	800.26
1200.14	Flexural Strength of Concrete	800.27
1200.15	Tests on Sealants (Poly Sulphate or Bituminous)	As specified
1200.16	Test Certificates from the Manufacturers for Elastomeric Bearings, Expansion Joints, Plasticisers	As specified

—◆—
SECTION 1300

**PROTECTION WORKS
AND DRAINAGE**

—◆—

1300 PROTECTION WORKS AND DRAINAGE

Sec No.	Title	Test Ref No.
A)	Materials	
1300.1	Brick Masonry	600
1300.2	Stone Masonry	700
1300.3	Concrete for Structures	800
1300.4	Wire Crates (Size and Mesh Size)	As specified
B)	Construction & Workmanship	
1300.5	Brick Masonry	600
1300.6	Stone Masonry	700
1300.7	Tests on Mortar for Joint	600
1300.8	Cross Sections, Gradient, General Workmanship	Levels, straight edge, measuring tape, visual

—◆—
SECTION 1400

**CEMENT CONCRETE
CAUSEWAY**

—◆—

1400 CEMENT CONCRETE CAUSEWAY

Sec No.	Title	Test Ref No.
A)	Materials	
1400.1	Tests on Bricks	600
1400.2	Tests on Stones	700
1400.3	Tests Cement Concrete Ingredients	800
1400.4	Tests on Pavement Materials GSB,WBM,CC	400,800,1500
B)	Construction & Workmanship	
1400.5	Workability of Concrete	800
1400.6	Curing of Concrete	800
1400.7	Strength of Concrete	800
1400.8	Formwork	900
1400.9	Cement Concrete Pavement	1500
1400.10	Pipes	1100
1400.11	Bearings, Expansion Joints	Manufacturers Specifications
1400.12	Measurement of Dimensions and Level and Joints Thickness	Levels,measuring tape, straight edge,visual

—◆—
SECTION 1500

**PLAIN CEMENT
CONCRETE PAVEMENT**



1501 PLAIN CEMENT CONCRETE PAVEMENTS

Sec No.	Title	Test Ref No.
A)	Materials	
1501.1	Cement	800.1 to 800.3
1501.2	Fine Aggregate	307.10
1501.3	Coarse Aggregate	800
1501.4	Suitability of Water for Use in Concrete	600.8
1501.5	Admixtures	1501.5
1501.6	Dowel Bars	1501.6
1501.7	Premoulded Joint Filler	1501.7
1501.8	Joint Sealing Compound	1501.8
1501.9	Tools Plants and Equipment	1501.9
1501.10	Concrete Mix	1501.10
1501.11	Granular, Sub-base	401
1501.12	Trial Length	1501.12
B)	Construction & Workmanship	
1501.13	Sub-grade and Sub-base	400
1501.14	Gradation & Moisture Content of Aggregate	401.1
1501.15	Concrete Workability	800.15
1501.16	Strength of Concrete	800.17
1501.17	Straightness of side forms	900
1501.18	Size, Spacing, Paralleling of Dowel Bars and Locations of Different Joints	As specified
1501.19	Batching and Mixing of Materials	1501.19
1501.20	Hot / Cold Weather Concreting and Compaction	1501.20
1501.21	Compaction Equipment (Needle, Screed and Plate Vibrators)	1501.21
1501.22	Separation Membrane	1501.22
1501.23	Surface Level	301.10
1501.24	Surface Regularity	301.11
1501.25	Width of Pavement and Position of Paving Edges	As specified
1501.26	Pavement Thickness	As specified
1501.27	Alignment of Joints	As specified
1501.28	Depth of Dowel Bars	As specified
1501.29	Texturing and Edging	As specified

1501.5 Admixtures

Purpose

Admixtures are used to reduce the water content without affecting its workability.

Procedure

The optimum quantity of admixtures is determined by trial tests. The materials and the test procedures should conform to IS:6925 and IS : 9103.

1501.6 Dowel Bars

Purpose

Dowel bars are provided in the joints to permit movements and transfer of stresses.

Procedure

Plain mild steel bars of 25 mm diameter conforming to IS : 432 (Part 1) having minimum yield strength 240 N/mm² shall be used as dowel bars. These shall be free from oil, dirt, loose rust, scale, irregularities and burring restricting slippage in the concrete.

1501.7 Premoulded Joint Filler

Purpose

Joint fillers are used to fill up the joints.

Procedure

Bitumen impregnated filler board, premoulded synthetic joint filler board for expansion joints shall be 20mm thick with a tolerance of ± 1.5 mm and of a firm compressible materials in conformity of the requirements of IS : 1838.

1501.8 Joint Sealing Compound

Purpose

These compounds are used for sealing the joints.

Procedure

Joint sealing compound shall be hot poured sealing compound / type having flexibility, resistance to age hardening and durability. It shall conform to IS : 1834.

1501.9 Tools, Plants and Equipment

Purpose

It is important to ensure that proper tools, plants and equipment are used for carrying out the work.

Procedure

It will be ensured that the tools, plants and equipment used for construction work are as specified in the Contract.

1501.10 Concrete Mix

The Concrete Mix shall conform to the requirements specified in the Contract documents and shall be tested in accordance with the procedure and tests described in Section 800.

1501.12 Trial Length

The trial length will show the materials, equipment and construction proposed to be used for the main construction. It will be checked whether the trial meets with the specifications.

Four full depth cores of at least 100mm (2 cores for each day's work) at 28 days will be cut by core cutting machine. The cores shall be tested as per IS : 516.

The trial length shall satisfy surface levels and regularity; and demonstrate that the joint-forming methodology is satisfactory. The hardened concrete shall be cut over 3m width and reversed to inspect the bottom surface for any segregation taking place.

1501.19 Batching & Mixing of Materials

Purpose

The strength and durability of concrete depends upon the materials, their proportions, and proper mixing.

Procedure

It must be ensured that all batching is done by weight. Volume batching of aggregates may be permitted as a special case in small projects with the approval of the Engineer.

The system of weigh batching will be checked and its calibration carried out from time to time.

1501.20 Hot / Cold Weather Concrete including Compaction

Purpose

Proper precautions must be taken, if concreting is to be done in extreme weather conditions.

Procedure

No concreting shall be done when the concrete temperature is above 30°C measured at the point of placing and the ambient temperature is more than 35°C. Similarly in cold weather, no concreting shall be done when the concrete temperature is below 5°C and the temperature is descending.

1501.21 Compaction Equipment (Needle, Screed and Plate Vibrators)

Purpose

For concrete to develop its desired properties, it is essential that its compaction is done properly.

Procedure

The compaction of pavement is normally achieved by a vibrating screed supplemented by two internal vibrators. Vibrating screed may be supplemented by portable needle vibrator.

It may be ensured that proper compaction equipment is provided as per specifications and that the compaction activity is carried out for the specified duration.

1501.22 Separation Membrane (Thickness and Laying)

Purpose

A separation membrane usually of polythene sheet, is provided between the concrete slab and the sub-base.

Procedure

It must be checked whether the separation membrane to be provided is as per specifications, particularly with regard to its thickness and that it is laid without creases.

1501.25 Alignment of Joints

Purpose

The alignment of joints should be as per specifications.

Procedure

The alignment of joints shall be checked at the end of each days work and made sure that it is as per specifications.

1501.26 Depth of Dowel Bars

Purpose

Dowel bars are provided in joints.

Procedure

The depth at which dowel bars are provided will be as per specifications and drawings.

1501.27 Texturing and Edging

Purpose

The pavement surface is given a texture before it hardens so that it prevents skidding.

Procedure

Just before the concrete becomes non-plastic, the surface shall be textured with an approved long handled steel or fibre brush conforming to the stipulations laid down in IRC : 43.

After belting and / or texturing has been completed, but before the concrete has taken its initial set, the edges of the slab shall be carefully finished so as to leave the pavement edges smooth and true to line. The floating, finishing and edging etc. shall be done using a wooden / steel bridge with legs straddled apart so as not to touch the pavement.

1502 Roller Compacted Concrete Pavement

Sec No.	Title	Test Ref No.
A)	Materials	
1502.1	Tests on Cement	800.1 to 800.3
1502.2	Tests on Fine Aggregate	800.12 to 800.16
1502.3	Tests on Coarse Aggregate	400
1502.4	Tests on Flyash	409
1502.5	Suitability of Water for Concrete	600.8
1502.6	Admixtures	1501.5
1502.7	Dowel Bars	1501.6
1502.8	Premoulded Joint Filler	1501.7
1502.9	Joint Sealing Compound	1501.8
1502.10	Tools, Plant and Equipment	1501.9
1502.11	Concrete Mix Design	1501.10
1502.12	Granular Subbase	401
1502.13	Trial Length	1501.12
B)	Construction & Workmanship	
1502.14	Subgrade and Sub-base	400
1502.15	Grading and Moisture Content of Aggregates	401.1
1502.16	Batching and Mixing	1501.19
1502.17	Workability of Concrete	800.15
1502.18	Compressive Strength of Concrete	800.17
1502.19	Straightness of Side Forms	900
1502.20	Transverse Contraction Joints (Width and Depth)	1501.27
1502.21	In-situ Density by Sand Replacement Method	308.1(a)
1502.22	Compaction and Surface Correction	1501.21 / 1501.29
1502.23	Surface Levels	301.10
1502.24	Surface Regularity	301.11
1502.25	Width of Pavement	1501.25
1502.26	Pavement Thickness	1501.26
1502.27	Cumulative Length of Cracks	Measuring Steel Tape
1502.28	Core Density	401.9
1502.29	Performance of Trial Length	1501.12
1502.30	Texturing and Edging	1501.29

1503 RECTANGULAR CONCRETE BLOCK PAVEMENT

Sec No.	Title	Test Ref No.
A)	Materials	
1503.1	Tests on Cement	800.1 to 800.3
1503.2	Tests on Fine Aggregates	800.12 to 800.16
1503.3	Tests on Coarse Aggregates	400
1503.4	Tests on Flyash	409
1503.5	Suitability of Water for Construction	600.8
1503.6	Admixtures	1501.5
1503.7	Joint Details, Pattern of Laying and End Restraints	1501.27
1503.8	Tools, Plants and Equipment	1501.9
1503.9	Mix Design for Concrete	1501.10
1503.10	Subgrade and Subbase	400
1503.11	Method of Manufacturing and Compacting Blocks	As per the Specifications
1503.12	Trial Length before commencement of regular work	1501.12
1503.13	Grading of Bedding and Joint Filling Sand	401.1
B)	Construction & Workmanship	
1503.14	Subgrade and Sub-base	400
1503.15	Compressive Strength of Concrete	800.17
1503.16	Pattern of Laying of Blocks and End Restraints	To check if it is as per drawing
1503.17	Earthen Shoulders (width and camber)	1501.25
1503.18	Width of Joints between blocks	1501.18
1503.19	Horizontal Alignment	301.9
1503.20	Surface Levels	301.10
1503.21	Surface Regularity	301.11
1503.22	Dimensions of Blocks (size and thickness)	To check if it is as per specifications
1503.23	Performance of Trial Length	1501.12
1503.24	General Workmanship	To check the quality of construction in general

1504 INTERLOCKING CONCRETE BLOCK PAVEMENT

Sec No.	Title	Test Ref No.
A)	Materials	
1504.1	Tests on Cement	800.1 to 800.3
1504.2	Tests on Fine Aggregates	800.12 to 800.16
1504.3	Tests on Coarse Aggregates	400
1504.4	Tests on Flyash	409
1504.5	Suitability of Water for Construction	600.8
1504.6	Admixtures	1501.5
1504.7	Joint Details, Pattern of Laying and End Restraints	1501.27
1504.8	Tools, Plants and Equipment	1501.9
1504.9	Mix design for Concrete	1501.10
1504.10	Base Course	400
1504.11	Method of Manufacturing and Compacting Blocks	As per Specifications
1504.12	Trial Length 30m before commencement of regular work	1501.12
1504.13	Block size and thickness	To check if it is as per specifications
1504.14	Water Absorption and Compressive Strength of Blocks	307.23 / 800.17
B)	Construction & Workmanship	
1504.15	Subgrade and Sub-base	400
1504.16	Dimensions and Tolerances of Paving Blocks	To check if it is as per specifications
1504.17	Compressive Strength of Concrete Blocks	800.17
1504.18	Paving Pattern of Blocks and End Restraints	To check if it is as per specifications
1504.19	Horizontal Alignment	301.9
1504.20	Surface Levels	301.10
1504.21	Surface Regularity	301.11
1504.22	Performance of Trial Length	1501.12
1504.23	General Workmanship	Quality of work in general

—◆—
SECTION 1600

**HILL ROAD
CONSTRUCTION**

—◆—

1600 HILL ROAD CONSTRUCTION

Sec No.	Title	Test Ref No.
A)	Materials	
	Tests on Stones	
1600.1	Compressive Strength of Stone	600.12
1600.2	Water Absorption of Stones	700.2
	Tests on Cement	
1600.3	Compressive Strength of Cement	800.3
1600.4	Fineness of Cement	409.1
1600.5	Setting Time of Cement	800.1
	Tests on Sand	
1600.6	Grain Size Analysis of Sand / Stone Dust	800.12
	Tests on Coarse Aggregates	
1600.7	Flakiness Index of Coarse Aggregates	402.3
1600.8	Deleterious Content and Organic Matter	800.13
1600.9	Specific Gravity, Density, Voids and Absorption	
1600.10	Crushing Strength	800.8
1600.11	Aggregate Impact Value	401.5
1600.12	Soundness	402.5,402.6
1600.13	Alkali Aggregate Reactivity	800.11
	Tests for Suitability of Water	
1600.14	Suitability of Water for Construction	600.8
	Tests on Steel	
1600.15	Characteristic Strength of Steel	1000.1
1600.16	Modulus of Elasticity of Steel	1000.2
1600.17	Ultimate Tensile Strength and Elongation	1000.3
B)	Construction & Workmanship	
1600.18	Degree of Compaction	301.8 (a)
1600.19	Workability of Concrete by Slump Test	800.19
1600.20	Compressive Strength of Concrete	800.26
1600.21	Flexural Strength of Concrete	800.27
1600.22	Horizontal Alignment	301.9
1600.23	Surface Levels	301.10
1600.24	Surface Regularity	301.11
1600.25	Earthworks	300
1600.26	Granular Sub base and Base and Bituminous work	400,500
1600.27	Cement Concrete Pavements, Blocks etc.	1500
1600.28	Cross Drainage Works	600,800,1400



SECTION 1700

TRAFFIC SIGNS AND MARKINGS



1700 TRAFFIC SIGNS AND MARKINGS

Sec No.	Title	Test Ref No.
A)	Materials	
Unless indicated otherwise, the materials will be as per the following specifications:		
1700.1	Colour, Configuration, Size, Location and Dimensions	As per IRC 67
1700.2	Concrete	Section 801
1700.3	Reinforcing Steel	As per IS : 1786
1700.4	Bolts, Nuts and Washers	As per IS : 1367
1700.5	MS Sheets, Plates and Supports	As per IS : 2062
1705.6	Reflectorised Paint	As per IS : 5
1705.7	Non Reflectorised Paint	As per IS : 164
1705.8	Paints for Road Markings	As per IS : 164



SECTION 1900

MAINTENANCE



1900 MAINTENANCE

1901, 1902, 1903, 1907 & 1914 Maintenance of Earthworks and Drains

Sec No.	Title	Test Ref No.
A)	Materials	
1900.1	Soils 301, 302, 303	
1900.2	Stones 700	
1900.3	Bricks, Cement, Mortar	600
B)	Construction & Workmanship	
1900.4	Horizontal Alignment	301.9
1900.5	Surface Levels	301.10
1900.6	Surface Regularity	301.11

1904 Maintenance of Bitumen Raods

Sec No.	Title	Test Ref No.
A)	Materials	
1904.1	Bituminous Materials	500
1904.2	Granular Materials / Aggregates	400
B)	Construction & Workmanship	
1904.3	Horizontal Alignment	301.9
1904.4	Surface Levels	301.10
1904.5	Surface Regularity	301.11

1905 Maintenance of Gravel Roads

Sec No.	Title	Test Ref No.
A)	Materials	
1905.1	Gravels / Soil Aggregates	402
B)	Construction & Workmanship	
1905.2	Horizontal Alignment	301.9
1905.3	Surface Levels	301.10
1905.4	Surface Regularity	301.11

1906 Maintenance of WBM Roads

Sec No.	Title	Test Ref No.
A)	Materials	
1906.1	WBM 405	
B)	Construction & Workmanship	
1906.2	Horizontal Alignment	301.9
1906.3	Surface Levels	301.10
1906.4	Surface Regularity	301.11

1908 Maintenance of Culverts and Small Bridges

Sec No.	Title	Test Ref No.
A)	Materials	
1908.1	Materials for Culverts and Small Bridges	1200
B)	Construction & Workmanship	
1908.2	Horizontal Alignment	301.9
1908.3	Surface Levels	301.10
1908.3	Surface Regularity	301.11

1909 Maintenance of Causeways

Sec No.	Title	Test Ref No.
A)	Materials	
1909.1	Materials for Causeways	1400
B)	Construction & Workmanship	
1909.2	Horizontal Alignment	301.9
1909.3	Surface Levels	301.10
1909.4	Surface Regularity	301.11

1910 Maintenance of Road Signs

Sec No.	Title	Test Ref No.
A)	Materials	
1910.1	Materials for Road Signs	1700

1911, 1912, 1913, 1915 Maintenance of Markings and Appurtenances

Sec No.	Title	Test Ref No.
A)	Materials	
1911.1	Materials for Markings and Appurtenances	1700

Appendix -1

LIST OF INDIAN STANDARDS REFERRED TO IN THE HANDBOOK

Section 300	EARTHWORKS
	Tests on Soil
1	Preparation of dry soil samples for various tests IS : 2720 (Part 1) – 1983
2	Determination of Water Content IS : 2720 (Part 2) – 1973 (Second Revision)
3	Grain Size Analysis IS : 2720 (Part 4) – 1985 (Second Revision)
4	Determination of Liquid Limit and Plastic Limit IS: 2720 (Part 5) – 1985 (Second Revision)
5	Determination of Water Content – dry density relationship using light compaction IS : 2720 (Part 7) – 1980 (Second Revision)
6	Determination of Water Content – dry density relationship using heavy compaction IS : 2720 (Part 8) – 1983 (Second Revision)
7	Laboratory Determination of CBR IS : 2720 (Part 16) – 1987
8	Determination of Total Soluble Solids IS : 2720 (Part 21) – 1965
9	Determination of Organic Content IS : 2720 (Part 22) – 1972
10	Determination of pH value : IS : 2720 (Part 26) – 1987)
11	Determination of Total Soluble Sulphates in Soil IS : 2720 (Part 27) – 1977
12	Determination of dry density of soils in place, by the sand replacement method IS : 2720 (Part 28) - 1974
	Tests on Stabilised Soils
13	Determination of Moisture Content of stabilized soil mixture IS L: 4332 (Part 2) – 1967
14	Determination of Moisture Content – dry density relation for stabilized soils mixtures IS : 4332 (Part 3) – 1967 (Amendment No.1)
15	Determination of Unconfined Compressive Strength of stabilized soils IS : 4332 (Part 5) – 1970
16	Determination of Cement Content of Cement Stabilised Soils IS : 4332 (Part 7) – 1973
17	Determination of Lime Content of Lime Stabilised Soils IS : 4332 (Part 8) – 1969
18	Determination of the Bituminous Stabilizer Content of Bitumen and Tar Stabilised Soils IS : 4332 (Part 9) – 1970
19	Tests for Soil/bituminous mixture IS : 4332 (Part 10) – 1969 (Amendment No.1)
	Tests on Cement
20	Determination of Fineness of Cement by dry sieving IS : 4031 (Part 1) – 1996 (Second Revision)
21	Determination for Fineness of Cement by Blaine's Air Permeability Method IS : 4031 (Part 2)-1999 (Second Revision)
22	Determination of Soundness IS : 4031 (Part 3) – 1988 (First Revision)
23	Determination of Consistency of Standard Cement Paste IS : 4031 (Part 4) – 1988

Appendix - 1

24	Determination of Initial and Final Setting times IS : 4031 (Part 5) – 1988 (First Revision)
25	Determination of Compressive Strength of Hydraulic Cement other than masonry cement IS : 4031 (Part 6) – 1988 (First Revision)
26	Determination of False Set IS : 4031 (Part 15) – 1991
Tests on Bricks	
27	Determination of Compressive Strength of Bricks IS : 3495 (Part 1) – 1992
28	Determination of Water Absorption of Bricks IS : 3495 (Part 2) – 1992
29	Determination of Efflorescence of Bricks IS : 3495 (Part 3) – 1992
30	Determination of Warpage IS : 3495 (Part 4) – 1992
Tests on Cement Sand Mortar	
31	Determination of Consistency of Masonry Mortar IS : 2250 – 1981
32	Measurement of Water Retentivity of Masonry Mortar IS : 2250 – 1981
33	Determination of Compressive Strength of Masonry Mortars IS : 2250 – 1981
34	Code of Practice for Preparation and Use of Masonry Mortars IS : 2250-1981 (First Revision)
Tests on Quick Lime and Hydrated Lime	
35	Determination of available lime (as CaO) IS : 1514-1990
36	Method of Sampling and Test for quicklime and hydrated lime IS : 1514-1990 (First Revision)
Tests on Sand / Stone Dust	
37	Sand for masonry mortars IS : 2116- 1980 (First Revision)
38	Measuring Mortar making properties of fine aggregate IS : 2386 (Part 6) – 1963 (Amendment No.2)
39	Coarse and Fine Aggregates from natural sources from concrete IS : 383 – 1970 (Second Revision)
Tests on Stones	
40	Method of test for determination of water absorption, apparent specific gravity and porosity of natural building stones IS : 1124 – 1974 (First Revision)
Section 400	GRANULAR CONSTRUCTION / USE OF LOCAL MATERIALS
Tests on Aggregates / WBM / Base / Sub-base	
1	Specifications for Coarse Aggregate for Water bound Macadam IS : 6579-1981 (First Revision) (Amendment No.1)
2	Method of Test for Determining Stripping Value of road aggregates IS : 6241- 1971
3	Particle Size and Shape IS : 2386 (Part 4) –1963
4	Estimation of Deleterious Materials and Organic Impurities, IS 2386 (Part 2) – 1963
5	Specific Gravity, Density, Voids, Absorption and Bulking IS : 2386 (Part 3) – 1963
6	Mechanical Properties (Crushing Value, Aggregate Impact Value, Abrasion, Polished Stone, Crushing Strength) IS : 2386 (Part 4) – 1968
7	Soundness IS : 2386 (Part 5) – 1963
8	Measuring Mortar making properties of Fine Aggregates IS : 2386 (Part 6) – 1963

Tests on Stones	
15	Method of test for determination of water absorption, apparent specific gravity and porosity of natural building stones IS : 1124 – 1974 (First Revision)
Tests on Cement Sand Mortar	
16	Determination of Consistency of Masonry Mortar IS : 2250 – 1981
17	Measurement of Water Retentivity of Masonry Mortar IS : 2250 – 1981
18	Determination of Compressive Strength of Masonry Mortars IS : 2250 – 1981
19	Code of Practice for Preparation and Use of Masonry Mortars IS : 2250-1981 (First Revision)
20	Code of Practice for Brickwork IS : 2212-1991 (First Revision)
21	Code of Practice for Jack-Arch Type of built up floor or roof IS : 2118-1991 (First Revision)
Section 700	STONES MASONRY FOR STRUCTURES
Tests on Cement Sand Mortar	
1	Determination of Consistency of Masonry Mortar IS : 2250 – 1981
2	Measurement of Water Retentivity of Masonry Mortar IS : 2250 – 1981
3	Determination of Compressive Strength of Masonry Mortars IS : 2250 – 1981
4	Code of Practice for Preparation and Use of Masonry Mortars IS : 2250-1981 (First Revision)
Tests on Stones	
5	Method of test for determination of water absorption, apparent specific gravity and porosity of natural building stones IS : 1124 – 1974 (First Revision)
6	Construction of Stone Masonry – Code of Practice Part –I rubble stone masonry IS : 1597 (Part 1) – 1992 (First Revision)
Section 800	CONCRETE FOR STRUCTURES
Tests on Cement	
1	Determination of Fineness of Cement by dry sieving IS : 4031 (Part 1) – 1996 (Second Revision)
2	Determination for Fineness of Cement by Blaine’s Air Permeability Method IS : 4031 (Part 2)- 1999 (Second Revision)
3	Determination of Soundness IS : 4031 (Part 3) – 1988 (First Revision)
4	Determination of Consistency of Standard Cement Paste IS : 4031 (Part 4) – 1988
5	Determination of Initial and Final Setting times IS : 4031 (Part 5) – 1988 (First Revision)
6	Determination of Compressive Strength of Hydraulic Cement other than masonry cement IS : 4031 (Part 6) – 1988 (First Revision)
7	Determination of False Set IS : 4031 (Part 15) – 1991
Tests on Sand / Stone Dust	
8	Sand for masonry mortars IS : 2116- 1980 (First Revision)
9	Measuring Mortar making properties of fine aggregate IS : 2386 (Part 6) – 1963 (Amendment No.2)
10	Coarse and Fine Aggregates from natural sources from concrete IS : 383 – 1970 (Second Revision)

Tests on Aggregates / WBM / Base / Sub-base	
11	Specifications for Coarse Aggregate for Water bound Macadam IS : 6579-1981 (First Revision) (Amendment No.1)
12	Method of Test for Determining Stripping Value of road aggregates IS : 6241- 1971
13	Particle Size and Shape IS : 2386 (Part 4) –1963
14	Estimation of Deleterious Materials and Organic Impurities, IS 2386 (Part 2) – 1963
15	Specific Gravity, Density, Voids, Absorption and Bulking IS : 2386 (Part 3) – 1963
16	Mechanical Properties (Crushing Value, Aggregate Impact Value, Abrasion, Polished Stone, Crushing Strength) IS : 2386 (Part 4) – 1968
17	Soundness IS : 2386 (Part 5) – 1963
18	Measuring Mortar making properties of Fine Aggregates IS : 2386 (Part 6) – 1963
19	Alkali Aggregate Reactivity IS : 2386 (Part 7) – 1963
Tests on Concrete	
20	Method of tests for strength of concrete (compressive Strength, Flexural Strength, Modulus of Elasticity) IS : 516 –1959
21	Code of Practice for plain and reinforced concrete IS : 458-1988 (Third Revision)
Tests on Water	
Section 900	FORWORK AND SURFACE FINISH FOR STRUCTURES
1	Code of Practice for painting of ferrous metals in buildings IS : 1477-1971 (Part 1 & 2) (First Revision)
2	Code of Practice for Painting Concrete, Masonry and Plaster Surfaces IS : 2395 (Part 1 & 2) – 1994 (First Revision)
Section 1000	TESTS ON STRUCTURAL STEEL
1	Specification for high strength deformed steel bars and wires for concrete reinforcement IS : 1786-1985
2	Mild steel and medium tensile steel bars IS : 432 (Part 1) – 1982 (Third Revision)
3	Code of Practice for inspection of welds IS : 822-1970
4	High stress deformed steel bars and wires for concrete reinforcement IS : 1786 – 1985 (Third Revision)
5	Steel for general structural purpose – Specifications
Section 1100	PIPE CULVERTS
1	Precast Concrete Pipes (With and without reinforcement) IS : 458-1988 (Third Revision)
2	Concrete Pipes – Methods of Tests IS : 3597 1998 (Second Revision)
Section 1200	RCC SLAB CULVERTS AND MINOR BRIDGES
Tests on Cement	
1	Determination of Fineness of Cement by dry sieving IS : 4031 (Part 1) – 1996 (Second Revision)
2	Determination for Fineness of Cement by Blaine's Air Permeability Method IS : 4031 (Part 2)-1999 (Second Revision)
3	Determination of Soundness IS : 4031 (Part 3) – 1988 (First Revision)
4	Determination of Consistency of Standard Cement Paste IS : 4031 (Part 4) – 1988

Appendix - 1

5	Determination of Initial and Final Setting times IS : 4031 (Part 5) – 1988 (First Revision)
6	Determination of Compressive Strength of Hydraulic Cement other than masonry cement IS : 4031 (Part 6) – 1988 (First Revision)
7	Determination of False Set IS : 4031 (Part 15) – 1991
Tests on Sand / Stone Dust	
8	Sand for masonry mortars IS : 2116- 1980 (First Revision)
9	Measuring Mortar making properties of fine aggregate IS : 2386 (Part 6) – 1963 (Amendment No.2)
10	Coarse and Fine Aggregates from natural sources from concrete IS : 383 – 1970 (Second Revision)
Tests on Aggregates / WBM / Base / Sub-base	
11	Specifications for Coarse Aggregate for Water bound Macadam IS : 6579-1981 (First Revision) (Amendment No.1)
12	Method of Test for Determining Stripping Value of road aggregates IS : 6241- 1971
13	Particle Size and Shape IS : 2386 (Part 4) –1963
14	Estimation of Deleterious Materials and Organic Impurities, IS 2386 (Part 2) – 1963
15	Specific Gravity, Density, Voids, Absorption and Bulking IS : 2386 (Part 3) – 1963
16	Mechanical Properties (Crushing Value, Aggregate Impact Value, Abrasion, Polished Stone, Crushing Strength) IS : 2386 (Part 4) – 1968
17	Soundness IS : 2386 (Part 50 – 1963
18	Measuring Mortar making properties of Fine Aggregates IS : 2386 (Part 6) – 1963
19	Alkali Aggregate Reactivity IS : 2386 (Part 7) – 1963
Tests on Concrete	
20	Method of tests for strength of concrete (compressive Strength, Flexural Strength, Modulus of Elasticity) IS : 516 –1959
21	Code of Practice for plain and reinforced concrete IS : 458-1988 (Third Revision)
Tests on Flyash	
22	Method of test for Pozzolanic Material IS : 1727-1967 Covers the following (a) Chemical (g) Transverse Strength (b) Flakiness (h) Drying Shrinkage (c) Soundness (i) Permeability (d) Setting time (j) Reduction in Alkinity and silica release (e) Lime Reactivity (k) Specific gravity (f) Compressive Strength
23	Pulverised Fuel Ash – Specifications , Part – 1 for use as pozzolana in cement, cement mortar and concrete IS : 3812 (Part 1) – 2003
Section 1300 PROTECTION WORK AND DRAINAGE	
1	Ready mixed paint, brushing for road marking, to Indian Standard Color No.356 Golden Yellow, White and Black IS : 164-1981
2	Specifications for Galvanised steel barked wire for fencing IS : 280-1978 (Third Revision)
3	Specifications for hot applied sealing compounds for joints in concrete IS : 1834-1984 (First Revision)
4	Code of Practice for Painting of ferrous metals in buildings IS : 1477 (Part 1 & 2)

Section 1400 CEMENT CONCRETE CAUSEWAYS	
Tests on Cement	
1	Determination of Fineness of Cement by dry sieving IS : 4031 (Part 1) – 1996 (Second Revision)
2	Determination for Fineness of Cement by Blaine's Air Permeability Method IS : 4031 (Part 2)-1999 (Second Revision)
3	Determination of Soundness IS : 4031 (Part 3) – 1988 (First Revision)
4	Determination of Consistency of Standard Cement Paste IS : 4031 (Part 4) – 1988
5	Determination of Initial and Final Setting times IS : 4031 (Part 5) – 1988 (First Revision)
6	Determination of Compressive Strength of Hydraulic Cement other than masonry cement IS : 4031 (Part 6) – 1988 (First Revision)
7	Determination of False Set IS : 4031 (Part 15) – 1991
Tests on Sand / Stone Dust	
8	Sand for masonry mortars IS : 2116- 1980 (First Revision)
9	Measuring Mortar making properties of fine aggregate IS : 2386 (Part 6) – 1963 (Amendment No.2)
10	Coarse and Fine Aggregates from natural sources from concrete IS : 383 – 1970 (Second Revision)
Tests on Aggregates / WBM / Base / Sub-base	
11	Specifications for Coarse Aggregate for Water bound Macadam IS : 6579-1981 (First Revision) (Amendment No.1)
12	Method of Test for Determining Stripping Value of road aggregates IS : 6241- 1971
13	Particle Size and Shape IS : 2386 (Part 4) –1963
14	Estimation of Deleterious Materials and Organic Impurities, IS 2386 (Part 2) – 1963
15	Specific Gravity, Density, Voids, Absorption and Bulking IS : 2386 (Part 3) – 1963
16	Mechanical Properties (Crushing Value, Aggregate Impact Value, Abrasion, Polished Stone, Crushing Strength) IS : 2386 (Part 4) – 1968
17	Soundness IS : 2386 (Part 50 – 1963
18	Measuring Mortar making properties of Fine Aggregates IS : 2386 (Part 6) – 1963
19	Alkali Aggregate Reactivity IS : 2386 (Part 7) – 1963
Tests on Concrete	
20	Method of tests for strength of concrete (compressive Strength, Flexural Strength, Modulus of Elasticity) IS : 516 –1959
21	Code of Practice for plain and reinforced concrete IS : 458-1988 (Third Revision)
Tests on Flyash	
22	Method of test for Pozzolanic Material IS : 1727-1967 Covers the following (a) Chemical (g) Transverse Strength (b) Flakiness (h) Drying Shrinkage (c) Soundness (i) Permeability (d) Setting time (j) Reduction in Alkinity and silica release (e) Lime Reactivity (k) Specific gravity (f) Compressive Strength

Appendix - 1

23	Pulverised Fuel Ash – Specifications , Part – 1 for use as pozzolana in cement, cement mortar and concrete IS : 3812 (Part 1) – 2003
Section 1500 CEMENT CONCRETE / ROLLER COMPACTED PAVEMENTS	
Tests on Cement	
1	Determination of Fineness of Cement by dry sieving IS : 4031 (Part 1) – 1996 (Second Revision)
2	Determination for Fineness of Cement by Blaine’s Air Permeability Method IS : 4031 (Part 2)-1999 (Second Revision)
3	Determination of Soundness IS : 4031 (Part 3) – 1988 (First Revision)
4	Determination of Consistency of Standard Cement Paste IS : 4031 (Part 4) – 1988
5	Determination of Initial and Final Setting times IS : 4031 (Part 5) – 1988 (First Revision)
6	Determination of Compressive Strength of Hydraulic Cement other than masonry cement IS : 4031 (Part 6) – 1988 (First Revision)
7	Determination of False Set IS : 4031 (Part 15) – 1991
Tests on Sand / Stone Dust	
8	Sand for masonry mortars IS : 2116- 1980 (First Revision)
9	Measuring Mortar making properties of fine aggregate IS : 2386 (Part 6) – 1963 (Amendment No.2)
10	Coarse and Fine Aggregates from natural sources from concrete IS : 383 – 1970 (Second Revision)
Tests on Aggregates / WBM / Base / Sub-base	
11	Specifications for Coarse Aggregate for Water bound Macadam IS : 6579-1981 (First Revision) (Amendment No.1)
12	Method of Test for Determining Stripping Value of road aggregates IS : 6241- 1971
13	Particle Size and Shape IS : 2386 (Part 4) –1963
14	Estimation of Deleterious Materials and Organic Impurities, IS 2386 (Part 2) – 1963
15	Specific Gravity, Density, Voids, Absorption and Bulking IS : 2386 (Part 3) – 1963
16	Mechanical Properties (Crushing Value, Aggregate Impact Value, Abrasion, Polished Stone, Crushing Strength) IS : 2386 (Part 4) – 1968
17	Soundness IS : 2386 (Part 5) – 1963
18	Measuring Mortar making properties of Fine Aggregates IS : 2386 (Part 6) – 1963
19	Alkali Aggregate Reactivity IS : 2386 (Part 7) – 1963
Tests on Concrete	
20	Method of tests for strength of concrete (compressive Strength, Flexural Strength, Modulus of Elasticity) IS : 516 –1959
21	Code of Practice for plain and reinforced concrete IS : 458-1988 (Third Revision)

Tests on Flyash													
22	<p>Method of test for Pozzolanic Material IS : 1727-1967 Covers the following</p> <table style="width: 100%; border: none;"> <tr> <td style="width: 50%;">(a) Chemical</td> <td style="width: 50%;">(g) Compressive Strength</td> </tr> <tr> <td>(b) Flakiness</td> <td>(h) Transverse Strength</td> </tr> <tr> <td>(c) Soundness</td> <td>(i) Drying Shrinkage</td> </tr> <tr> <td>(d) Setting time</td> <td>(j) Permeability</td> </tr> <tr> <td>(e) Lime Reactivity</td> <td>(k) Reduction in Alkinity and silica release</td> </tr> <tr> <td>(f) Compressive Strength</td> <td>(l) Specific gravity</td> </tr> </table>	(a) Chemical	(g) Compressive Strength	(b) Flakiness	(h) Transverse Strength	(c) Soundness	(i) Drying Shrinkage	(d) Setting time	(j) Permeability	(e) Lime Reactivity	(k) Reduction in Alkinity and silica release	(f) Compressive Strength	(l) Specific gravity
(a) Chemical	(g) Compressive Strength												
(b) Flakiness	(h) Transverse Strength												
(c) Soundness	(i) Drying Shrinkage												
(d) Setting time	(j) Permeability												
(e) Lime Reactivity	(k) Reduction in Alkinity and silica release												
(f) Compressive Strength	(l) Specific gravity												
22	Pulverised Fuel Ash – Specifications , Part – 1 for use as pozzolana in cement, cement mortar and concrete IS : 3812 (Part 1) – 2003												
23	Specifications for preformed fillers for expansion joints in concrete pavements and structures (non-												

Appendix -2

LIST OF TESTS

TEST	SECTION NO.
Accelerated Curing Test of Concrete	800.25
Aggregate Impact Value (Dry and Wet)	401.5
Alkali Aggregate Reactivity	800.11
Available Lime as CaO	403.1
Binder Content	504.10
CBR on Remoulded and Soaked Soil Samples	302.7
Cement for Stone Masonry for Drains	800
Characteristic Strength of Steel	1000.1
Compacted Thickness	401.10
Compressive Strength of Bricks	600.4
Compressive Strength of Cement	800.3
Compressive Strength of Concrete Cubes (150mm x 150mm x 150mm) at 28 days	800.26
Compressive Strength of Mortar	600.12
Consistency of Mortar	600.10
Consumption of Mortar in Stone Masonry	307.24
Crushing Strength	800.8
Deleterious Materials and Organic Impurities	800.6
Deviation from Drawings	1200.8,1300.8,1400.12
Deviations of Pre-Split Face from Plane Passing Through Adjacent Holes.	304.1
Dimensional Tolerances of Stones	700.1
Dimensional Tolerances of Bricks	600.1
Ductility of Bitumen	504.1 (c)
Edge Bearing Tests on Pipes	1100.10
Efflorescence of Bricks	600.3
Elastic Recovery Test	504.2 (c)
Equipment for Central Laboratory	121
Equipment for Field Laboratory	119
Equipment for Laboratory at District Level	120
Fineness of Cement	409.1
Finishing	600.15
Flakiness Index	402.3

Appendix - 2

Flexural Strength of Concrete	800.27
Free Swell Index	301.4
Gradation Analysis of Aggregates	401.1
Grain Size Analysis	301.1
Horizontal Alignment	301.9
Initial and Final Setting Time of Cement	800.1
Joint Filters and Crack Sealers	1501.7,1501.8
Lime Reactivity	409.3
Liquid Limit and Plastic Limit	301.2
Loss of Ignition	301.5
Measurements of Length, Internal Diameter, Barrel Thickness	1100.16
Moisture Content of Soil – Oven Drying Method	301.7 (a)
Nuclear Density Gauge Method	301.8 (c)
Organic Material Content	301.5
Paints for Highways Uses	1700
Penetration Test	504.1 (a)
Placement Moisture Content and Degree of Compaction	301.8
Plaster Finish – Tolerance	600.15
Proctors' Density	301.3
Quality of binder Straight run Bitumen (Penetration, Softening Point and Ductility)	504.1
Quality of Binder Modified Bitumen (Penetration, Softening Point, Elastic Recovery and Separation)	504.2
Quality of Binder Bitumen Emulsion (Viscosity, Residue on 600 micron sieve and Storage Stability)	507.2
Rate of Spread of Binder	503.6
Rebound Hammer Test	800.23
Sand Bath Method	301.7 (b)
Softening Point of Bitumen	504.1 (b)
Soluble Sulphate Content	301.6
Soundness by Autoclave Expansion	409.4
Soundness by Le Chatelier Method	409.5
Soundness of Cement	800.2
Soundness with Magnesium Sulphate	402.6
Soundness with Sodium Sulphate	402.5
Specific Gravity and Water Absorption of Aggregate	402.4
Standard Consistency of Cement	800.1
Storage Stability Tests on Emulsion	502.4

Stripping of Bitumen Aggregate Mixture	504.5
Suitability of Water for Construction	600.8
Surface Levels	301.10
Surface Regularity	301.11
Temperature of Binder	503.5
Residue on 600 Micron	502.3
Tests to Certify Suitability of Water for Construction	600.8
Thickness Compacted Layer	401.10
Thickness of Joints for General Brick Work – Tolerance	600.13
Thickness of Joints for Arches – Tolerance	600.14
Tolerances in Formwork	904
Ultimate Tensile Strength and Elongation	1000.1
Ultrasonic Pulse Velocity Test	800.24
Unconfined Compressive Strength of Stabilized Soil Samples	403.5
Viscosity of Binders	501.2
Water Absorption of Bricks	600.2
Water Absorption of Stones	700.2
Water Retentivity of Mortar	600.11
Workability of Concrete by Compaction Test	800.20
Workability of Concrete by Slump Test	800.19

Appendix - 3

LIST OF FORMS

DESCRIPTION	FORM NO.
EARTHWORKS	SECTION 300
Sieve Analysis of Soil	EW-1
Atterberg Limits Test	EW-2
Proctor Density	EW-3
Free Swell Index	EW-4
Determination of Organic Matter Content	EW-5
Determination of Soluble Sulphate Content	EW-6
Moisture Content of Soil by Oven Drying Method	EW-7
Moisture Content of Soil by Sand Bath Method	EW-8
Field Density of Soil (Sand replacement method)	EW-9
Field Density of the Soil (Core Cutter Method)	EW-10
Determining Swell Index	EW-11
CBR Test of Soil	EW-12
GRANULAR CONSTRUCTION	SECTION 400
Gradation Analysis of Aggregates	SB-1
Aggregate Impact Value	SB-2
Flakiness Index	GB-1
Water Absorption	GB-2
Soundness with Sodium Sulphate	GB-3
Soundness with Magnesium Sulphate	GB-4
Determination of Fineness of Cement	GB-5
BITUMINOUS CONSTRUCTION	SECTION 500
Storage Stability Test	BC-1
Flash Point of Bitumen	BC-2
Determination of Temperature of Binder	BC-3
Rate of Spread of Binder	BC-4
Penetration of Bitumen	BC-5
Softening Point of Bitumen	BC-6
Ductility of Bitumen	BC-7
Elastic Recovery Test	BC-8

Appendix - 3

Stripping Test of Aggregate	BC-9
Percentage of Binder	BC-10
BRICKWORK FOR CONSTRUCTION	SECTION 600
Water Absorption of Bricks	BR-1
Compressive Strength of Bricks	BR-2
Compressive Strength of Mortar	BR-3
STONE MASONRY FOR STRUCTURES	SECTION 700
Water Absorption of Stones	ST-1
CONCRETE FOR STRUCTURES	SECTION 800
Setting Time of Cement	CC-1
Soundness of Cement by Le-Chatelier Method	CC-2
Compressive Strength of Cement	CC-3
Crushing Strength of Coarse Aggregate	CC-4
Workability of Concrete	CC-5
Compressive Strength of Concrete Cubes	CC-6

Appendix - 4

LIST OF PHOTOGRAPHS

DESCRIPTION	PHOTO NO.
EARTHWORKS	SECTION 300
Sieve for Grain Size Analysis	1
Motorised Sieve Shaker	2
Liquid Limit Device	3
Universal Automatic Compactor	4
Electric Oven	5
Digital Balance	6
Sand Pouring Cylinder Apparatus	7
Nuclear Density Gauge	8
Laboratory CBR Test Apparatus	9
GRANULAR CONSTRUCTION	SECTION 400
Sieves for Aggregates	1
Impact Tester	2
Thickness Gauge	3
BITUMINOUS CONSTRUCTION	SECTION 500
Saybolt Viscometer	1
Ring and Ball Apparatus	2
Ductility Test Apparatus	3
Centrifuge Apparatus	4
CONCRETE FOR STRUCTURES	SECTION 800
Le Chatelier Mould	1
Vibrating Machine for Cement Cubes	2
Hand Operated Compression Testing Machine	3
Length Comparator	4
Bar Mould	5
Rebound Hammer	6
Ultrasonic Pulse Velocity Tester	7
Accelerated Curing Tank	8
Hand Operated Compression Testing Machine	9
Moulds	10
Flexure Test Apparatus	11

Appendix - 5

LIST OF TABLES

DESCRIPTION	TABLE NO.
EARTHWORKS	SECTION 300
Mass of Various Sized Materials to be Taken for Sieve Analysis	301.1.1
Maximum Weight of Material to be Retained on Each Sieve	301.1.2
Permissible Maximum Mass of Sample on 200mm Diameter	301.1.3
Typical values of maximum dry density and optimum water content	301.3.1
Tolerances in Surface Levels	301.10.1
Standard Loads for the CBR Test	302.7.1
GRANULAR CONSTRUCTION	SECTION 400
Desirable Sizes and Grading of Coarse Aggregates for Granular Construction	401.1.1
Desirable Sizes and Grading of Fine Aggregates (or Screenings)	401.1.2
Soil Pulverisation Requirements of Lime Stabilisation	403.6.1
BITUMINOUS CONSTRUCTION	SECTION 500
Nominal Rates of Spread for Binder and Chippings	502.8.1
BRICK WORK FOR STRUCTURES	SECTION 600
Permissible Limits of Solids in Construction Water	600.8.1
CONCRETE FOR STRUCTURES	SECTION 800
Limits of Deleterious Materials	800.6.1
Grading of Fine Aggregates for Alkali Aggregate Reactivity Test	800.11.1
Ultrasonic Pulse Velocity and Quality of Concrete	800.24.1
RCC SLAB CULVERTS AND MINOR BRIDGES	SECTION 1200
Tolerances in various dimensions and levels	1200.35.1

Appendix - 6

LIST OF FIGURES

DESCRIPTION	FIGURE NO.
EARTHWORKS	SECTION 300
Typical Grain Size Distribution Diagram	Figure 1
Determination of Liquid Limit	Figure 2
Modified Proctor Test Curve (Dry density Vs Moisture content)	Figure 3
Compaction Curves for a Range of Soil types	Figure 4
Set up for Rapid Determination of Moisture Content	Figure 5
Correlation Load Penetration Curve (CBR Test)	Figure 6
BRICK WORK FOR STRUCTURES	SECTION 600
Standard Cone Apparatus	Figure 7
Apparatus Assembly for Water Retention	Figure 8
Mixing Bowl	Figure 9
A Mixer Blade	Figure 10
PIPE CULVERTS	SECTION 1100
Three Edge Bearing	Figure 11

Appendix-7

Measurement Conversion Factors

To convert from the unit in the first column to the unit in the second column, multiply by the factor in the third column.

SI Unit	Customary Unit	Factor
Length		
Millimeters	Inches	0.039
Centimeters	Inches	0.394
Meters	Feet	3.281
Kilometers	Miles	0.621
Area		
Square millimeters	Square inches	0.00155
Square meters	Square feet	10.764
Square meters	Square yards	1.196
Hectares	Acres	2.471
Square kilometers	Square miles	0.386
Volume		
Liters	Gallons	0.264
Cubic meters	Cubic feet	35.314
Cubic meters	Cubic yards	1.308
Mass		
Grams	Ounces	0.035
Kilograms	Pounds	2.205
Megagrams	Short tons	1.102
Illumination		
Lux	Footcandles	0.093
Candelas per square meter	Footlamberts	0.292
Force and Pressure or Stress		
Newtons	Poundforce	0.225
Kilopascals	Poundforce per square inch	0.145
Temperature		
To convert Celsius temperature (°C) to Fahrenheit temperature (°F), use the following formula :°F = (°C x 1.8) + 32		

Conversion between the Imperial and SI systems

1 bar = 10^6 dynes / $\text{cm}^2 = 10^5$ N / $\text{m}^2 = 10^5$ Pa = 0.1 Mpa = $1\text{kg} / \text{cm}^2$

1 atm = 1.013 bars = 14.7 psi = 2116 lbf / $\text{ft}^2 = 1.03125 \times 10^5$ Pa = $1.03125 \text{ kg} / \text{cm}^2$

1 slug = 1 lbf - $\text{s}^2/\text{ft} = 14.59$ kg

1 snail = 1 lbf- s^2 / in

1 gravity = $9.81 \text{ m} / \text{s}^2$

1 g = 9.81 N