केन्द्रीय विद्यालय संगठन
(शिक्षा मंत्रालय,भारत सरकार के अधीन स्वायत्त निकाय)
KENDRIYA VIDYALAYA SANGATHAN
(An Autonomous Body under Ministry of Education, Government of India)
क्षेत्रीय कार्यालय,तिनसुकिया (असम),REGIONAL OFFICE, TINSUKIA (ASSAM)
प्रांगण:केन्द्रीय विद्यालय तिनसुकिया/Campus: Kendriya Vidyalaya Tinsukia
राजा अली रोड, नौ-पुखरी, जिला :तिनसुकिया-786125/Raja Ali Road, Nau-Pukhuri,Tinsukia -786125
दूरभाष /Tel: 0374-2950031(DC)/2950029(AC), वेबसाईट/Website::rotinsukia.kvs.gov.inई-मेल/ E-mail :newkvstinsukia@gmail.com

फा.सं. 42346(2)/2026-27/के.वि.सं. /क्षे.का.ति./शै./ दिनांक:- 13.05.2026

(ई-मेल)

प्राचार्य
पी एम श्री केन्द्रीय विद्यालय चूड़ाचाँदपुर
मणिपुर।

विषय:- सीबीएसई संबद्धता की अवधि विस्तार हेतु अनुमोदन के संबंध में।
संदर्भ:- फ.सं. 1862-377/K.V.S/CHURACHANDPUR/2025-26/57, दिनांक :- 12.05.2026.

महोदया,

उपायुक्त, के.वि.सं. क्षेत्रीय कार्यालय तिनसुकिया द्वारा केंद्रीय विद्यालय चुराचांदपुर को सीबीएसई मानकों के अनुसार संबद्धता की अवधि विस्तार हेतु अनुमोदन प्रदान किया जाता है।

यह पत्र सक्षम अधिकारी की अनुमति से जारी किया जाता है।

भवदीय,

(राजेंद्र कुमार)
सहायक आयुक्त

प्राचार्य
पीएम श्री केन्द्रीय विद्यालय
चूड़ाचाँदपुर

20/5/26
विद्यालय प्रबंधन समिति
पी.एम.श्री.के.वि. चुड़ाचाँदपुर

SELF CERTIFICATION FORMATE

CATEGORY OF APPLICATIO: EXTENTION OF AFFILIATION

WE (I) MRS. ROSELYN KHAWBUNG(PRINCIPAL) OF THE SCHOOL PM SHRI KENDRIYA VIDYALAYA CHURACHANDPUR MANIPUR CERTIFY THAT:

	Following uploaded documents are genuine and valid
1	Establishment letter issued by the appropriate authority i.e Kendriya Vidyalaya Sangathan/Navodaya Vidyalaya samiti/Directorate of Education/Education Department:
2	Approval letter issued by appropriate Govt authority: DEPUTY COMMISSIONER
3	Fire Safety Certificate No.: No.5/2/Misc./2023-FS/214 Dated:16/03/2023
4	Fire Safety Certificate Issuing Authority: DIRECTOR MANIPUP FIRE SERVICE
5	Fire Safety Certificate Expiry Date: 16/03/2024
6	Building Safety Certificate No.: 58(A)/DD/EE-MANIPUR/2025-26/2025-26/69(H) Dated: 24/03/2026
7	Building Safety Issuing Authority: EXECUTIVE ENGINEER CPWD IMPHAL
8	Building Safety Certificate Expiry Date: 24/03/2027
9	Safe drinking water and Sanitary Condition Certificate No.: EE/CCP-PHE/MISC/2025-26/106(ii) Dated: 17.07.2025
10	Safe drinking water and Sanitary Condition Certificate Issuing Authority: EXECUTIVE ENGINEER PHE CHURACHANDPUR
11	Safe drinking water and Sanitary Condition Certificate Expiry Date: 17.07.2026

The mandatory Public disclosure has been displayed on the school's website and it's link has been filled in the Part A of the affiliation application.

That we have uploaded/submitted all the self-attested documents/ information on the School's Web-Portal and link in the application and the same are true and genuine.

That if any of the information is found to be false, misleading and /or that the fail(s) to disclose all the information and /or suppress any information and /or misrepresent the information, the Board shall also be free to take any action including withdrawal of affiliation.

Names and Signature(s): Roselyn

Principal: ROSELYN KHAWBUNG

ROSELYN KHAWBUNG Digitally signed by ROSELYN KHAWBUNG Date: 2026.05.18 10:00:24 +05'30'

Date: 18/05/2026

Place: Churachandpur

PRINCIPAL, प्राचार्य
PM SHRI K.V CHURACHANDPUR / पीएम श्री के वि चुड़ाचाँदपुर

20/5/26
अध्यक्ष/CHAIRMAN
विद्यालय प्रबंधन समिति
पी.एम.श्री.के.वि. चुड़ाचाँदपुर

म श्री कन्द्राय विद्यालय
एस.एफ, चूड़ाचाँदपुर
णिपुर पिन-795006
(शिक्षा मंत्रालय भारत सरकार)
वेबसाईट : bsfchurachandpur.kvs.ac.in
ई-मेल : kvccpur1862@gmail.com

केन्द्रीय विद्यालय संगठन

PM SHRI KENDRIYA VIDYALAYA
BSF CHURACHANDPUR
MANIPUR PIN-795006
(MINISTRY OF EDUCATION GOVT. OF INDIA)
Website : bsfchurachandpur.kvs.ac.in
E-Mail : kvccpur1862@gmail.com
Phone : 09402881383

F.NO.1862-350/K.V.S/CHURACHANDPUR/2026-27/ 62 *DATE - 18.05.2026*

CERTIFICATE

This is to certify that PM Shri KV Churachandpur is under the Ministry of Education and that all items of RTE act are being followed in letter and spirit.

Roselyn

रोज़लिन खोबुग/ ROSELYN KHAWBUNG
प्रभारी प्रचार्य/ PRINCIPAL I/C
PRINCIPAL/प्राचार्य
PM SHRI KV CHURACHANDPUR / पीएम श्री के वि चूड़ाचाँदपुर

Manel Singh

अध्यक्ष/CHAIRMAN 20/5/26
विद्यालय प्रबंधन समिति
पी.एम.श्री.के वि. चुड़ाचाँदपुर

श्री केन्द्राय विद्यालय
स.एफ, चूड़ाचाँदपुर
णिपुर पिन-795006
(शिक्षा मंत्रालय भारत सरकार)
वेबसाईट : bsfchurachandpur.kvs.ac.in
ई-मेल : kvccpur1862@gmail.com


केन्द्रीय विद्यालय संगठन

PM SHRI KENDRIYA VIDYALAYA
BSF CHURACHANDPUR
MANIPUR PIN-795006
(MINISTRY OF EDUCATION GOVT. OF INDIA)
Website : bsfchurachandpur.kvs.ac.in
E-Mail : kvccpur1862@gmail.com
Phone : 09402881383

F.NO.1862- 350 /K.V.S/CHURACHANDPUR/2026-27/ 63 *DATE – 18.05.2026*

CERTIFICATE

This is to certify that Fire Safety Certificate has been applied for and is under process. The online application is attached .

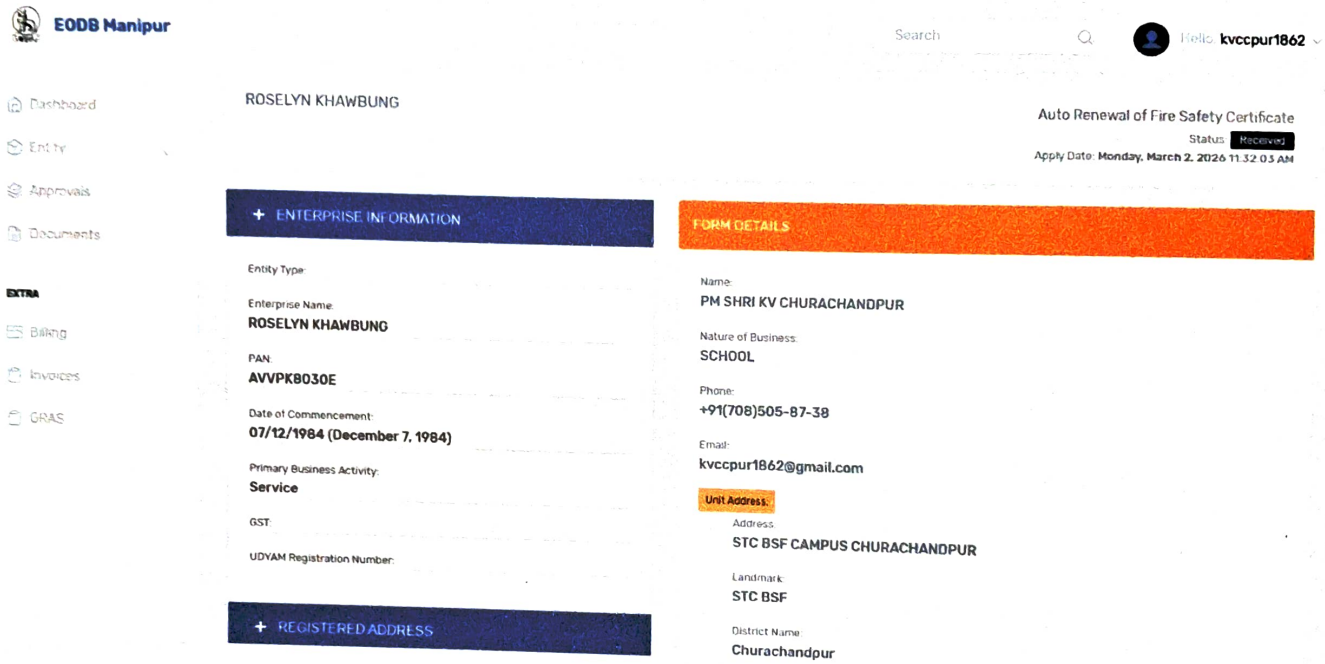

अध्यक्ष/CHAIRMAN 20/5/26
विद्यालय प्रबंधन समिति
पी.एम.श्री.के वि. चुड़ाचाँदपुर

रोज़लिन खोबुग/ ROSELYN KHAWBUNG
प्रभारी प्रचार्य/ PRINCIPAL I/C
PRINCIPAL
PM SHRI KV CHURACHANDPUR / पीएम श्री के वि. चूड़ाचांदपुर

GOVERNMENT OF MANIPUR
FIRE SERVICE DEPARTMENT

No. 5/2/MISC/2023-FS/ 214 Dated 16/03/2023.

FIRE SAFETY CERTIFICATE

Certified that the KENNDRIYA VIDYALAYA CHURACHANDPUR BSF (name of the school) located at STC BSF CAMPUS CHURACHANDPUR, CHURACHANDPUR DISTRICT, MANIPUR (address) comprised of PUCCA CONSTRUCTION owned/occupied by KENDRIYA VIDYALAYA SANGATHAN has already been issued fire safety certificate bearing No 5/2/MISC/2019-FS/742 The premises was re-inspected by *Shri W. Rona Singh, Sub-Officer* of Manipur Fire Service on 02/03/2023 (date of inspection) in the presence of ROSELYN KHAWBUNG, PRINCIPAL and observed that all the fire prevention and fire safety arrangements as provided in the premises found in good working condition. Therefore, the school is fit for occupancy of Class *GROUP "B" Educational building (B-1)*.. with effect from 16/03/2023 for a period of 1(one) year in accordance with rule and subject to compliance of the conditions.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life and property due to non-functional fire safety measures shall be at the responsibility of the management.
3. Fire-fighting training & mock drill exercise shall be organized quarterly/half yearly with intimation of fire Service Department.
4. The trained fire-fighting staff should be available round the clock.
5. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
6. Water source of Fire Fighting purposes be available in the school throughout the year.
7. All exits provided in the building shall be kept free from any obstruction.
8. First Aid Kits and necessary medicines are readily available in the school.
9. Fire/Emergency Telephone numbers shall be displayed on the Notice Board.
10. School/Institute buildings shall be insured against fire and natural calamities with group insurance of School/Institute Pupils obstruction

Issue on *16/03/2023.*

Signature with Seal : 16.3.2023

Name : *Themthing Ngashangva, IPS*
Designation : *Director,*
Manipur Fire Service,
Imphal.

Themthing Ngashangva, IPS
Director,
Manipur Fire Service, Imphal

सत्यमेव जयते

भारत सरकार
GOVERNMENT OF INDIA
केन्द्रीय लोक निर्माण विभाग
CENTRAL PUBLIC WORKS DEPARTMENT
कार्यालय कार्यपालक अभियंता (सि)
OFFICE OF THE EXECUTIVE ENGINEER (CIVIL)
का.अभि.- मणिपुर, जीपीआरए कॉलोनी, संगाइप्रोउ, इम्फाल-795140
MCD-I, GPRA Colony, Sangaiprou, IMPHAL-795140

CPWD

दूरभाष / फैक्स नं. 0385-2455095
ई – मेल:- ddo.mcdicpwd-mn@gov.in

पत्र सं. : 58(A) /DB/EE-Manipur /2025-26/ 169(H) दिनांक : 24 / 03 / 2026

SAFETY CERTICATE

It is certified that the school building of PM Shri Kendriya Vidyalaya, Churachandpur, Manipur seems fit and habitable from visual inspection for structural perspective & stability. Some defects and cracks are present but these do not seem dangerous and times being do not pose any threat to structure. But it is recommended to get these cracks & defects to be repair at earliest to prevent any further damages.

24/3/26
कार्यपालक अभियंता
का.अभि.-मणिपुर, के.लो.नि.वि.

Roselyn
प्राचार्य
पीएम श्री केन्द्रीय विद्यालय
चूड़ाचाँदपुर

Anand Singh 20/3/26
अध्यक्ष / CHAIRMAN
विद्यालय प्रबंधन समिति
पी.एम.श्री.के.वि. चुड़ाचाँदपुर

GOVERNMENT OF MANIPUR
PUBLIC HEALTH ENGINEERING DEPARTMENT

No. EE/CCP-PHE/Misc/2025-26/106(ii) DATE : 17.07.2025

SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

It is certified that an inspection headed by **Shri L Paulungmuan, Assistant Engineer** from **Churachandpur PHE-Division, Public Health Engineering Department (PHED), Manipur** inspected the **PM Shri Kendra Vidyalaya, Churachandpur, Manipur – 795128** on **15th July, 2025** and on the basis of Water Test Report (attached) bearing no. CCPDL2025-26000000020 dated 17/07/2025 certified that the **PM Shri Kendra Vidyalaya, Churachandpur** has safe drinking water facilities for the students and members of staff of the institution. The School also maintained safe and hygienic sanitation condition in the school building and the campus as per norms prescribed by the Central / State/ U.T. Govt.

This certificate is valid till 1 (One) Year

Signature with Seal

Executive Engineer
Churachandpur PHE Division
PHED, Manipur

Name : **John Thanglienmang**

Designation : **Executive Engineer**

Name & address of Department/Office:

Churachandpur PHE-Division, PHED, Bijang, Churachandpur, Manipur

प्राचार्य
पीएम श्री केन्द्रीय विद्यालय
चूड़ाचाँदपुर

अध्यक्ष/CHAIRMAN
विद्यालय प्रबंधन समिति
पी.एम.श्री.के. चूड़ाचाँदपुर

20/5/26

DISTRICT LABORATORY, PHED, CHURACHANDPUR, MANIPUR - 795128

CCPL Laboratory Govt. of Manipur Churachandpur 795128 PHED

FF-13
CCPDL/PHED, Manipur
Page No. 1/1

Head Quarter Veng, Churachandpur – 795128 Email: ccpphedlab@gmail.com Name & Address of Customer: PM SHRI Kendriya Vidyalaya BSF, Churachandpur.	TEST REPORT
	Report No. CCPDL2025-260000000020
	Date of Report: 17/07/2025
	Sample ID: 07/07
	Date of Collection of Sample: 15/07/2025
	Duration of Performance: 16/07/2025
	Ref. No.
	Date:- 17/07/2025

1	Description of Sample (As declared by customer)	Water
2	Sample Mark (If any, given by the customer)	NA
3	Date of Sampling by the Customer	15/07/2025
4	Source & Place of Sampling	1. Filtered water 2. Raw water
5	Environmental conditions during sampling	NA
6	Sampling Plan & Procedures used	NA
7	Quantity of Water	1 liter bottle

We hereby certify that the following sample submitted to the laboratory has been analyzed with the following results

Analysis Results (As per IS10500:2012)

Chemical Testing

Sl. No	Characteristic	Acceptable Limit	Permissible Limit	Method of Test	Results		
					1.	2	3.
1	Chloride (as Cl) in mg/l	250	1000	APHA 23rd Edition 4500-Cl B	17.00	20.00	
2	Total Dissolved Solids in mg/l	500	2000	APHA 23rd Edition 2540 C	160.50	240.00	
3	Total Alkalinity in mg/l as $CaCO_3$	200	600	APHA 23rd Edition 2320 B	40.00	42.00	
4	Calcium (as Ca) in mg/l	75	200	APHA 23rd Edition 3500 – Ca B	25.60	28.00	
5	Magnesium (as Mg) in mg/l	30	100	APHA 23rd Edition 3500 Mg B	7.29	5.83	
6	Electrical Conductivity in µmho/l	-	-	APHA 23rd Edition 2510 B	246.00	370.00	
7	pH value at 25°C	6.5-8.5	No Relaxation	APHA 23rd Edition 4500-H+B	6.80	6.82	
8	Turbidity in N.T. U	1	5	APHA 23rd Edition 2130 B	1.00	1.00	
9	Total Hardness in mg/l as $CaCO_3$	200	600	APHA 23rd Edition 2340 C	94.00	94.00	

The results relate only to the item(s) tested.

This Test Report shall not be reproduced except in full, without the permission of District Laboratory, PHED, Churachandpur, Manipur. The reserved part of sample(s) shall be retained for 7 days from the date of Completion of Test.

All parameters of tested sample 1 and 2 are in the range of the acceptable limit. It is safe for drinking purposes.

Prepared by:-
Signature

Sanjram Nomita Devi/ Ngamtinmang Touthang
Designation Jr. Chemist Lab Assistant

Authorized signatory:

Name: - John Thanglienmang
Designation: - Executive Engineer
Churachandpur, PHE Division, Manipur
Executive Engineer
Churachandpur PHE Division
PHED, Manipur

- This document is issued by District Laboratory, PHED, Churachandpur as per requested by customer with terms and conditions apply. Any holder of this document is advised that information contained hereon reflects the laboratory's tested results at the time of testing only and within the limits of client's instructions. The laboratory's sole responsibility is to its client's confidentiality. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of law. This document cannot be reproduced except in full, without prior approval of the laboratory.

End of Report

DISTRICT LABORATORY, PHED, CHURACHANDPUR, MANIPUR - 795128

FF-13
CCPDL/PHED, Manipur
Page No. 1/1

Head Quarter Veng, Churachandpur – 795128
Email: ccpphedlab@gmail.com
Name & Address of Customer:
PM SHRI Kendriya Vidyalaya BSF, Churachandpur.

TEST REPORT

Report No. CCPDL2025-260000000020
Date of Report: 17/07/2025
Sample ID: 07/07
Date of Collection of Sample: 15/07/2025
Duration of Performance: 16/07/2025
Ref No.
Date: - 17/07/2025

1	Description of Sample (As declared by customer)	Water
2	Sample Mark (If any, given by the customer)	NA
3	Date of Sampling by the Customer	15/07/2025
4	Source & Place of Sampling	1. Filtered water 2. Raw water
5	Environmental conditions during sampling	NA
6	Sampling Plan & Procedures used	NA
7	Quantity of Water	1 liter bottle

We hereby certify that the following sample submitted to the laboratory has been analyzed with the following results

Analysis Results (As per IS10500:2012)

Chemical Testing

Sl. No	Characteristic	Acceptable Limit	Permissible Limit	Method of Test	Results		
					1.	2	3.
1	Chloride (as Cl) in mg/l	250	1000	APHA 23rd Edition4500-Cl⁻ B	17.00	20.00	
2	Total Dissolved Solids in mg/l	500	2000	APHA 23rd Edition 2540 C	160.50	240.00	
3	Total Alkalinity in mg/l as $CaCO_3$	200	600	APHA 23rd Edition 2320 B	40.00	42.00	
4	Calcium (as Ca) in mg/l	75	200	APHA 23rd Edition 3500 – Ca B	25.60	28.00	
5	Magnesium (as Mg) in mg/l	30	100	APHA 23rd Edition 3500 Mg B	7.29	5.83	
6	Electrical Conductivity in µmho/l	-	-	APHA 23rdEdition 2510 B	246.00	370.00	
7	pH value at 25°C	6.5-8.5	No Relaxation	APHA 23rd Edition 4500-H⁺B	6.80	6.82	
8	Turbidity in N.T. U	1	5	APHA 23rd Edition 2130 B	1.00	1.00	
9	Total Hardness in mg/l as $CaCO_3$	200	600	APHA 23rd Edition 2340 C	94.00	94.00	

The results relate only to the item(s) tested.

This Test Report shall not be reproduced except in full, without the permission of District Laboratory, PHED, Churachandpur, Manipur. The reserved part of sample(s) shall be retained for 7 days from the date of Completion of Test.

All parameters of tested sample 1 and 2 are in the range of the acceptable limit. It is safe for drinking purposes.

Prepared by: -
Signature:

Sanjram Nomita Devi/ Ngamtinmang Touthang
Designation Jr. Chemist Lab Assistant

Authorized signatory:

Name: - John Thanglienmang
Designation: - Executive Engineer
Churachandpur, PHE Division, Manipur

Executive Engineer
Churachandpur PHE Division
PHED, Manipur

- This document is issued by District Laboratory, PHED, Churachandpur as per requested by customer with terms and conditions apply. Any holder of this document is advised that information contained hereon reflects the laboratory's tested results at the time of testing only and within the limits of client's instructions. The laboratory's sole responsibility is to its client's confidentiality. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of law. This document cannot be reproduced except in full, without prior approval of the laboratory.

---------- End of Report ----------

6/2021

NO : CBSE/1200005/EX-02307-2223/2022-23/

Dated: 18/06/2021

The Manager,
KENDRIYA VIDYALAYA CHURACHANDPUR MANIPUR
KENDRIYA VIDYALAYA,STC, BSF CAMPUS, NEW LAMKA,CHURACHANDPUR BPO-MUALKHOI
MANIPUR,CHURACHANDPUR, 795006
(M: 091-9402881383)

SUBJECT: -Extension of General Affiliation up to Secondary/Senior Secondary Level .

This is with reference to school application on the subject cited above. In this connection, I am directed to convey the approval of the Board for Extension of General Affiliation as per details given below:-

Affiliation No used as User ID for ~~both OASIS and~~ LOC/Registration System	**~~1200005~~**
School No	39351
Affiliated for	Extension of General Affiliation
Category	Extension of Affiliation
Period of affiliation	01.04.2022 to 31.03.2027

The above sanction is subject to fulfillment of following conditions:-

1. The approval is based upon the documents /data/information uploaded by the school online. The school will be responsible for its genuineness. In case of any discrepancies, necessary action will be initiated against the school as per Affiliation Bye -Laws-2018.
2. The school will follow the RTE Act, 2009 and instructions issued thereon by the CBSE/Respective State /UT Govt. from time to time. The school will also abide by the conditions prescribed, if any, by the State Government concerned.
3. The School is required to apply on online for extension of affiliation along with the requisite fee and other documents as per Rule 10.3 of Affiliation Bye Laws.
4. The school should go through the provision of Affiliation and Examination Bye Laws and subsequent amendment therein as well as circulars and guidelines /instructions issued by the Board time to time and keep a copy there of for reference purpose and is also advised to regularly visit CBSE websites i.e., http://cbseacademic.nic.in/ & http://cbse.nic.in/ for updates.
5. The school to renew mandatory certificates from time to time.
6. The school shall be solely responsible for any legal consequences arising out of the use of school name/logo/society/trust or any other identity /activity related to running of school affiliated to CBSE. All legal expenses incurred by the Board, if any, arising out of these circumstances, shall be borne by the school.

"~~The school shall possess valid fire safety certificate and Building safety certificate during~~ functioning of the school which shall be renewed from time to time as per norms".

DEPUTY SECRETARY/JOINT SECRETARY (AFF.)

ENROLMENT TABLE

SN	Location of School	Campus area	Affiliation Allowed	Optimum No. of Sections

				(From classes I/VI to X/XII)
A	Areas/Cities mentioned in clause 3.6	1600 sqm	Up to Class-X only	10
B	Areas/Cities mentioned in clause 3.6	2400 sqm	Up to Class-XII	24
C	Areas/Cities mentioned in clause 3.6	3200 sqm	Up to Class-XII	28
D	Class-X Cities (Clauses 3.5) and Areas mentioned in clause 3.7	2000 sqm	Up to Class-X only	10
E	Class-X Cities (Clauses 3.5) and Areas mentioned in clause 3.7	3000 sqm	Up to Class-XII	24
F	Class-X Cities (Clause 3.5) and Areas mentioned in clause 3.7 and Areas/Cities mentioned in clause 3.4	4000 sqm	Up to Class-XII	28
G	Pan India (Clause 3.3)	6000 sqm	Up to Class-XII	38
H	Pan India (Clause 3.2)	8000 sqm	Up to Class-XII	48
I	Pan India (Clause 3.2)	>8000 sqm	**Up to Class-XII** The number of sections shall be restricted in accordance with **'H'** above with land requirement unit scaled down to 2000 square meters i.e. 12 sections for every 2000 square meter additional land.	
· The total number of sections taken together for classes XI and XII should not be more than 1/3 of optimum number of section allowed on the basis of land holding for any school.				
· The number of sections and students shall be restricted as per the actual facilities in the school.				
· For class rooms of size less than 500 sq feet the enrolment shall be 0.08 X size of class rooms in sq feet				

Important Notes : Granted conditionally. As per part B there is no pucca wall surrounding the school. The school is required to make pucca boundary wall surrounding the school as per govt. norms. Well ness teacher/counselor and special educator to be appointed. Science labs, playground, Library etc. to be maintained as per the cbse norms. The safety certificates should be renewed in stipulated time period The school is required to act according the rules and regulations of the Board. Section teacher ratio should be maintained as per the affiliation bye laws.

Roselyn
प्राचार्य
पीएम श्री केन्द्रीय विद्यालय
चूड़ाचाँदपुर

20/5/26
अध्यक्ष/CHAIRMAN
विद्यालय प्रबंधन समिति
पी.एम.श्री.के वि. चुड़ाचाँदपुर

Appendix- 1 A

CERTIFICATE OF REGISTRATION UNDER SOCIETIES REGISTRATION ACT XXI OF *1860 (PUNJAB AMENDMENT) ACT 1957 AS EXTENDED TO THE UNION TERRITORY OF D E L H I.

No. S.2884 of 1965 -1966 .

I hereby certify that *CENTRAL SCHOOLS ORGANIZATION*

has this day been registered under the Societies Registration Act XXI of 1860 (Punjab Amendment) Act 1957, as extended to the Union Territory of Delhi.

Given under my hand at DELHI

this 15th day of DECEMBER

One thousand nine hundred and SIXTY FIVE.

Fee Rs. 50.00 paid.

REGISTRAR OF SOCIETIES DELHI

(SURENDER KISHORE)
REGISTRAR OF SOCIETIES
D E L H I.

DHINGRA

No.S/2884/167.

Dated 15-12-1965

From
The Registrar of Societies,
Old Secretriat,
Delhi.

To
Shri S.N. Dutt, Under Secy.,
Central School Units,
Room No.36, E-Block,
Ministry of Education, N.Delhi

Regd * CENTRAL SCHOOLS ORGANIZATION *

Dear Sir,

I am enclosing herewith the certificate of registration of your society named above. Please acknowledge receipt.

Yours faithfully,

(SURENDER KISHORE)
REGISTRAR OF SOCIETIES,
D E L H I.

Acknowledged
15/12

Encl: One Certificate.

DHINGRA

प्राचार्य
पीएम श्री केन्द्रीय विद्यालय
चूड़ाचाँदपुर

अध्यक्ष/CHAIRMAN 20/5/26
विद्यालय प्रबंधन समिति
पी.एम.श्री.के वि. चूड़ाचाँदपुर