


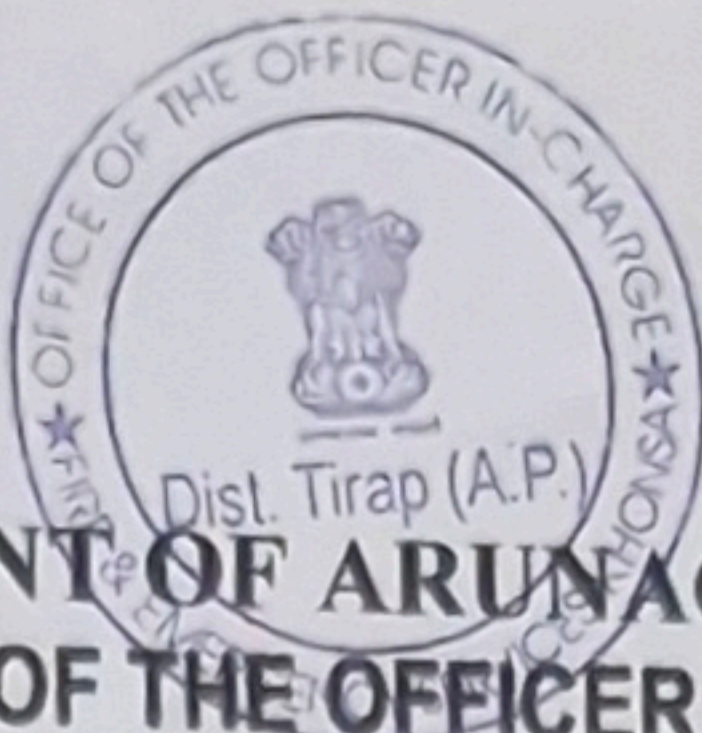

GOVERNMENT OF ARUNACHAL PRADESH
OFFICE OF THE OFFICER IN-CHARGE
FIRE & EMERGENCY SERVICES KHONSA
DISTRICT:: TIRAP (A.P)

NO. TAPP/KSA/FS-51/2024


Dated Khonsa the 19th Sept '2026.

TESTING & REFILL CERTIFICATE

Certified that the following Fire Extinguishers was hydraulically Pressure Tested/Refilled & Serviced by M.D. Enterprise at Guwahati (Assam) of M/s P.M. Shou. KENDRA VIDYALA KHONSA..... Market, Deomali, Tirap District (A.P) .

SL. NO	TYPE OF EXTINGUISHER	Date of Inspection/Hydraulic Testing	Date of Next Inspection	Hydraulic Testing			
				I-Test	II-Test	III-Test	Bursting Test
01	ABC – 04 kgs, 06 kgs ✓	12'Sept'2026	18'Sept'2027				
02	WATER TYPE 9 LTS.	-do-	Minutes	15 Bar	20 Bar	35 Bar	55 Bar
				30 sec	1 mins	3 mins	5 mins
03	FOAM TYPE 9 LTS ✓	-do-		-do-		-do-	-do-
04	CO2 (carbondioxide & Clean Agent)	-do-		-do-		-do-	-do-

Declaration:- if any Fire Extinguisher are not working at the time of initial stage of fire /any damages unfortunately Happen, The Re-filler Cum Fire Service should be look after.

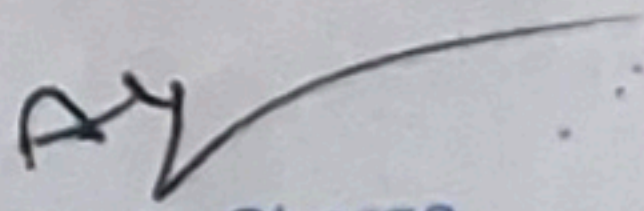
Officer In-Charge
Fire Station Khonsa
Tirap Distt. (A.P.)

Officer In-Charge
Fire Station Khonsa , Tirap District
Arunachal Pradesh