

ऑयल एण्ड नेचुरल गैस कॉरपोरेशन लिमिटेड OIL AND NATURAL GAS CORPORATION LTD.

अग्निशमन विभाग, अंकलेश्वर परिसम्पति FIRE SERVICES, ANKLESHWAR ASSET, अग्निशामक यंत्र परीक्षण रिपोर्ट

FIRE EXTINGUISHER EXAMINATION REPORT

INSTALLATION / RIG/FACILITY Central School

DATE: |6/ 11/2023.

SL NO.	TYPE OF FIRE EXTINGUSHERS & CAPACITY	QUANTITY	SERVICE REPORT/SPARES/CONSUMABLE USED/PERFOMANCE TEST DONE.
1	DCP 5 KG & BELOW		All co2 checked weight
2	DCP 9/10 KG		a crecening.
3	DCP 25 KG		
4	DCP 50 KG		NOIP: 2 Nos (02 65/19.
5	DCP 75 KG		
6	DCP 150 KG		Lode in Lab.
7	MECH FOAM 9 LTRS		
8	MECH FOAM 50 LTRS		Dep (SP) as wares
9	CO2 2.0 KG	05	tupe under HPT.
10	CO2 3.0 KG		Tope some contract
11	CO2 4.5 KG	01	
12	CO2 6.5 KG		
13	CO2 9.0 KG		
14	WATER 9.0 LTRS		
15	CLEAN AGENT		
	· · ·		
	1.		ā .

DETAILS OF MAINTENANCE CREW:

SR NO.	NAME	DESIGNATION
1	La prajopals	AFO
2	THE TUNE 1CE	JOFI)
3	1	
4		· · · · · · · · · · · · · · · · · · ·
5	Mora	

Jelly 12h

Shift I/C

I/c Fire Station



INDIA NON JUDICIAL Government of Gujarat

Certificate of Stamp Duty

Certificate No.

Certificate Issued Date

Account Reference

Unique Doc. Reference

Purchased by

Description of Document

Description

Consideration Price (Rs.)

First Party

Second Party

Stamp Duty Paid By

Stamp Duty Amount(Rs.)

IN-GJ56074939359455T

05-Jun-2021 11:43 AM

IMPACC (SV)/ gj13039404/ ANKLESHWAR1/ GJ-BH

SUBIN-GJGJ1303940447959916481927T

MANISH JAIN PRINCIPAL KV ONGC

Article 5(h) Agreement (not otherwise provided for)

DECLARATION REGARDING FIRE PROTECTION

SYSTEM

Rec

(Zero)


Not Applicable

MANISH JAIN PRINCIPAL KV ONGC

MANISH JAIN PRINCIPAL KV ONGC.

300


(Three Hundred only)



Keip it in Building job Very important

0015627493



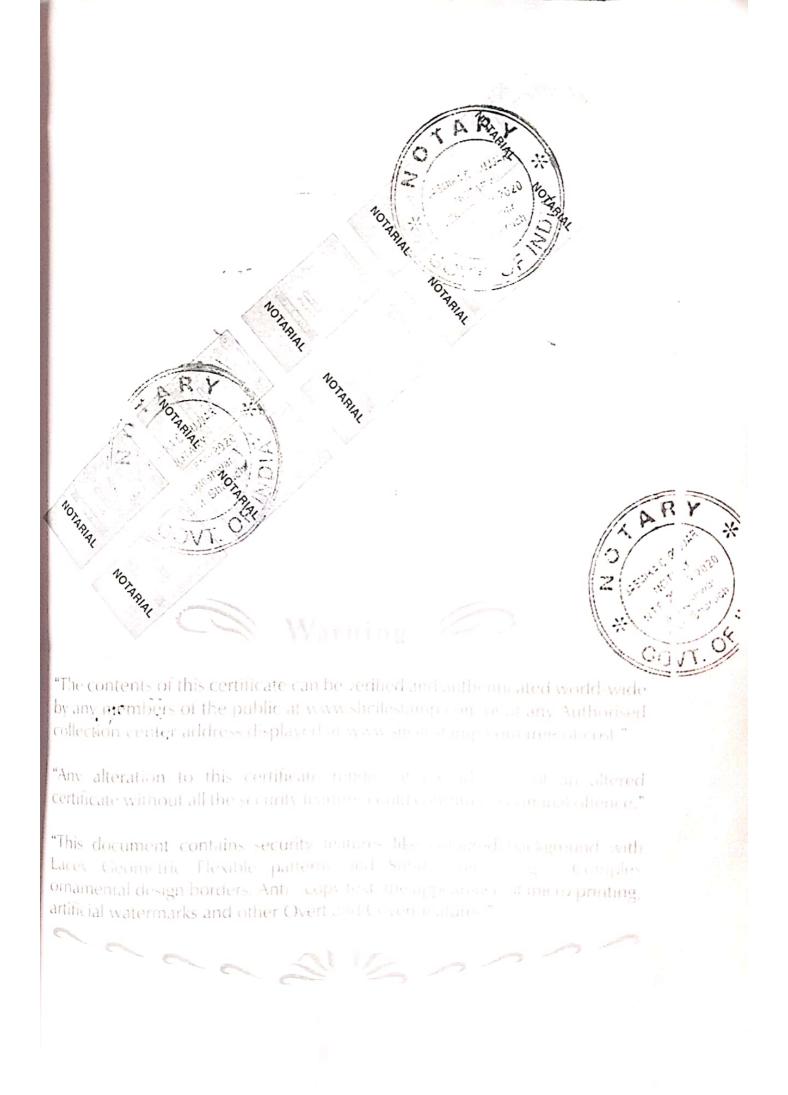

Declaration Regarding Fire Protection System

I MANISH JAIN, Principal KV ONGC, Ankleshwar hereby declare that KV ONGC, Ankleshwar school building is situated at ONGC Colony, Village:-Gadkhol, Ta.Ankleshwar, Dist.Bharuch.

I hereby declare that KV ONGC, Ankleshwar building height is <u>7.2 meter</u>, which is not Above-9 Meters. So fire noc is not required as per URBAN DEVLOPMENT AND URBAN HOUSING DEPARTMENT Notification Number GH/V/9 of 2021/AGN-102021-100-L-1, Date:- 22 January-2021, However for the fire safety purpose we have strictly followed the requirement of NATIONAL BUILDING CODE OF INDIA PART-4 FIRE AND SAFETY, We have provided in our building Fire Protection System as mentioned below which is as per requirment of NATIONAL BUILDING CODE OF INDIA PART-4 RELADED TO FIRE SAFETY.

1.

2.

Date:05/06/2021

Signature

Register Schial Manager Spires

My Commission Expires

on 611-03-2025

EXECUTED ACCEPTED

8 SIGNED BEFORE ME

8 SIGNED BEFORE ME

NOTARY

ADVOCATE & NOTARY

ADVOCATE & NOTARY

ANKLESHWAR, DI SHARUCH